

Lawrence Berkeley National Laboratory

Recent Work

Title

NEUTRON PRODUCTION BY Ne AND Si IONS ON A THICK Cu TARGET AT 670 MeV.A WITH APPLICATION TO RADIATION PROTECTION

Permalink

<https://escholarship.org/uc/item/3vc648dc>

Author

McCaslin, J.B.

Publication Date

1985-04-01



Lawrence Berkeley Laboratory

UNIVERSITY OF CALIFORNIA

Facilities Management & Technical Services Division

RECEIVED
LAWRENCE
BERKELEY LABORATORY
JUL 8 1985

LIBRARY AND
DOCUMENTS SECTION

Presented at the 1985 Particle Accelerator Conference, Vancouver, British Columbia, May 13-16, 1985; and to be published in the Proceedings


NEUTRON PRODUCTION BY Ne AND Si IONS ON A THICK Cu TARGET AT 670 MeV·A WITH APPLICATION TO RADIATION PROTECTION

J.B. McCaslin, P.R. LaPlant, A.R. Smith, W.P. Swanson, and R.H. Thomas

April 1985

TWO-WEEK LOAN COPY

*This is a Library Circulating Copy
which may be borrowed for two weeks.*

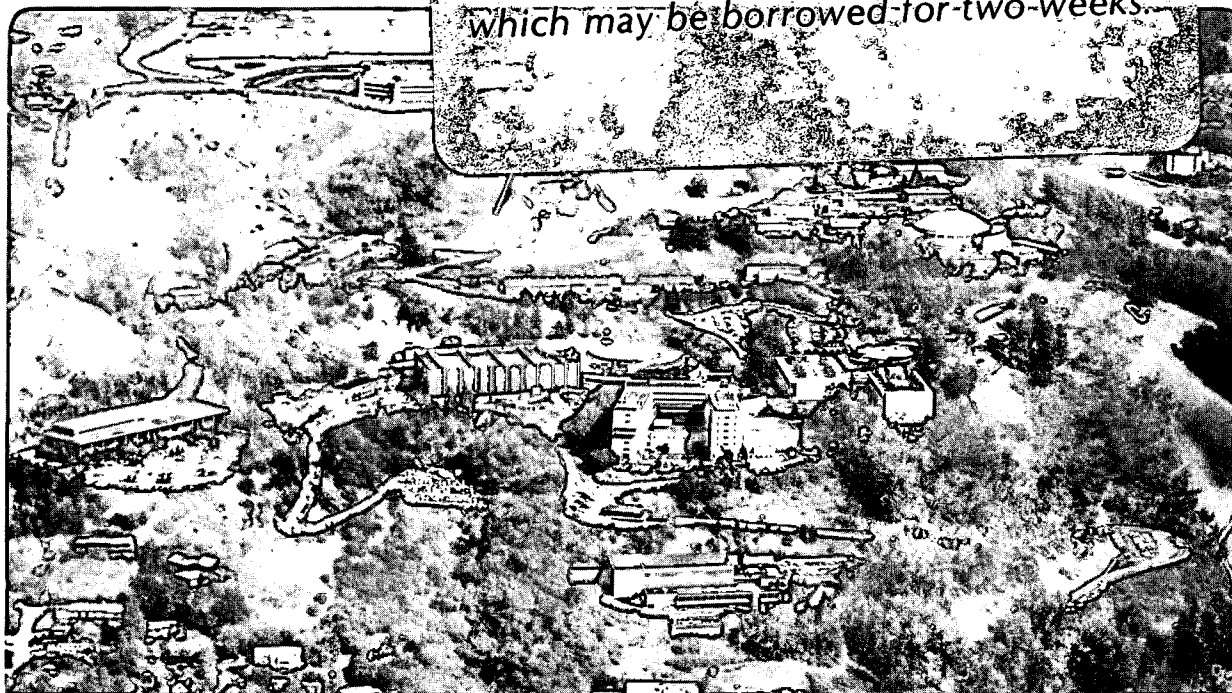

LBL-19648

DISCLAIMER

This document was prepared as an account of work sponsored by the United States Government. While this document is believed to contain correct information, neither the United States Government nor any agency thereof, nor the Regents of the University of California, nor any of their employees, makes any warranty, express or implied, or assumes any legal responsibility for the accuracy, completeness, or usefulness of any information, apparatus, product, or process disclosed, or represents that its use would not infringe privately owned rights. Reference herein to any specific commercial product, process, or service by its trade name, trademark, manufacturer, or otherwise, does not necessarily constitute or imply its endorsement, recommendation, or favoring by the United States Government or any agency thereof, or the Regents of the University of California. The views and opinions of authors expressed herein do not necessarily state or reflect those of the United States Government or any agency thereof or the Regents of the University of California.

NEUTRON PRODUCTION BY Ne AND Si IONS ON A THICK Cu TARGET
AT 670 MeV · A WITH APPLICATION TO RADIATION PROTECTION

Joseph B. McCaslin, Pierre R. LaPlant, Alan R. Smith,
William P. Swanson and Ralph H. Thomas
Lawrence Berkeley Laboratory
University of California
Berkeley, California 94720

Summary

Beams of neon and silicon at 670 MeV · A from the Bevalac were stopped in a copper target. Neutron yields and angular distributions were measured with activation detectors. Attenuation of neutrons through a concrete shield was measured at 7°, 54° and 72° to the beam direction. Dose equivalent estimates were made in adjoining areas by using moderated BF₃ proportional counters and carbon and aluminum activation detectors. Data are presented and radiation protection aspects discussed.

Experimental Arrangement

The purpose of these measurements is to determine source parameters which will be useful in shielding calculations for a proposed medical accelerator [1, 2]. Beams of Ne and Si at 670 MeV · A at an intensity of about 2.5 × 10⁸ ions/sec were brought from the Bevalac into Cave I (Fig. 1). The beam monitor was a calibrated secondary emission monitor. The targets used were 76.5 or 38.4 g cm⁻² of Cu, somewhat thicker than the range of the primary ions, Ne and Si, respectively, and were placed as shown on Fig. 1. Neutron detectors [3] were placed at several locations both within and outside of the cave (Table 1).

Table 1. Neutron Detectors Used.

Type of detector	Reaction	Energy Range
Indium	n capture	Thermal
BF ₃ (moderated)	¹⁰ B(n, α) ⁷ Li	0 - 15 MeV
Aluminum:	²⁷ Al --> ²⁴ Na	> 6.5 MeV
	²⁷ Al --> ²² Na	> 25 MeV
	²⁷ Al --> ¹⁸ F	> 50 MeV
Teflon	¹⁹ F --> ¹⁸ F	> 10 MeV
Polyethylene (CH ₂) _n	¹² C --> ¹¹ C	> 20 MeV

Attenuation Measurements

Secondary particles from primary beam interactions which have sufficient energy (>150 MeV) initiate hadronic cascades. Lower energy neutrons reach equilibrium with the highest energy component after 2 to 3 mean free paths and the subsequent ratio of low to high energy neutron intensity remains approximately constant. This makes it possible to measure the attenuation of the energy integrated fluence using low energy neutron detectors. In particular, advantage may be taken of the high activation cross sections of indium for thermal neutrons. Indium foils were placed in narrow spaces (to prevent neutron streaming) between concrete shielding blocks at known angles to the beam direction. Figure 2 shows measurements at angles of 7°, 54° and 72°, for Ne and Si beams.

Values of the effective attenuation length observed at 7°, λ_{conc} = 114 and 109 g cm⁻², for Ne and Si, respectively, are consistent with those at high energy proton accelerators and represent the maximum value. This is a consequence of the constancy of the inelastic cross sections at energies above about 150 MeV [4].

For the range of concrete shielding thickness used, the effective attenuation length decreases with increasing angle. Values obtained from Fig. 2 are 64 and 56 g cm⁻², for secondaries from Ne at 54° and 72°, respectively, and 61 g cm⁻² for

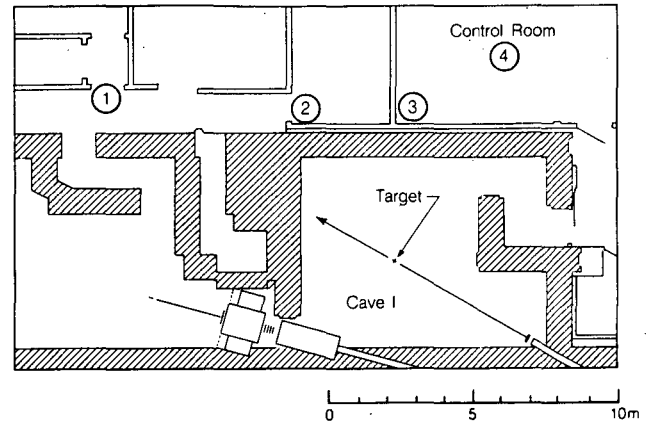


Fig. 1 Experimental arrangement around Cave I. Dose equivalent measurements were made with moderated BF₃ counter at locations 1 - 4.

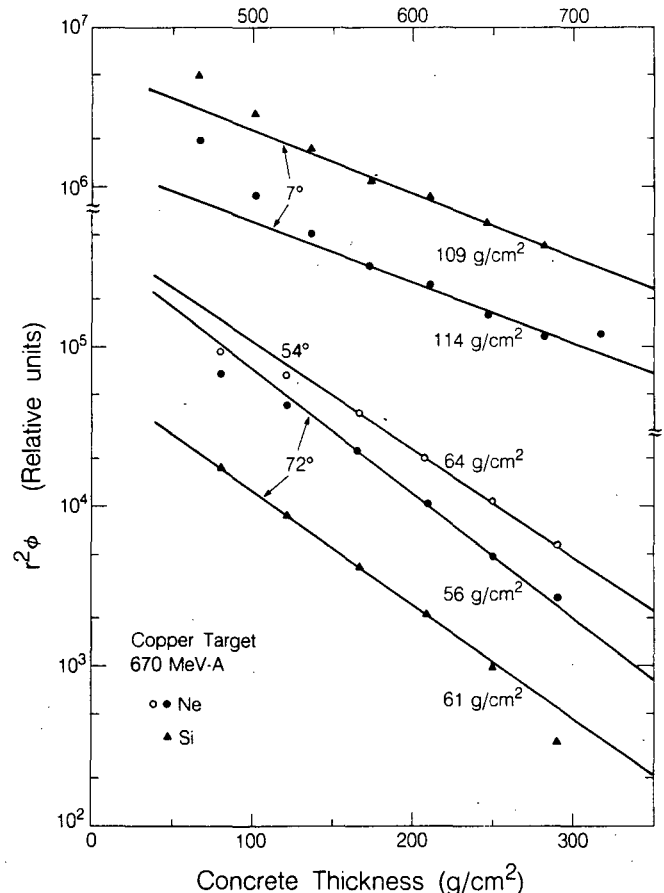


Fig. 2 Attenuation curves in concrete for secondaries from a Cu target struck by 670 MeV · A Ne or Si ions. Detectors are indium foils. Data at 7° begin at 466 g cm⁻² (upper scale). Units are relative.

Si at 72°. For a beam of Ne ions on Cu, $\lambda_{\text{conc}}(\theta)$ may be represented by the equations:

$$\text{For } \theta < 75^\circ: \quad \lambda_{\text{conc}}(\theta) = 115 e^{-0.01 \theta} \text{ g cm}^{-2}, \quad (1a)$$

$$\text{for } \theta > 75^\circ: \quad \lambda_{\text{conc}}(\theta) = 55 \text{ g cm}^{-2}, \quad (1b)$$

where the angle θ is in degrees. The second of these expressions (1b) is a conservative assumption and is used because of inadequate data at larger angles.

Even at large angles some secondary nucleons are produced which have sufficient energy to initiate hadronic cascades in target and shielding materials. In situations where the beam intensity is high, and thick shields are therefore required, it is these high energy particles, having an attenuation length of 115 g cm^{-2} which determine the shield thickness; the softer components of the secondary radiation emitted from the target are removed by the inner layers of the shield (see below).

Multiplying by the ratio of inelastic cross sections, we can infer that the attenuation in steel is given by

$$\lambda_{\text{Fe}}(\theta) = 0.436 \lambda_{\text{conc}}(\theta). \quad (2)$$

This gives the observed value of $\lambda_{\text{Fe}}(0^\circ) = 160 \text{ g cm}^{-2}$.

Angular Distribution and Yield Measurements

The angular distribution of secondary particles was studied using Al, $(\text{CH}_2)_n$ and teflon detectors, arranged around the Cu target on an arc of 1 m radius (Fig. 1). Results are shown in Figs. 3 and 4. The slope corresponding to $\exp[-2.3 \theta]$ (radians), indicated by the line segment represents the angular distribution derived for high energy proton interactions [5,

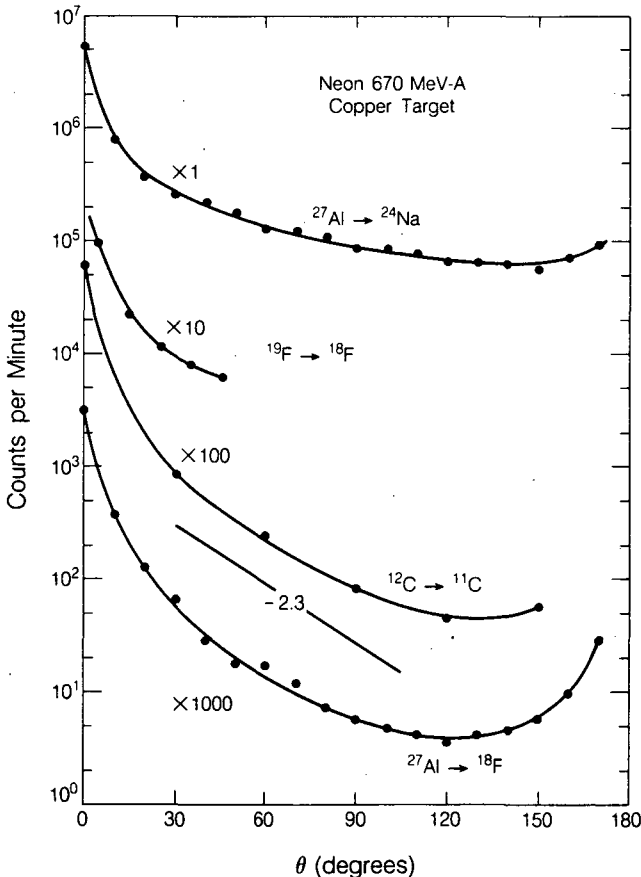


Fig. 3 Angular distributions as determined at 1 m by four types of activation detectors having thresholds in the range 6.5 - 50 MeV. Beam was 2.5×10^8 Ne ions sec^{-1} on to a thick Cu target. Normalization is arbitrary.

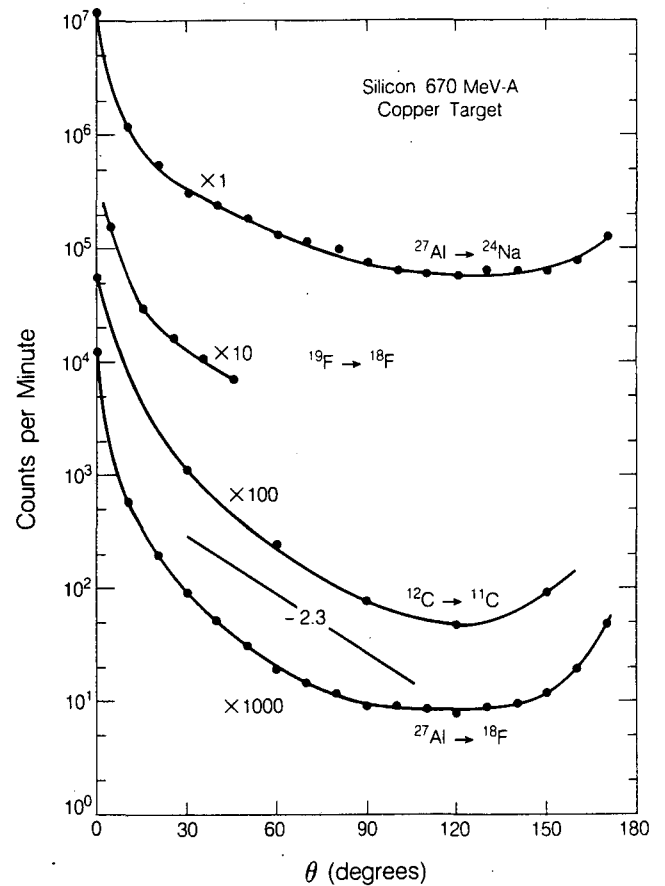


Fig. 4 As for Fig. 3 but using beam of Si ions.

6]. The upward tail at large angles on several of the observed distributions can be attributed to spurious particles accompanying the beam at large radii. An alternative explanation is that charged secondaries have less target material to penetrate in the backward direction, and enhance the count rate relative to sideward directions.

An analytical fit to the $^{27}\text{Al} \rightarrow ^{24}\text{Na}$ distribution, useful for computational purposes for the range $2^\circ < \theta < 180^\circ$ is:

$$\phi(\theta) = 3.72 \times 10^2 \theta^{-1} \text{ neutrons m}^{-2} / \text{ion}. \quad (3)$$

at 1 m for incident Ne ions (θ is in degrees).

Empirical Model for Thin Shields

The measurements described above suggest an empirical model used to calculate the dose equivalent, $H(\theta)$, outside shields within the range of thicknesses studied. On the basis of the measured attenuation lengths and angular distributions shown in Figs. 3 and 4, an empirical model was devised to fit measured dose equivalents at the locations shown in Fig. 1:

$$H(\theta) = N C_1 C_2 \phi(\theta) r^{-2} e^{-\ell(\theta)/\lambda(\theta)}, \quad (4)$$

where H is in Sv and θ is in degrees, and

- N is the number of Ne ions stopped in a copper target.
- C_1 accounts for that fraction of the dose equivalent due to neutrons of energy greater than 20 MeV. This factor ranges from 2 in heavily shielded areas to about 5 where the shielding is less thick [7, 8].
- C_2 converts fluence to dose equivalent. The value $2.33 \times 10^{-14} \text{ m}^2 \text{ Sv neutron}^{-1}$ was used [9].
- $\phi(\theta)$ is the neutron fluence 1 m from the target [neutrons m^{-2} ; equation (3)].
- $r(\theta)$ is the distance from the target to the detector (m).
- $\ell(\theta)$ is the shield thickness in the direction θ (g cm^{-2}).

$\lambda(\theta)$ is the attenuation length [g cm^{-2} ; equation (1)].

Combining the above factors, we obtain for a Ne beam on Cu:

$$H(\theta) = 8.67 \times 10^{-12} N C_1 \theta^{-1} r^{-2} e^{-\lambda(\theta)/\lambda(\theta)} \quad (5)$$

Table 2 compares the dose equivalent rates measured at the numbered locations on Fig. 1, to values calculated as just described. The model is accurate to within a factor of two for these conditions.

Table 2. Comparison with Measurements at 2.5×10^8 Ne/sec.

Location	θ (deg)	Distance (m)	Shielding Thickness (g/cm^2)	C_1	Dose Equivalent Rate Measured ($\mu\text{Sv/hr}$)	Dose Equivalent Rate Calculated ($\mu\text{Sv/hr}$)
1.	2	12.2	953	2	26	11
2.	30	6.1	251	5	2000	1840
3.	65	5.3	222	3	200	320
4.	80	8.8	237	2.2	50	37

This model is adequate to relate observed dose equivalent levels outside the shield to beam loss in Cave 1 and provides a rough guide for the proposed medical accelerator shielding. However, it is not necessarily applicable to geometries which substantially differ in lateral shielding thickness.

Dose Equivalent Estimates for Thick Shields

For the estimation of dose equivalent outside thick shields where particle equilibrium is achieved, equations (1) are inappropriate. Under such conditions we have

$$\lambda_{\text{conc}} = 115 \text{ g cm}^{-2} \quad (1c)$$

Additionally, in order to account for the nucleons emitted with sufficient energy to initiate hadronic cascades we base the source term, $\phi(\theta)$, on the fluence as measured by the reaction $^{12}\text{C} \rightarrow ^{11}\text{C}$. For incident Ne ions, we use parameterizations for the fluence at 1 m which are analogous to equation (3). For $0^\circ < \theta < 20^\circ$:

$$\phi(\theta) = 248 e^{-0.20 \theta} \text{ neutrons m}^{-2} / \text{ion} \quad (6a)$$

and for $20^\circ < \theta < 120^\circ$,

$$\phi(\theta) = 10 e^{-0.038 \theta} \text{ neutrons m}^{-2} / \text{ion} \quad (6b)$$

where θ is in degrees. Substituting these source terms, together with the value $C_1 = 2$, in equation (4), we have for $0^\circ < \theta < 20^\circ$:

$$H(\theta) = 12 \times 10^{-12} N e^{-0.20 \theta} r^{-2} e^{-\lambda(\theta)/115} \quad (7a)$$

and for $20^\circ < \theta < 120^\circ$,

$$H(\theta) = 0.48 \times 10^{-12} N e^{-0.038 \theta} r^{-2} e^{-\lambda(\theta)/115} \quad (7b)$$

where H is in Sv, r is in meters and λ is in g cm^{-2} .

These approximations are expected to be conservative for the forward hemisphere because they use a source term based on yields measured by the $^{12}\text{C} \rightarrow ^{11}\text{C}$ reaction (20 MeV threshold); this source term will be larger than that ideally needed (neutrons > 150 MeV). However, for angles larger than about 120° , the source term might be underestimated if the backward rise seen in Fig. 3 is significant.

The models of equations (5) and (7) have been used in the design of shielding for a proposed Heavy Ion Medical Accelerator which can accelerate a variety of ions from H to Ar, at energies up to 800 MeV/A and at intensities of 10^7 to 10^9 ions sec^{-1} [2].

Conclusions and Future Efforts

The uncertainties in the data presented here demonstrate the need for more detailed measurements. Neutron yields and angular distributions as functions of ion energy, ion species and target material are required. The attenuation of secondary neutrons in concrete at depths up to 6 m in the forward direction and 3 m in the transverse direction are needed.

Acknowledgements

The authors wish to express their gratitude to Jose R. Alonso, William T. Chu, Richard A. Gough and Tim R. Renner of the LBL Accelerator Division for their assistance and to Jensen Young, Head of the Environmental Health and Safety Department, and W. D. Hartsough, Head of Facilities Management, for support and encouragement. This work was supported by the U. S. Department of Energy under Contract No. DE-AC03-76SF00098 with the University of California.

References

- [1] J. B. McCaslin, P. R. LaPlant, A. R. Smith and R. H. Thomas, Lawrence Berkeley Laboratory, Bevalac Biomed Radiation Measurements, Health Physics Note 1 (Sept., 1983); and Health Physics Note 2 (Feb., 1984).
- [2] R. A. Gough (ed.), The Heavy Ion Medical Accelerator, Lawrence Berkeley Laboratory, Report PUB 5122 (1984).
- [3] R. H. Thomas, Neutron dosimetry at high energy particle accelerators, Vol. 1, Neutron Monitoring for Radiation Protection Purposes, Proc. Symp. on Neutron Monitoring for Radiation Protection Purposes, Vienna: IAEA (1972).
- [4] S. J. Lindenbaum, Shielding of high energy accelerators, Ann. Rev. Nucl. Sci. 11, 213 (1961).
- [5] G. S. Levine, D. M. Squier, G. B. Stapleton, K. Goebel, and J. Ranft, "The angular dependence of dose and hadron yields from targets in 8 GeV/c and 24 GeV/c extracted proton beams," Particle Accelerators 3, 91 (1972).
- [6] G. R. Stevenson, Liu Kuei-Lin and R. H. Thomas, Determination of transverse shielding for proton accelerators using the Moyer model, Health Phys. 43, 13 (1982).
- [7] J. B. McCaslin and R. H. Thomas, "Practical neutron dosimetry at high energies," European Seminar on Radiation Protection Quantities for External Exposure, held in Braunschweig, 13 - 15 October 1980, Commission of the European Communities, London: Harwood (1981).
- [8] R. H. Thomas and G. R. Stevenson, Radiation protection around high energy accelerators, Rad. Prot. Dosimetry 10 (1-4), 283 (1985).
- [9] H. W. Patterson and R. H. Thomas, Accelerator Health Physics, New York: Academic Press, 1973, p. 45.

This report was done with support from the Department of Energy. Any conclusions or opinions expressed in this report represent solely those of the author(s) and not necessarily those of The Regents of the University of California, the Lawrence Berkeley Laboratory or the Department of Energy.

Reference to a company or product name does not imply approval or recommendation of the product by the University of California or the U.S. Department of Energy to the exclusion of others that may be suitable.

TECHNICAL INFORMATION DEPARTMENT
LAWRENCE BERKELEY LABORATORY
UNIVERSITY OF CALIFORNIA
BERKELEY, CALIFORNIA 94720