

# UC Irvine

## UC Irvine Previously Published Works

### Title

Formation and measurement of N<sub>2</sub>O in combustion systems

### Permalink

<https://escholarship.org/uc/item/0ph713f1>

### Journal

Symposium (International) on Combustion, 23(1)

### ISSN

0082-0784

### Authors

Muzio, LJ  
Montgomery, TA  
Samuelsen, GS  
[et al.](#)

### Publication Date

1991

### DOI

10.1016/S0082-0784(06)80266-3

### License

[CC BY 4.0](#)

Peer reviewed

## FORMATION AND MEASUREMENT OF N<sub>2</sub>O IN COMBUSTION SYSTEMS

L. J. MUZIO, T. A. MONTGOMERY

*Fossil Energy Research Corporation*

G. S. SAMUELSEN

*University of California, Irvine*

J. C. KRAMLICH, R. K. LYON

*Energy and Environmental Research Corporation*

AND

A. KOKKINOS

*Electric Power Research Institute*

Direct N<sub>2</sub>O emissions from fossil fuel combustion have previously been reported to be equivalent to 25-40% of the NO<sub>x</sub> levels. At these levels, fossil fuels have been suggested to be a major anthropogenic source of N<sub>2</sub>O. Recent tests have shown these measurements to be in error, most of the N<sub>2</sub>O having been formed by reaction between NO<sub>x</sub>, SO<sub>2</sub>, and H<sub>2</sub>O in the sample containers. Time resolved measurements of gas samples stored in Tedlar bags, supported by chemical kinetic calculations, indicate that the majority of N<sub>2</sub>O forms over a time period of 6 hours. The conversion of NO<sub>x</sub> to N<sub>2</sub>O in the sample containers is shown to depend on the amount of SO<sub>2</sub> present.

This sampling artifact raises questions about the validity of the existing data base, collected by grab sampling methods. As a result, a continuous infrared analyzer, developed primarily for characterization of N<sub>2</sub>O emissions from full scale combustion sources, was used to perform on line N<sub>2</sub>O measurements at several full scale utility combustion systems. A variety of conventional and advanced utility combustion systems (firing pulverized coal, oil, and gas) were tested. The measurements from conventional systems (natural gas, oil, and pulverized coal-fired) indicate that the direct N<sub>2</sub>O emission levels are generally less than 5 ppm and are not related to the NO<sub>x</sub> levels in the flue gas. However circulating fluidized bed units produced elevated N<sub>2</sub>O emissions. At one circulating fluidized bed combustor firing a bituminous coal, N<sub>2</sub>O levels ranged from 84 to 126 ppm as the load was varied from 100% to 55%, respectively. The N<sub>2</sub>O emissions from the circulating fluidized bed appeared to be inversely related to the bed temperature. However, temperature is not the only parameter affecting N<sub>2</sub>O emissions from fluidized beds; all three of the units studied operated at similar temperatures during full load operation, but the N<sub>2</sub>O emissions ranged between 25 and 84 ppm. N<sub>2</sub>O emissions were also elevated at a full-scale boiler using selective non-catalytic NO<sub>x</sub> reduction with urea; 11-13% of the reduced NO<sub>x</sub> was converted to N<sub>2</sub>O.

### Background

The mean global concentration of N<sub>2</sub>O is approximately 300 ppb and has been increasing at a rate of 0.2-0.4% per year.<sup>1,2</sup> In the troposphere, N<sub>2</sub>O is a relatively strong absorber of infrared radiation, and, therefore implicated as a contributor to the "Greenhouse Effect." Being stable in the troposphere, N<sub>2</sub>O is transported to the strato-

sphere. In the stratosphere N<sub>2</sub>O is the largest source of stratospheric NO; NO is the primary species responsible for establishing the equilibrium stratospheric O<sub>3</sub> concentration.<sup>3</sup>

The increase of N<sub>2</sub>O in the atmosphere has been attributed to anthropogenic sources, although the dominant source of N<sub>2</sub>O is still uncertain. Weiss,<sup>2</sup> Hao et al.,<sup>4</sup> and Tirpak<sup>1</sup> suggest that combustion of fossil fuels results in emissions of N<sub>2</sub>O that can ac-

count for the observed increase in N<sub>2</sub>O. Previous N<sub>2</sub>O measurements from combustion sources indicate that systems fired with natural gas do not produce significant concentrations of N<sub>2</sub>O. However, substantial levels of N<sub>2</sub>O were reported from systems fired with residual oil or coals (e.g., fuels containing nitrogen and sulfur). In fact, the measurements of Hao et al.<sup>4</sup> and Castaldini et al.<sup>5</sup> suggest that the N<sub>2</sub>O emissions are related to the emissions of NO<sub>x</sub> (NO + NO<sub>2</sub>); the N<sub>2</sub>O level being equal to 25–40% of the NO<sub>x</sub> concentration.

The N<sub>2</sub>O measurements from combustion sources referenced above were made by gas chromatographic analysis of gas samples collected in glass or stainless steel containers. Recent measurements have shown that these grab samples can undergo chemical reaction in the containers creating N<sub>2</sub>O concentrations substantially higher than those originally formed in the combustion process.<sup>6,7</sup> This raises questions regarding the existing data base on N<sub>2</sub>O emissions from combustion sources and the role of combustion in contributing to the increases in atmospheric N<sub>2</sub>O concentration.

This paper will address two issues: 1) the formation of N<sub>2</sub>O in sample containers; and 2) N<sub>2</sub>O emissions from combustion systems using an on-line continuous infrared analyzer.

#### Formation of N<sub>2</sub>O in Sample Containers

The artifact in measuring N<sub>2</sub>O with grab sampling techniques was initially identified in the course of combustion experiments in a bench-scale combustor.<sup>6,7</sup> The tests showed that the N<sub>2</sub>O was being formed in the sample containers through a reaction mechanism involving SO<sub>2</sub>, NO, and H<sub>2</sub>O.<sup>6,7</sup> The SO<sub>2</sub> concentration was found to influence the amount of N<sub>2</sub>O formed. To better quantify the progress of the reactions occurring in the sample containers, tests were conducted during this study to determine the time history of N<sub>2</sub>O, NO, NO<sub>2</sub>, and SO<sub>2</sub> in the sample containers. Gas samples from a natural gas fired combustor were collected in 270 liter Tedlar bags and subsequently analyzed for NO, NO<sub>2</sub>, N<sub>2</sub>O and SO<sub>2</sub>. The 270 liter Tedlar bags provided sufficient sample to allow samples to be withdrawn and analyzed as a function of time using continuous gas analyzers. N<sub>2</sub>O was analyzed with an infrared continuous analyzer described in Ref. 8. NO and NO<sub>x</sub> were measured with a TECO chemiluminescent analyzer and SO<sub>2</sub> with a Western Research ultraviolet analyzer.

The primary variable for the series of tests was SO<sub>2</sub> concentration, which was varied from 700 ppm to 2500 ppm. Initial SO<sub>2</sub> and NO<sub>x</sub> concentrations were varied by adding SO<sub>2</sub> to the combustion air and NH<sub>3</sub> to the natural gas. The time histories of N<sub>2</sub>O, NO<sub>x</sub>, and SO<sub>2</sub> are shown in Fig. 1. As can

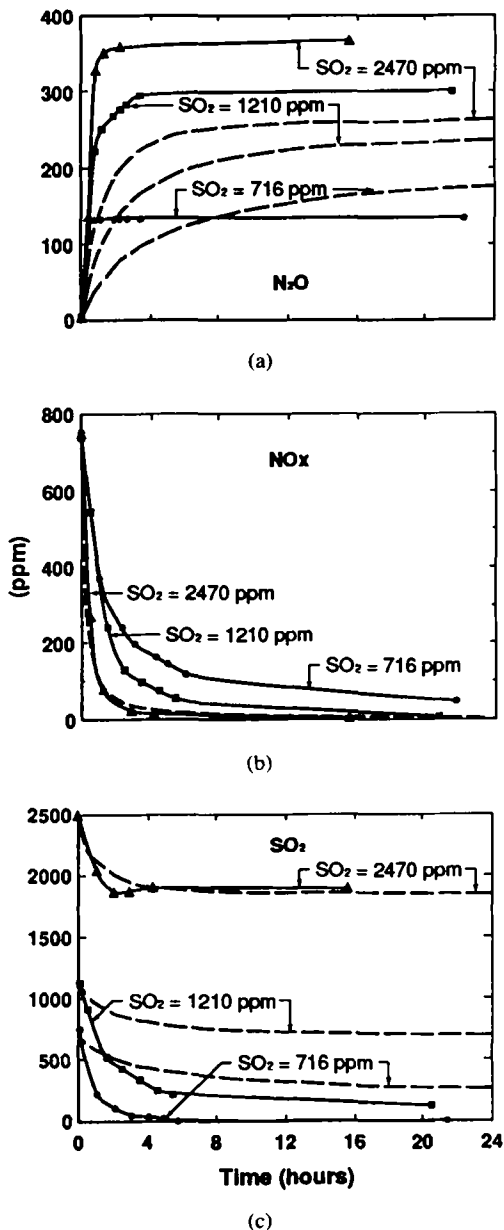


FIG. 1. Time histories of N<sub>2</sub>O, NO<sub>x</sub>, and SO<sub>2</sub> during reaction in 270 liter Tedlar bags: experimental versus model results: a. N<sub>2</sub>O, b. NO<sub>x</sub>, c. SO<sub>2</sub> (— experimental, --- model).

be seen in Fig. 1a, the majority of the N<sub>2</sub>O formation occurs in the first six hours, irrespective of the initial SO<sub>2</sub> level. The accompanying time histories of NO<sub>x</sub> and SO<sub>2</sub> are shown in Figs. 1b and 1c. As seen in Figs. 1a–c, at the high SO<sub>2</sub> condition, virtually all of the NO<sub>x</sub> initially present in the

Tedlar bag is transformed to N<sub>2</sub>O in the final product. At the lowest SO<sub>2</sub> concentration (716 ppm), N<sub>2</sub>O continues to form until virtually all of the SO<sub>2</sub> is removed from the gas phase, after which the N<sub>2</sub>O stabilizes while the NO<sub>x</sub> continues to decrease. At the intermediate SO<sub>2</sub> level (1210 ppm), the N<sub>2</sub>O formation rate is initially rapid becoming more gradual after 2 hours, as the NO<sub>x</sub> and SO<sub>2</sub> are consumed. For this intermediate case, there appears to be sufficient SO<sub>2</sub> to allow the reaction to proceed longer than at the low SO<sub>2</sub> condition, but not sufficient SO<sub>2</sub> to convert all of the initial NO<sub>x</sub> to N<sub>2</sub>O, as was observed at the higher SO<sub>2</sub> level.

The gas phase and aqueous reactions between SO<sub>2</sub>, NO<sub>x</sub>, and H<sub>2</sub>O leading to the formation of N<sub>2</sub>O have been documented in the literature. Martin et al.<sup>9</sup> discuss the reaction mechanism; the general chemistry has also been discussed in the wet FGD scrubbing literature.<sup>10,11</sup> Lyon and Cole<sup>12</sup> proposed a detailed mechanism for N<sub>2</sub>O formation in the sample containers. In the sample flasks, NO is oxidized to NO<sub>2</sub>. NO<sub>2</sub> and SO<sub>2</sub> in the gas phase are taken to be in equilibrium with the aqueous phase. In the aqueous phase, the NO<sub>2</sub> and SO<sub>2</sub> ultimately form N<sub>2</sub>O and H<sub>2</sub>SO<sub>4</sub> through a reaction sequence involving HNO.<sup>12</sup>

The detailed mechanism of Lyon and Cole was integrated for the same conditions as the experiments conducted in the Tedlar bags (Fig. 1). The results of these calculations are included with the experimental results in Figure 1a-c. In general, the model calculations are in qualitative agreement with the experimental results. The characteristic time for N<sub>2</sub>O formation is basically the same between experiment and model, with the experiment exhibiting somewhat faster N<sub>2</sub>O formation than predicted by the model. However, there are noteworthy differences between the experiments and the model calculations. First, for the medium and high SO<sub>2</sub> cases, the kinetics underpredict the amount of N<sub>2</sub>O formed. At the high SO<sub>2</sub> condition, the experiments exhibited virtually 100% conversion of the NO<sub>x</sub> to N<sub>2</sub>O, whereas the model predicts 65% conversion. Second, in the Tedlar bags the rate of disappearance of NO<sub>x</sub> decreased as the SO<sub>2</sub> level decreased, whereas the kinetic calculations indicate little effect of SO<sub>2</sub> level upon the NO<sub>x</sub> time histories. Another difference between the experimental observations and calculations is the effect of the chemical reactions on the pH of the aqueous phase. Experimentally, the pH in sample containers containing 600 ppm NO and 1500 ppm of SO<sub>2</sub> have been reported to be 1.8.<sup>7</sup> However, the calculations indicate an aqueous phase pH of only 4.5-4.8 after 24 hours for initial SO<sub>2</sub> concentrations ranging from 2470 ppm to 100 ppm. This is expected to influence the calculated levels of N<sub>2</sub>O produced since previous work suggests that N<sub>2</sub>O increases as the pH decreases.<sup>10,11</sup>

At present, the model does not include a reaction allowing the direct oxidation of sulfite ion to sulfate ion, although this step is known to occur. By including this reaction in the model, most of the deviations noted in Fig. 1 could be accounted for. For example, the sulfite ion concentration would be depleted, reducing the resistance of the liquid phase to SO<sub>2</sub> dissolution. This would increase the predicted rate of SO<sub>2</sub> decay in the gas phase, improving agreement between model and experiment (Fig. 1). Also, the depleted sulfite ion in the liquid phase would slow the liquid phase conversion of nitrogen, thereby increasing the resistance of NO<sub>2</sub> entering the liquid phase. Finally, the missing reaction would accelerate the conversion of a weak acid into a strong acid, reducing the predicted pH toward the experimentally observed values of 1.7-1.9.

### N<sub>2</sub>O Emissions from Combustion Sources

Reliable measurements of N<sub>2</sub>O emissions from combustion systems are needed in order to assess the role of combustion as an anthropogenic source of atmospheric N<sub>2</sub>O. With grab sampling procedures in question, a continuous N<sub>2</sub>O analyzer, utilizing a non-dispersive infrared principle was used to characterize N<sub>2</sub>O emissions from a variety of utility scale combustion systems. The continuous N<sub>2</sub>O analyzer system is described in detail elsewhere.<sup>8</sup> The basic analyzer is a non-dispersive infrared analyzer manufactured by Horiba Ltd. based on the work by Montgomery, et al.<sup>8</sup> The analyzer utilizes a 500 mm sample cell and uses the 7.8-8.5 micron region of the infrared for the N<sub>2</sub>O measurement. To eliminate interferences, NO<sub>2</sub> and SO<sub>2</sub> are removed from the sample gas using 1 M solutions of sodium sulfite and sodium carbonate.<sup>8</sup>

The continuous N<sub>2</sub>O analyzer was used to characterize the N<sub>2</sub>O emissions from the following systems:

Natural Gas-Fired Utility Boilers	(3 units)
Residual Oil-Fired Utility Boilers	(2 units)
Pulverized Coal-Fired Utility Boilers	(7 units)
Circulating Fluidized Bed Combustors	(3 units)
Boiler with Selective Non-Catalytic	
NO <sub>x</sub> Reduction	(1 unit)

The units firing natural gas, oil, and pulverized coal comprised a variety of designs including single wall-fired, opposed wall-fired and tangentially fired, and ranged in size from 50 to 750 MW (electric). The majority of the testing was performed at full load. For selected sites, the testing was performed over a range of loads. A summary of the results is pre-

sented in Table I. At four of the boilers, on-line gas chromatographic measurements sponsored by the U.S. EPA were made in parallel and showed similar results.<sup>13</sup>

#### Natural Gas Firing:

The N<sub>2</sub>O emission from three natural gas-fired utility boilers ranging in size from 215 to 750 MW were consistent with the previously reported results.<sup>2</sup> The N<sub>2</sub>O emissions from these natural gas-fired utility boilers were low, less than 2 ppm. Also, as seen in Table I, there was no correlation with the NO<sub>x</sub> emissions.

#### Residual Oil Firing:



The N<sub>2</sub>O emissions from the two residual oil-fired utility boilers (110 and 215 MW) were again low, 1 ppm, and exhibited no correlation with the NO<sub>x</sub> emissions.

#### Pulverized Coal Firing:

Seven pulverized coal-fired boilers were tested ranging in size from 180 MW to 790 MW. As can be seen in Table I, except for the 620 MW opposed wall-fired boiler, the N<sub>2</sub>O emissions were less than 6 ppm. The 12 ppm N<sub>2</sub>O concentration measured from the 620 MW opposed-fired unit may represent an upper limit on the emissions from this unit. Because of the high SO<sub>2</sub> levels and NO<sub>x</sub> levels in this flue gas, a small amount of N<sub>2</sub>O may have formed in the unheated sample lines during transport to the analyzer.

#### Circulating Fluidized Bed Combustion:

N<sub>2</sub>O emissions were also characterized at three circulating fluidized bed combustors. Compared to pulverized coal-fired boilers, the circulating bed units exhibit elevated levels of N<sub>2</sub>O emissions. At full load operation of these units, N<sub>2</sub>O levels ranged from 84 to 26 ppm (dry at 3% O<sub>2</sub>).<sup>14</sup> The corresponding NO<sub>x</sub> levels varied from 81 to 283 ppm (dry at 3% O<sub>2</sub>).<sup>13</sup> At one of the units, tests were conducted over a range of operating loads, from 55 to 100% of rated load. A summary of this unit's emissions are presented in Table II. The N<sub>2</sub>O and NO<sub>x</sub> levels are plotted as a function of load in Figure 2a. For this unit, the N<sub>2</sub>O levels decrease and NO<sub>x</sub> increases as the load increases. Further, for this unit the N<sub>2</sub>O and NO<sub>x</sub> emissions appear to correlate with bed temperature (see Fig. 2b). The N<sub>2</sub>O levels decrease and NO<sub>x</sub> increases as the bed temperature increases. The trends in N<sub>2</sub>O concentrations with bed temperature are consistent with the results obtained from pilot-scale fluidized bed combustors reported by Amand and Anderson<sup>15</sup> and the mechanism suggested by Kramlich et al.<sup>16</sup> Kramlich et al.<sup>16</sup> suggest that N<sub>2</sub>O formation can occur from HCN through a mechanism of the form



Peak conversion of HCN to N<sub>2</sub>O via the above

TABLE I  
N<sub>2</sub>O emissions from full-scale utility combustion systems

Design Type	Fuel	Load (%)	NO <sub>x</sub> * (ppm)	N <sub>2</sub> O* (ppm)
Single Wall-Fired Boiler	Nat. Gas	98	120	2
Opposed-Fired Boiler	Nat. Gas	97	142	2
T-Fired Boiler	Nat. Gas	100	58	1
Single Wall-Fired Boiler	Resid. Oil	100	268	1
Single Wall-Fired Boiler	Resid. Oil	91	291	2
Opposed-Fired Boiler	Pulv. Coal	97	982	12
Opposed-Fired Boiler	Pulv. Coal	97	701	3
Opposed-Fired Boiler, Triple Cell	Pulv. Coal	98	692	6
T-Fired Boiler	Pulv. Coal	95	325	1
T-Fired Boiler	Pulv. Coal	82	390	1
T-Fired Boiler	Pulv. Coal	69	393	1
T-Fired Boiler	Pulv. Coal	51	498	1
Circulating Fluidized Bed	Crushed Coal	100	81	84

\*Corrected to 3% O<sub>2</sub>.

TABLE II  
Emissions from the circulating fluidized bed combustor

Load % of Rated	T <sub>bed</sub> °K	O <sub>2</sub> % dry	CO <sub>2</sub> % dry	CO ppm dry	SO <sub>2</sub> ppm corrected to 3% O <sub>2</sub> dry	NO	N <sub>2</sub> O
55	1116	5.0	14.6	127	86	55	126
75	1141	3.9	15.6	76	79	61	93
100	1146	3.6	16.0	86	81	81	84

mechanism occurs at a temperature of about 1250 K. Below 1250 K, N<sub>2</sub>O concentrations are controlled by the formation of NCO and the conversion of NCO to N<sub>2</sub>O. Above 1250 K, removal of N<sub>2</sub>O through reactions with H and OH control the level of N<sub>2</sub>O. At the circulating fluidized bed tested over a range of loads, bed temperatures ranged between 1116 and 1140 K, suggesting that the N<sub>2</sub>O levels from this unit are controlled by formation processes rather than destruction reactions.

Further investigations are needed to assess what other operational variables yield higher or lower N<sub>2</sub>O levels in CFBC's. While N<sub>2</sub>O levels correlated with bed temperature for the unit where tests were conducted over a range of loads, all three of the units tested operated at similar bed temperatures at full load. Yet, the N<sub>2</sub>O levels varied from 26 to 84 ppm. Other parameters that might influence the level besides temperature include the fuel type (char N evolution), char and/or solids loading, residence time, calcium species, sulfur species, and NO<sub>x</sub> level. Certainly the field data suggest there are operational conditions that minimize N<sub>2</sub>O in CFBC's, offering possible keys to its control. Once the primary N<sub>2</sub>O formation mechanisms are understood, potential control mechanisms can be developed.

### Selective Non-Catalytic NO<sub>x</sub> Reduction: Urea Injection

A number of selective non-catalytic NO<sub>x</sub> reduction processes (SNCR) are currently under development for utilization in industry. These include injection of ammonia (NH<sub>3</sub>), urea (NH<sub>2</sub>CONH<sub>2</sub>), or cyanuric acid ([HNCO]<sub>3</sub>) at temperatures nominally between 1200 and 1500 K where the decomposition products react with NO<sub>x</sub>. Caton and Siebers<sup>17</sup> reported bench-scale results showing N<sub>2</sub>O as a product of the reaction between cyanuric acid and NO<sub>x</sub>, presumably via reactions 3 and 4. Further, they suggested that urea injected into high temperature combustion products would decompose to NH<sub>3</sub> and HNCO.

N<sub>2</sub>O measurements were also made at a unit using urea injection to reduce NO<sub>x</sub>. The boiler is rated at 110 MW and was firing residual oil. A summary of the full load data is presented in Table III. The urea/NO<sub>x</sub> molar injection ratio was varied between 0.0 (baseline) and 0.6. Without urea injection, the baseline NO<sub>x</sub> and N<sub>2</sub>O emissions were 291 and 1 ppm, respectively. As the amount of urea injection increased, the NO<sub>x</sub> level decreased, and the N<sub>2</sub>O level increased. Over the range of urea injection rates tested (urea/NO<sub>x</sub> molar ratio of 0.2 to 0.6), between 11 and 13% of the NO<sub>x</sub> removed was converted to N<sub>2</sub>O. Further work is needed to 1) verify these first measurements, 2) thoroughly characterize N<sub>2</sub>O formation from SNCR processes, and 3) develop a better understanding of the basic N<sub>2</sub>O formation chemistry.

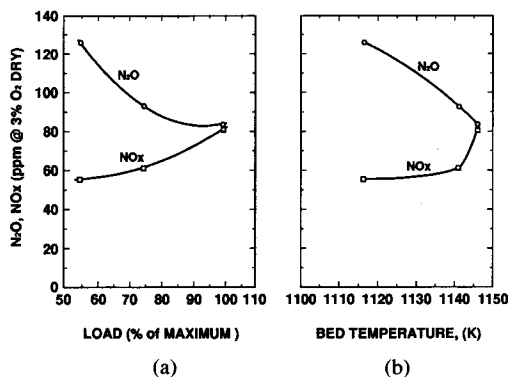


FIG. 2. N<sub>2</sub>O and NO<sub>x</sub> emissions versus load from a circulating fluidized bed combustor. (a. as a function of load; b. as a function of bed temperature).

TABLE III  
N<sub>2</sub>O and NO<sub>x</sub> emissions: oil-fired boiler with urea injection

Urea/NO <sub>x</sub> (molar ratio)	NO <sub>x</sub> (ppm)	N <sub>2</sub> O (ppm)	ΔNO <sub>x</sub> (%)	ΔN <sub>2</sub> O ΔNO <sub>x</sub>
0.0	291	1	—	—
0.2	206	10	29%	11%
0.4	161	16	45%	12%
0.6	117	23	60%	13%

### Conclusions

The following conclusions can be drawn from the results discussed above:

- N<sub>2</sub>O measurements using grab sampling techniques are subject to errors due to reactions between NO, SO<sub>2</sub>, and H<sub>2</sub>O forming N<sub>2</sub>O in the sample containers. The N<sub>2</sub>O formation occurs over a time period of 2–6 hours and depends on the amount of SO<sub>2</sub> initially present.
- Measurements using the continuous analyzer at a variety of conventional utility boilers (natural gas, residual oil, and pulverized coal-fired) indicate that direct N<sub>2</sub>O emissions are low (generally, less than 6 ppm), and that the N<sub>2</sub>O levels are not a substantial fraction of the NO<sub>x</sub> levels as previously suggested.
- Tests of circulating fluidized bed combustors yielded N<sub>2</sub>O levels ranging from 26 to 84 ppm. The N<sub>2</sub>O levels appear to be inversely related to the fluidized bed temperature.
- N<sub>2</sub>O measurements at a full-scale boiler using urea injection for NO<sub>x</sub> reduction show that 11–13% of the reduced NO<sub>x</sub> is converted to N<sub>2</sub>O.
- Further work is needed to determine if the chemistry occurring in the sample containers plays a role in increasing atmospheric N<sub>2</sub>O concentrations; e.g., if NO<sub>x</sub>, SO<sub>2</sub>, and H<sub>2</sub>O react in the atmosphere to form N<sub>2</sub>O.

### Acknowledgments

We are pleased to acknowledge the support of the Electric Power Research Institute at Fossil Energy Research Corp. (Contract No. RP2533-9), and at the University of California, Irvine (Contract No. RP8005-4) in the development of the continuous N<sub>2</sub>O analyzer. The field measurements made with the continuous analyzer were supported by the Electric Power Research Institute and Southern California Edison (Contract No. RP2154-16). Additionally, we are pleased to acknowledge the support of the U.S. Department of Energy's Direct Utilization Advanced Research and Technology Development Program at Energy and Environmental Research (Contract No. DE-AC22-84PC70771) in the chemical kinetic modeling of N<sub>2</sub>O formation in sample containers. We would like to acknowledge and thank HORIBA, Ltd. for their cooperation and support in the development of the field prototype N<sub>2</sub>O analyzer. The continued encouragement and discussions with G. Offen (EPRI) and Kert Kertamus (SCE) are also acknowledged. K. Anderson, M. Teague, G. Shimoto, J. A. Cole, T. Grogan, J. M. Mc-

Carthy, T. McGrath, and J. McInerney helped in the performance of the experimental tasks and modeling.

### REFERENCES

1. TIRPAK, D. A.: Symposium on Stationary Combustion Nitrogen Oxide Control, V. 1, EPRI CS-5361, EPA Contract 68-02-3994, WA93, 1987.
2. WEISS, R. F.: *J. Geophys. Res. Lett.*, 86 (C8), 7285 (1981).
3. KRAMLICH, J. C., LYON, R. K., AND LANIER, W. S.: EPA/NOAA/NASA/USDA N<sub>2</sub>O Workshop, Volume I: Measurement Studies and Combustion Sources, EPA-600/8-88-079, 1988.
4. HAO, W. M., WOFSY, S. C., McELROY, M. W., BEER, J. M., AND TOQUAN, M. A.: *J. Geophys. Res.*, 15, 1369 (1987).
5. CASTALDINI, C., et al.: 1982 Joint Symposium on Stationary Combustion NO<sub>x</sub> Control, V. II, 46.1-46.24, EPA-600/9-85-0266, U.S. Environmental Protection Agency, 1983.
6. MUZIO, L. J. AND KRAMLICH, J. C.: *Geophys. Res. Lett.*, 15, 1369 (1988).
7. MUZIO, L. J. et al.: *JAPCA*, 39, 287 (1989).
8. MONTGOMERY, T. A., MUZIO, L. J., AND SAMUELSEN, G. S.: *JAPCA*, 39, 721 (1989).
9. MARTIN, L. R. et al.: *Atmos. Environ.*, 15, 191 (1981).
10. CHANG, A. G. et al.: in *Flue Gas Desulfurization*, (J. L. Hudson and G. T. Rochelle, Eds.) ACS Symposium Series 188, p. 127, American Chemical Society, Washington, D.C., 1982.
11. NARITA, E. et al.: *Ind. Eng. Chem. Prod. Res. Dev.*, 23, 262 (1984).
12. LYON, R. K. AND COLE, J. A.: *Comb. Flame*, 77, 139, 1988.
13. CLAYTON, R. et al.: N<sub>2</sub>O Field Study, EPA-600/2-89-006, U.S. Environmental Protection Agency, 1989.
14. MONTGOMERY, T. A., et al.: N<sub>2</sub>O Emissions from Full Scale Combustion Systems, to be submitted to *JAPCA*, 1990.
15. AMAND, L. E., AND ANDERSON, S.: Emissions of Nitrous Oxide (N<sub>2</sub>O) from Fluidized Bed Boilers, presented at the Tenth International Conference on Fluidized Bed Combustion, San Francisco, California, 1989.
16. KRAMLICH, J. C., COLE, J. A., MCCARTHY, J. M., LANIER, W. S., AND MCSORLEY, J. A.: *Comb. Flame*, 77, 375 (1989).
17. SIEBERS, D. C., AND CATON, J. A.: *Comb. Sci. Tech.*, 65, 277 (1989).