

Lawrence Berkeley National Laboratory

Recent Work

Title

Influence of Glazing Selection on Commercial Building Energy Performance in Hot and Humid Climates

Permalink

<https://escholarship.org/uc/item/1rp3x1zn>

Authors

Sullivan, R.
Arasteh, D.
Sweitzer, G.
et al.

Publication Date

1987-07-01

UC 952
LBL-23287

c.1



Lawrence Berkeley Laboratory

UNIVERSITY OF CALIFORNIA

APPLIED SCIENCE DIVISION

RECEIVED
LAWRENCE
BERKELEY LABORATORY

FEB 19 1988

LIBRARY AND
DOCUMENTS SECTION

Presented at the ASHRAE Conference on Air Conditioning
in Hot Climates, Singapore, September 3-5, 1987


The Influence of Glazing Selection on Commercial Building Energy Performance in Hot and Humid Climates

R. Sullivan, D. Arasteh, G. Sweitzer, R. Johnson,
and S. Selkowitz

July 1987

For Reference

Not to be taken from this room

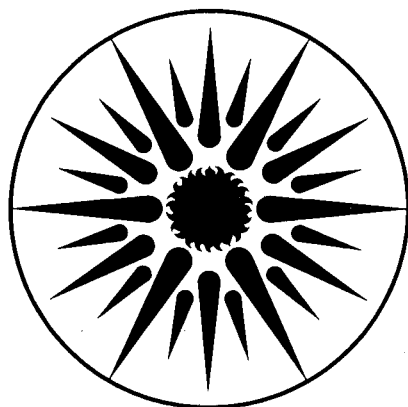

**APPLIED SCIENCE
DIVISION**

LBL-23287
c.1

DISCLAIMER

This document was prepared as an account of work sponsored by the United States Government. While this document is believed to contain correct information, neither the United States Government nor any agency thereof, nor the Regents of the University of California, nor any of their employees, makes any warranty, express or implied, or assumes any legal responsibility for the accuracy, completeness, or usefulness of any information, apparatus, product, or process disclosed, or represents that its use would not infringe privately owned rights. Reference herein to any specific commercial product, process, or service by its trade name, trademark, manufacturer, or otherwise, does not necessarily constitute or imply its endorsement, recommendation, or favoring by the United States Government or any agency thereof, or the Regents of the University of California. The views and opinions of authors expressed herein do not necessarily state or reflect those of the United States Government or any agency thereof or the Regents of the University of California.

LBL-23287
BS-247

To be presented at the ASHRAE Conference on Air Conditioning in Hot Climates,
September 3-5, 1987, in Singapore.

**THE INFLUENCE OF GLAZING SELECTION ON COMMERCIAL
BUILDING ENERGY PERFORMANCE
IN HOT AND HUMID CLIMATES**

R. Sullivan, D. Arasteh, G. Sweitzer, R. Johnson, and S. Selkowitz

Windows and Lighting Program
Center for Building Science
Applied Science Division
Lawrence Berkeley Laboratory
University of California
Berkeley, CA 94720

July 1987

This work was supported by the Assistant Secretary for Conservation and Renewable Energy, Office of Buildings and Community Systems, Building Systems Division of the U.S. Department of Energy under Contract No. DE-AC03-76SF00098.

THE INFLUENCE OF GLAZING SELECTION ON COMMERCIAL BUILDING ENERGY PERFORMANCE IN HOT AND HUMID CLIMATES

R. Sullivan, D. Arasteh, G. Sweitzer, R. Johnson, and S. Selkowitz

Windows and Lighting Program
Center for Building Science
Applied Science Division
Lawrence Berkeley Laboratory
University of California
Berkeley CA 94720

July 1987

ABSTRACT

This paper presents a comparative study in which commercial building perimeter zone electric energy (cooling, lighting, fan) and peak electric demand are analyzed as a function of window glazing type, with a particular emphasis on the use of glazings with wavelength-selective solar-optical properties. The DOE-2.1C energy analysis simulation program was used to generate a data base of the electric energy requirements of a prototypical office building module located in Singapore. Algebraic expressions derived by multiple regression techniques permitted a direct comparison of those parameters that characterize window performance in hot and humid climates: orientation, size, and solar-optical properties. Also investigated were the effects of exterior and interior shading devices, as well as interior illuminance level, power density, and lighting controls to permit the use of daylighting. These regression equations were used to compare the energy implications of conventional window designs and newer designs in which the type of coating and substrate were varied. The analysis shows the potential for substantial savings through combined solar load control and lighting energy use reduction with daylighting.

INTRODUCTION

The impact of nonresidential building design on energy conservation in hot and humid climates was the major topic at the ASEAN Conference on Energy Conservation in Buildings (USAID 1984), Singapore. Window and daylighting technologies were widely discussed because fenestration has proven to be the most significant envelope design factor affecting energy use in nonresidential buildings. In Singapore, and other hot and humid locations, exterior shading and window size have been successfully used to limit solar heat gain. Lately, architects and engineers have been designing buildings with large areas of glass and without exterior shading. Tinted glazing is being specified to reduce solar loads and comply with energy codes.


The benefits of using daylighted perimeter zones in office buildings were also discussed at the ASEAN conference. A large fraction of electric lighting can be saved by dimming or switching electric lights in response to available daylight. The degree to which daylighting can reduce lighting loads depends primarily on the size and visible transmittance of the window. Other studies (Arasteh 1985; Johnson 1986; and Sweitzer 1987) have demonstrated the total energy-related benefits of daylighting building perimeter zones.

While daylighting energy savings from windows are a function of window area and visible transmittance, cooling loads from windows are a function of area and shading coefficient. Previous studies, referenced above, have explored the critical relationship between solar transmittance and daylighting benefits if energy performance is to be optimized. From an energy viewpoint, the ideal glazing would have a high visible transmittance, τ_v , and a low shading coefficient, SC. We define a glazing luminous efficacy constant, k_e , the ratio of τ_v to SC, as a relative indicator of glazing performance in this regard. Conventional blue and green glazings have higher k_e s than other tinted, reflective, or clear glazings since they transmit comparatively higher fractions of visible solar radiation than solar infrared radiation. Low-E coated glazings, introduced in recent years to reduce glazing conductances and suppress heat losses, also have the property of admitting a higher proportion of visible light relative to the total solar transmittance, thus making them attractive candidates for application in cooling dominated climates.

The energy implications of using glazings with different areas, SCs, $\tau_{v,s}$, and k_e s are a function of climate, orientation, and building operating characteristics. In this paper, we discuss these effects in the context of the Singapore climate. We compare the performance of seven different glazing types and demonstrate the viability of new glazing technologies to reduce electric energy consumption and peak electrical demand in a hot and humid climate.

METHODOLOGY

The procedure used in the study involved the use of multiple regression equations that defined the electric energy and peak electric demand of a prototypical single-story office building module. These equations were derived from a large number of DOE-2.1C (1984) hour-by-hour simulations that were completed for a variety of configurations using 1979 weather data for Singapore (1.3°N latitude). The module shown in Figure 1 has four perimeter zones consisting of ten offices, each 4.57 m (15 ft) deep by 3.05 m (10 ft) wide, surrounding a central core zone of 929 m² (10,000 ft²) floor area. Floor-to-ceiling height was 2.6 m (8.5 ft) with a plenum of 1.07 m (3.5 ft) height. Work presented at the ASEAN conference (USAID 1984) also used this module in tabulating daylighting characteristics. A paper by Johnson (1983) contains more detailed information on the model.

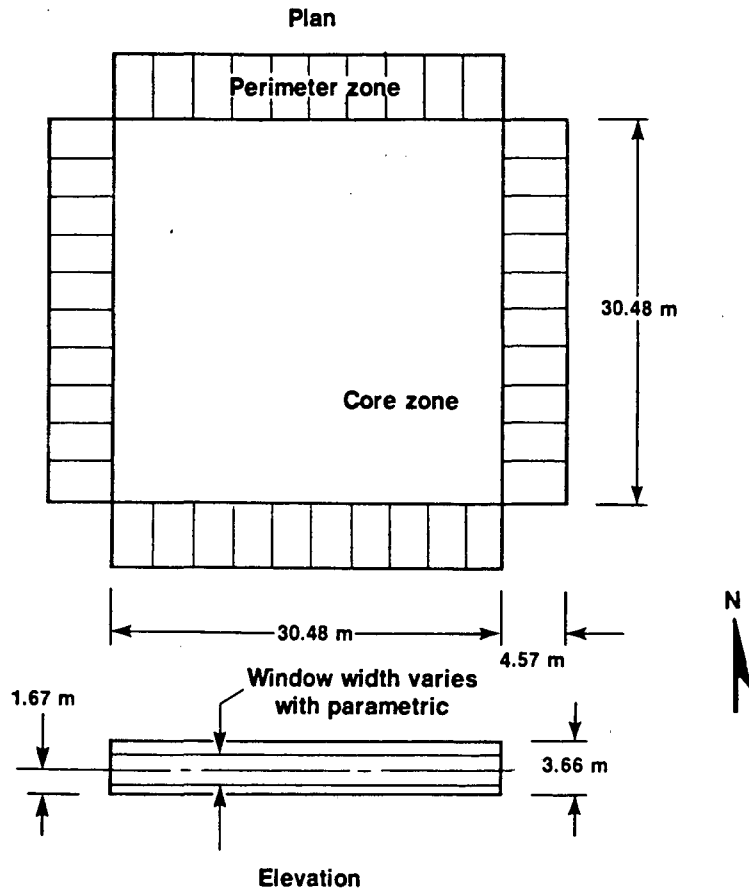

XBL 838-2960

Figure 1. Plan of simulated office building showing alternative window-to-wall ratios. Module consists of a 929-m² core surrounded by 4.57-m-deep perimeter zones, each divided into 10 modules 3.05 m wide.

Continuous-strip windows were used in the exterior wall of each perimeter zone. Thermal transfers were selectively constrained in order to isolate the energy effects of interest, i.e., the floor and ceiling as well as the walls at each end of the perimeter zones were modeled as adiabatic (i.e., no heat transfer) surfaces. The envelope effects can thus be considered analogous to those in an individual office in a series of contiguous offices. Normal building thermal interactions included heat capacity effects and small convective/conductive transfers between core and perimeter.

A data base of electric energy usage and peak electric demand was generated for changing window and lighting system properties. System extraction rates were calculated for each perimeter zone, and since DOE-2.1C cannot isolate zonal energy from building totals at the plant level, a COP of 3.0 was assumed to calculate the cooling energy from the extraction rates. The glazing characteristics that were varied included solar optical and thermal conductance properties and area. Lighting characteristics investigated included the use of daylighting with continuous dimming controls for varying lighting power densities and lighting levels.

External shading was also simulated with continuous, fixed, horizontally projecting, opaque overhangs. Overhang projection width was varied parametrically to a maximum ratio of projection width to window height of 0.6. Interior shading was simulated using shading coefficient and visible transmittance multipliers of 0.6 and 0.35, respectively. These conventional shades were deployed automatically when transmitted direct solar radiation exceeded 63 W/m^2 (20 W/ft^2). Exterior and interior shading were not simulated simultaneously.

A regression analysis was performed on the DOE-2.1C-generated data base, deriving simplified algebraic expressions that accurately reproduced the simulated electric energy and peak demand. Multiple regression is an analytical technique for determining the best mathematical fit for a dependent variable as a function of many independent variables. The resultant regression expression used to predict these quantities was of the form:

$$\Delta E = \beta_1 U_g \cdot A_g + \beta_2 k_o \cdot SC_g \cdot A_g + \beta_3 k_d \cdot L \cdot A_f \quad (1)$$

where ΔE is the incremental effect due to the fenestration system. The regression coefficients are denoted by β and the equation has three components chosen to contain the energy effects from a particular building thermal component: conduction ($U_g A_g$), solar radiation ($k_o SC_g A_g$), and lighting ($k_d L A_f$), where U_g is the overall conductance of the glazing, SC_g is the shading coefficient, k_o is a solar correction factor due to overhangs, L is the lighting installed power density, and k_d is a lighting correction term due to daylighting. A_g and A_f are glass and floor areas respectively. Shade management effects are accounted for by revised solar radiation coefficients, β_2 .

The regression coefficients are presented in Table 1 for each orientation along with the multiple r^2 values to indicate the goodness of fit of the expression to the data (an r^2 value of 1.0 represents a perfect fit). The configuration parameters are expressed in SI units, i.e., U_g ($\text{W/m}^2 \cdot ^\circ\text{C}$), A_g (m^2), L (W/m^2), A_f (m^2). An analysis of the regression terms shows that they are reasonably physically consistent with expected performance. For example, the β_3 coefficient is almost constant for all orientations since lighting energy is not affected by external conditions. Also, glazing conductance variations are quite small and can be safely ignored because of the

TABLE 1
 Regression Coefficients: Annual electricity usage (kWh) and peak electric demand (SI units)

		Electricity		Peak Demand	
		w/o SM	w/ SM	w/o SM	w/ SM
β_1	N	2.387		3.733	
	S	3.104		4.494	
	E	-2.069		.439	
	W	-5.411		.409	
β_2	N	306.114		132.180	
	S	319.910		141.214	
	E	514.862	360.403	237.690	144.991
	W	662.550	447.036	324.350	252.993
β_3	N	3.948		1.258	
	S	3.975		1.278	
	E	3.953		1.270	
	W	3.997		1.163	
r^2		.994		.994	

Note: SM = Shade Management

much larger contributions from solar gain and lighting. β_2 coefficients for shade management are presented for east and western orientations, only. The shades were not implemented very often in north and south because diffuse radiation accounts for a large fraction of available sunlight in Singapore.

Tables 2 and 3 show the regression coefficients for the solar and lighting correction terms, k_o and k_d . The solar factor from overhangs was a function of the ratio of overhang projection width to window height (R). Two forms are used to show the effects of overhangs: an exponential to predict electric energy usage for all orientations and both exponential (north and south) and linear (west and east) forms for peak demand predictions.

$$k_o = 1.0 - \delta_1[1 - e^{\delta_2 R}] \text{ or } k_o = 1.0 - \delta_1 R \quad (2)$$

where δ denotes the regression coefficients.

The lighting correction factor due to daylighting was also exponential and a function of desired lighting level (C) in lux, and effective aperture (A_e), which is the product of window-to-wall ratio and visible transmittance, i.e.:

$$k_d = 1.0 - [\phi_1 + \phi_2(C)][1 - e^{(\phi_3 + \phi_4 C)}] \quad (3)$$

where ϕ denotes the regression coefficients, which are shown for four orientations in Table 3. North and south are so similar that they can be considered the same.

It was not possible to perform a regression on the DOE-2.1C simulation results that used shade management because only a limited set of runs was completed; however, changes that occur in the lighting correction factor when shade management is employed are discussed below.

DISCUSSION

The above equations were used to predict the performance of the seven window glazing products shown in Table 4. Clear, tinted, and low-E single and double glazings were investigated. These products are currently commercially available and represent windows used in hot and humid locations and also systems that offer improvements in performance. The improvement is associated with changing proportions of total solar to visible transmittance, since these dominate the thermal variations due to window conductance differences.

Values for glazing luminous efficacy, k_e , range from 1.34 for low-E green-tinted double glazing with shading coefficient of 0.35 and visible transmittance of 0.47, to 0.69, for gray-tinted double pane with SC of 0.55 and τ_v of 0.38. Clear glazings with and without a low-E coating have the highest SCs and τ_v s and are most suitable for use with small window areas. Although green- and gray-tinted double glazings have similar SCs, their τ_v s differ greatly. Other tinted glazings, e.g., bronze, have τ_v s that are between green and gray. Adding a low-E coating decreases the shading coefficient more than the visible transmittance; thus green low-E double glazing is presented as a low-SC option with the highest τ_v . Although the low-emittance glazings are normally used in locations that require heating, this study indicates that they perform well in

TABLE 2

Regression Coefficients: Overhang Solar Correction Factor

		Electricity (Exponential)	Peak Demand (Exponential)	Peak Demand (Linear)
δ_1	N	.507	.725	-
	S	.534	.576	-
	E	.842	-	-.608
	W	.550	-	-.467
δ_2	N	-2.083	-1.271	-
	S	-1.708	-2.029	-
	E	-.893	-	-
	W	-1.396	-	-
r^2		.992	.991	.998

Note: east and west peak demand curves are linear.

TABLE 3

Regression Coefficients: Daylighting Lighting Correction Factor (SI Units)

ϕ_1	N	.754
	S	.753
	E	.758
	W	.756
ϕ_2	N	-.0000381
	S	-.0000429
	E	-.0000598
	W	-.0000710
ϕ_3	N	-16.325
	S	-16.720
	E	-21.728
	W	-20.003
ϕ_4	N	.0149
	S	.0152
	E	.0198
	W	.0179
r^2		.978

TABLE 4

Window System U-values and Shading Coefficients Analyzed

Window Type	Summer U-Value	Shading Coefficient (SC)	Visible Transmittance (τ_v)	Efficacy $k_e = \tau_v / SC$
(1) G	6.11 (1.07)	.95	.88	.93
(2) G _g	6.45 (1.13)	.72	.75	1.04
(3) G-G	3.31 (.58)	.82	.78	.95
(4) G _g -G	3.37 (.59)	.58	.66	1.14
(5) G _y -G	3.37 (.59)	.55	.38	.69
(6) GE-G	1.94 (.34)	.67	.74	1.10
(7) G _g E-G	1.83 (.32)	.35	.47	1.34

Notes:

1. U-value units are W/m^2C (Btu/hr-ft²F).
2. G denotes glazing layer; G_g tinted green; G_y tinted grey; E, a sputtered low-E coating ($e=.1$ for clear, .07 for green).
3. Glass thickness is 6 mm (0.25 in); gap width between layers is 12.7 mm (0.5 in).

locations such as Singapore, particularly if combined with a spectrally selective glazing such as green glass.

Figure 2 shows the variation of the solar correction factor from overhangs for electric usage and peak demand as a function of the ratio (R) of projection width to window height. Generally, asymptotes are approached as the ratio increases; however, the peak demand curves for the east and west are more linear than exponential. This is because for these orientations, the peak occurs when the sun is low in the sky. The k_o values at $R = 0.6$, the maximum ratio used in our work, represent decreases of 30%-35% for annual electricity and 27%-40% in peak demand, depending on window orientation.

Figure 3 presents the lighting correction factor from daylighting for four orientations and three lighting levels (323, 538, and 753 lux [30, 50, 70 footcandles]) as a function of effective aperture. Annual lighting energy savings with daylighting drop linearly until the space begins to become saturated with daylight; savings then asymptotically approach the maximum of 69%-74%. Daylighting savings are greatest when the desired interior illuminance is lowest. For small effective apertures, there is approximately a 10%-15% variation due to orientation, with east giving the largest reduction of lighting energy and north/south the smallest. However, the orientation effect is small and becomes insignificant as the asymptote is approached.

We found that there was a very small change in daylight availability when using overhangs. This is probably due to the large fraction of diffuse solar radiation in Singapore. Figure 4 shows the change in k_d at a lighting level of 538 lux (50 footcandles) when shade management is employed. Throughout most of the effective aperture range, daylight was reduced by 20%-25% for eastern and western orientations and less than 10% for north and south.

Solar- and lighting-induced electric energy consumption and peak demand are presented in Figures 5 and 6 as a function of the product of shading coefficient and window area. These figures represent the form expressed by Equation 1 with the exception that glazing conductance, a very minimal effect, is ignored. The incremental increase from solar gain and the decrease in lighting from daylighting are shown. Results are for four orientations, at a relatively efficient lighting power density of 18.3 W/m^2 (1.7 W/ft^2), a lighting level of 538 lux (50 footcandles), with and without the largest overhang. Also annotated are the relative positions of the seven glazings for a window area of 50 m^2 (538 ft^2).

These curves demonstrate the importance of orientation. North and south receive very little direct-beam solar radiation and therefore yield the lowest solar gain increments. A western orientation requires twice as much electricity and demand as north and south, with east being between the two. Overhangs with $R = 0.6$ provide about 30%-35% reduction in solar gain on each orientation, and because the gain is greatest on the west, the absolute benefit of an overhang is greatest on the west. This is particularly important since overhangs can provide substantial benefits without significantly diminishing daylighting potential. On a western orientation, in particular, the daylighting benefit can be overwhelmed by solar gains. Thus, minimal effective apertures with overhangs are necessary to mitigate the substantial solar load.

Glazing type can also have a substantial impact on solar load reduction but may do so at the expense of daylighting. Table 5 shows the percent reduction in solar-gain-induced electric usage for each glazing when using single pane clear as a base. The solar values given can be used for both usage and demand and for all orientations, with and without overhangs, since the percent change in energy or demand shown along the vertical axis in Figures 5 and 6 is equivalent to the percent change in shading coefficient because of the linearity associated with Equation 1. The

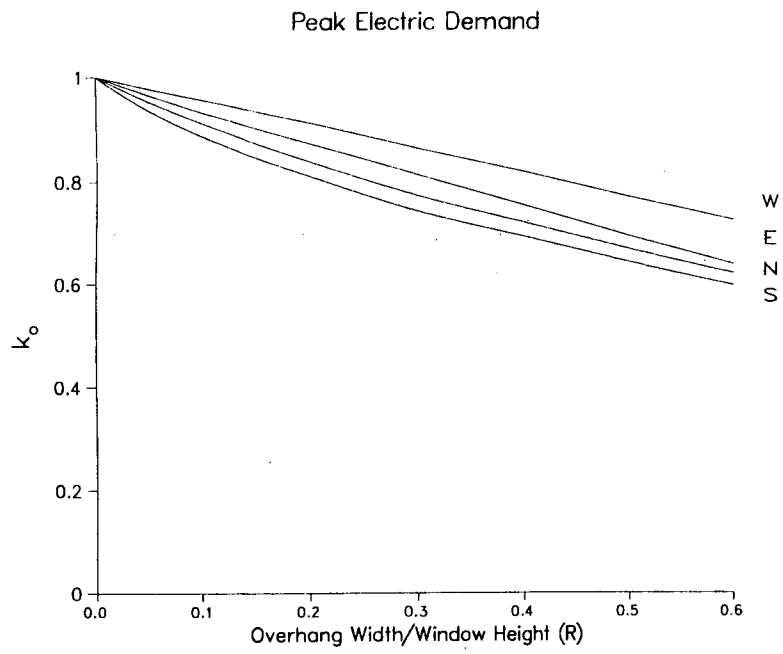
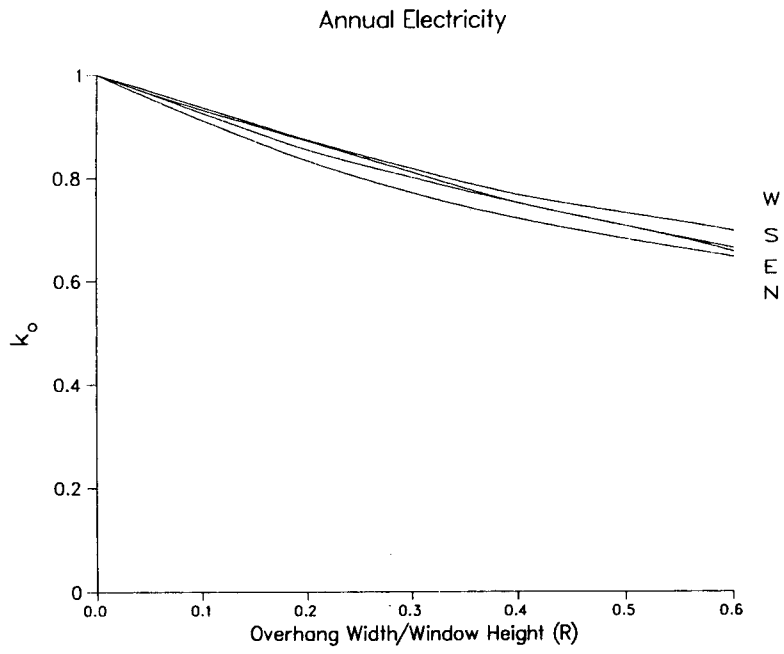


Figure 2. Solar correction factor for overhangs for perimeter zone annual electricity consumption and peak demand. The nondimensional factor for each orientation is the ratio of overhang width to window height .

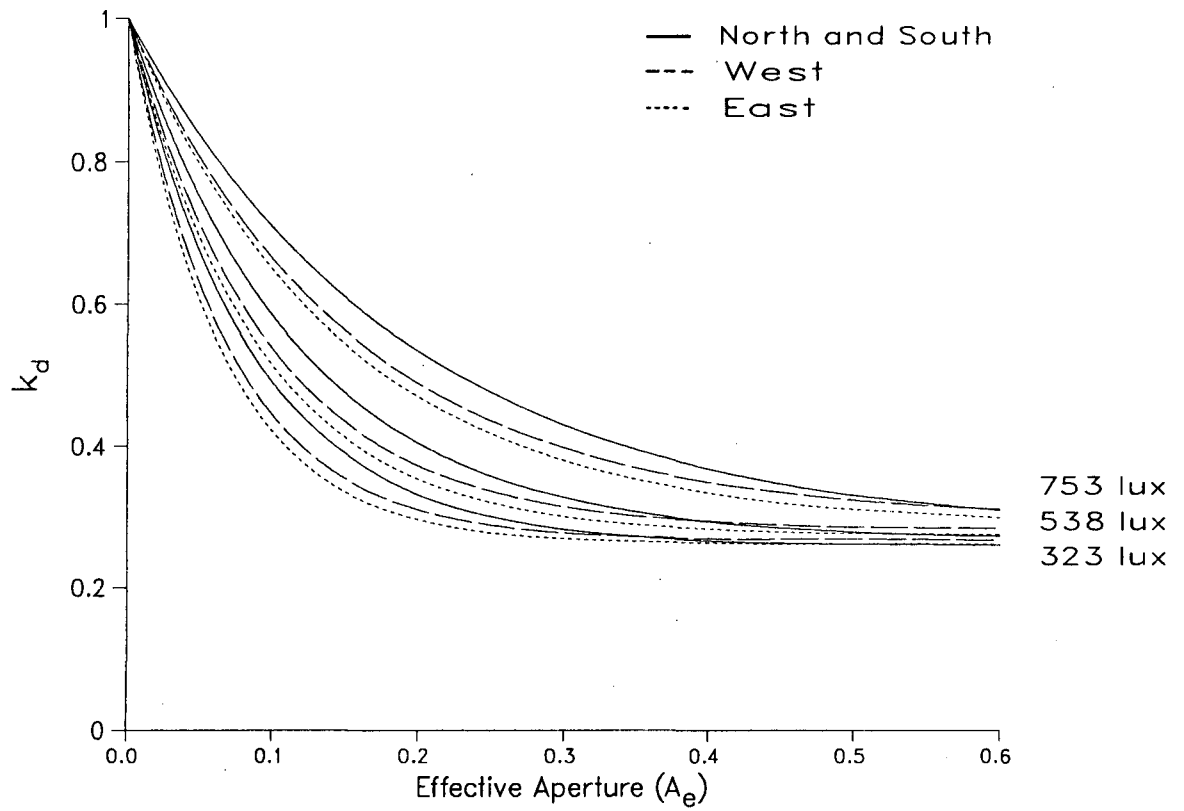


Figure 3. The daylighting correction factor, a nondimensional value, is a function of effective aperture at lighting levels of 753, 538, and 323 lux.

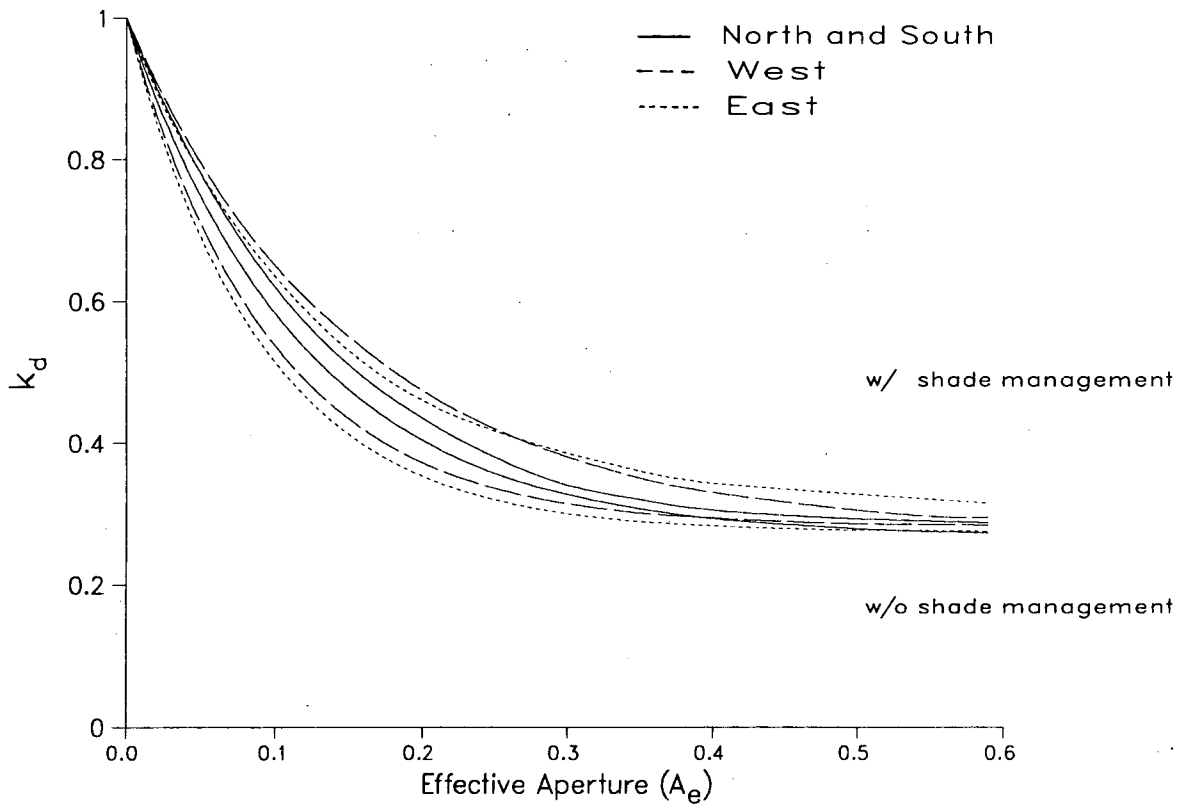


Figure 4. This plot shows the effect of shade management on the daylighting correction factor, a non-dimensional value, and a function of effective aperture at a lighting level of 538 lux.

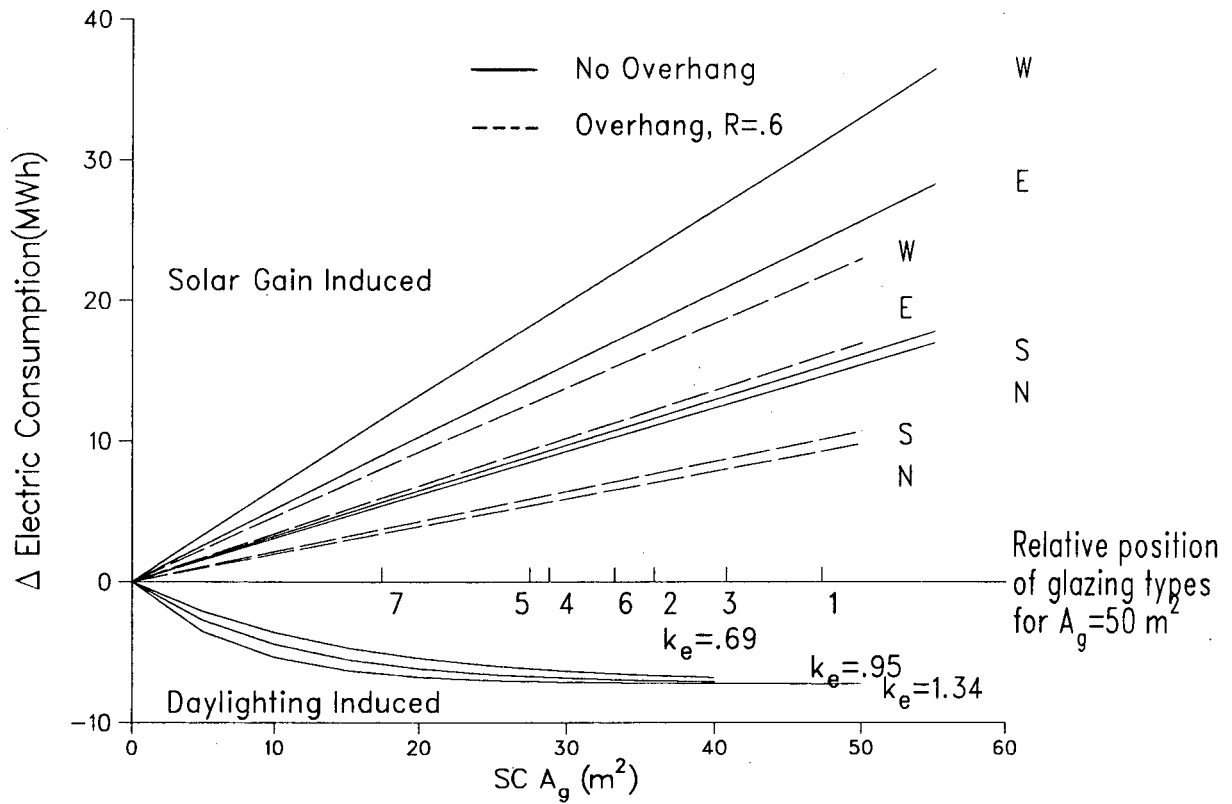


Figure 5. Incremental solar-gain and daylighting-induced electric energy usage for four orientations of a commercial building as a function of the product of shading coefficient and window area. The lighting power density is 18.3 W/m² and the interior lighting level is 538 lux. The seven glazing types (from Table 1) are plotted at an area of 50 m² for comparison. For east and west orientations, the data for overhangs are about the same as for shade management.

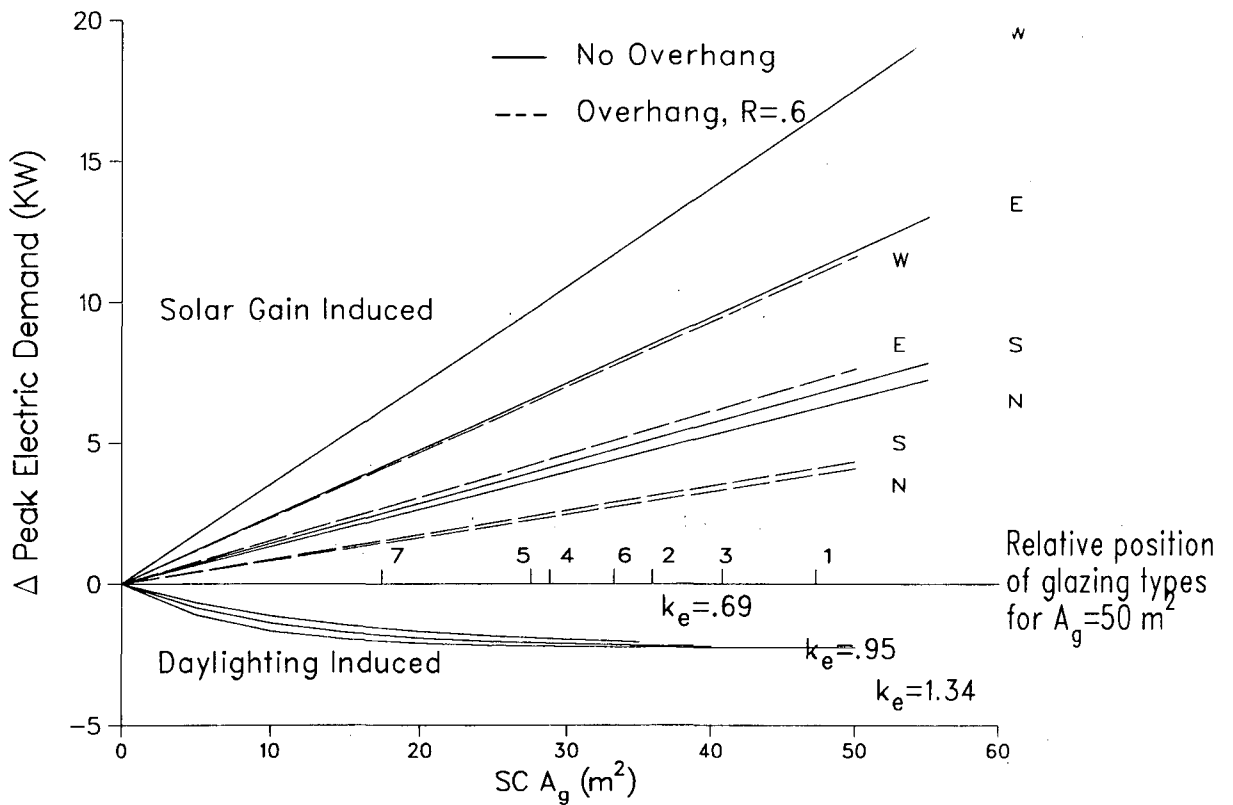


Figure 6. Incremental solar-gain- and daylighting-induced peak electric demand for four orientations of a commercial building as a function of the product of shading coefficient and window area. The lighting power density is 18.3 W/m² and the interior lighting level is 538 lux. The seven glazing types (from Table 1) are plotted at an area of 50 mm² for comparison. For east and west orientations, the data for overhangs are about the same as for shade management.

TABLE 5

Percent Reduction in Solar Induced Annual Electric Usage
With Single Pane Clear Glazing as a Base.

Window Type	Solar Gain %	Shading Coefficient
(1) G	0	.95
(2) G _g	23	.72
(3) G-G	13	.82
(4) G _g -G	40	.58
(5) G _y -G	42	.55
(6) GE-G	29	.67
(7) G _g E-G	63	.35

largest changes occur with low-E tinted double glazing. For the module used in this study, annual cooling energy due to solar gain can be reduced by 63% when using this glazing type. This corresponds to a net cooling energy reduction of 20 MWh and peak demand reduction of 10KW for a western orientation. The monolithic green absorbing glass unit results in a 23% reduction, so the addition of the low-E coating in the double glazed unit provides significant additional benefits.

In addition to the solar gain effects, Figures 5 and 6 also show some of the changes in daylighting savings. Lighting reduction curves are shown for an eastern orientation for three (two limiting and one midpoint) values of efficacy corresponding to glazings in Table 4 (types 3, 5, and 7). For electric energy consumption, the savings due to daylighting can approach the same magnitude as savings from the use of large overhangs. For the 50 m² window area, all glazing types have about the same daylight utilization, because the asymptotic values have been approached. One sees, however, that glazing type 7 (low-E green tinted), which has the lowest shading coefficient providing the maximum reduction in solar gain, also has the largest efficacy, $k_e=1.34$. Glazing type 3 ($k_e = 0.95$) provides almost the same available daylighting benefits as type 7 but with a large increase in solar gain. Better performance could be achieved by decreasing the glazing area to reduce the solar load without affecting daylight availability significantly.

Figures 5 and 6 also can be used for predicting the effects due to shade management. It was previously indicated that shade management was most useful for eastern and western orientations because of the large fraction of diffuse radiation present for north and south. The reduction in solar gain is coincidentally approximately the same as the decrease due to overhangs. Thus, for a shading coefficient multiplier of 0.6, about a 30% reduction is seen in both perimeter zone electricity use and peak demand. Note also that this shade management scheme has no effect on glazings with shading coefficients lower than 0.4. With such a low SC, the 63 W/m² (20 W/ft²) direct solar radiation level for shade management is not reached. Using interior shades does influence the savings with daylighting. The lighting curves in Figures 3 and 4 remain exponential in form and the daylighting reduction is about 25%.

CONCLUSIONS

Many techniques are available for reducing the annual electricity requirements and peak electrical demands of commercial office buildings in hot and humid climates. Several methods that relate to the design of the fenestration system have been documented. The effects of building orientation, external and internal shading devices, and glazing selection have been briefly discussed. A comparative study of several different glazings and the solar-optical properties that contribute to energy efficient design have also been presented. Conclusions are as follows.

1. Controlling solar gains from windows should be a major consideration in any new building design in hot and humid climates.
2. There is an extremely large variation in direct solar heat gain with orientation. Orientation also affects the level of influence that exterior and interior shading devices have on controlling these gains.
3. Lighting energy savings through the use of daylighting is a function of the visible transmittance of the glazing, the window area, desired lighting level, and lighting power density. It is possible to reduce electric lighting requirements by as much as 75% in perimeter zone offices.

4. Selecting the proper glazing type is as critical as orientation. It has been shown that it is possible to reduce electricity and peak demand of perimeter zones by using glazings with high efficacy values. These types of glazings reduce solar heat gain while maintaining a satisfactory level of daylighting utilization.
5. The use of exterior and interior shading devices on western and eastern orientations can reduce solar loads to the point that they are equivalent to northern and southern orientations. Shade management, as implemented in this study, gave results similar to an opaque overhang whose projection-width to window-height ratio was 0.6.
6. In Singapore, the use of overhangs did not significantly affect daylight availability because of the large fraction of diffuse sunlight. Interior shades, however, reduced daylight effectiveness 20%-25% for eastern and western orientations and less than 10% for north and south throughout most of the effective aperture range.
7. Glazing and/or shading must provide adequate control of discomfort glare from windows if the energy savings potential is to be realized.
8. Given adequate concern for orientation, glazing types, shading devices, and daylighting, a fenestration system can be designed that reduces overall energy consumption relative to an equivalent area of opaque wall.
9. Previous studies indicate that it is possible to have large first-cost savings by using high-efficacy glazings with daylighting controls rather than conventional glazings. The lower chiller and HVAC system first costs will pay for some or all of the increased glazing, solar shading, and lighting-control costs in many cases.

REFERENCES

- Arasteh, D., Johnson, R., Selkowitz, S., and Connell, D. 1985. "Cooling energy and cost savings with daylighting in hot and humid climates." Lawrence Berkeley Laboratory Report LBL-19734.
- Johnson, R., Sullivan, R., Selkowitz, S., Conner, C., and Arasteh, D. 1983. "Building envelope thermal and daylighting analysis in support of recommendations to upgrade ASHRAE/IES Standard 90." Lawrence Berkeley Laboratory Report LBL-16770.
- Johnson, R., Arasteh, D., and Connell, D. and Selkowitz, S. 1986. "The effect of daylighting strategies on building cooling loads and overall energy performance." Lawrence Berkeley Laboratory Report LBL-20347.
1984. "DOE-2 Supplement, Version 2.1C." Building Energy Simulation Group, Lawrence Berkeley Laboratory Report LBL-8706.
- Sweitzer, G., Arasteh, D., and Selkowitz, S. 1987. "Effects of low-emissivity glazings on energy use patterns in nonresidential daylighted buildings." ASHRAE Transactions, V.93 P.2.
- United States Agency for International Development. 1984. "Proceedings of the ASEAN conference on energy conservation in buildings." Development and Building Control Division, Public Works Department, Ministry of National Development, Republic of Singapore.

ACKNOWLEDGMENT

This work was supported by the Assistant Secretary for Conservation and Renewable Energy, Office of Buildings and Community Systems, Building Systems Division, U.S. Department of Energy under Contract No. DE-AC03-76SF00098.

*LAWRENCE BERKELEY LABORATORY
TECHNICAL INFORMATION DEPARTMENT
UNIVERSITY OF CALIFORNIA
BERKELEY, CALIFORNIA 94720*