

# Lawrence Berkeley National Laboratory

## Lawrence Berkeley National Laboratory

### **Title**

Is CO2 an Indoor Pollutant? Direct Effects of Low to Moderate CO2 Concentrations on Human Decision?Making Performance

### **Permalink**

<https://escholarship.org/uc/item/222631x2>

### **Author**

Satish, Usha

### **Publication Date**

2012-12-01

### **DOI**

10.1289/ehp.1104789

Peer reviewed



# ERNEST ORLANDO LAWRENCE BERKELEY NATIONAL LABORATORY

## Is CO<sub>2</sub> an Indoor Pollutant? Direct Effects of Low-to Moderate CO<sub>2</sub> Concentrations on Human Decision-Making Performance

Usha Satish,<sup>1</sup> Mark J. Mendell,<sup>2</sup> Krishnamurthy Shekhar,<sup>1</sup> Toshifumi Hotchi,<sup>2</sup> Douglas Sullivan,<sup>2</sup> Siegfried Streufert<sup>1</sup> and William J. Fisk<sup>2</sup>

<sup>1</sup>Department of Psychiatry and Behavioral Science  
Upstate Medical University, State University of New York  
Syracuse, NY, USA

<sup>2</sup>Environmental Energy Technologies Division  
Indoor Environment Group  
Lawrence Berkeley National Laboratory  
Berkeley, CA, USA

September 2012

Funding for this research was provided by Collaborative Activities for Research and Technology Innovation (CARTI), which supports research in the areas of air quality and water resource management. CARTI, part of the Syracuse Center of Excellence located in Syracuse, New York, is supported by the U.S. Environmental Protection Agency under award EM-83340401-0, and the U.S. Department of Energy under Contract DE-AC02-05CH11231.

*Published in Environmental Health Perspectives, September 21, 2012,  
doi:10.1289/ehp.1104789*

**Disclaimer**

This document was prepared as an account of work sponsored by the United States Government. While this document is believed to contain correct information, neither the United States Government nor any agency thereof, nor The Regents of the University of California, nor any of their employees, makes any warranty, express or implied, or assumes any legal responsibility for the accuracy, completeness, or usefulness of any information, apparatus, product, or process disclosed, or represents that its use would not infringe privately owned rights. Reference herein to any specific commercial product, process, or service by its trade name, trademark, manufacturer, or otherwise, does not necessarily constitute or imply its endorsement, recommendation, or favoring by the United States Government or any agency thereof, or The Regents of the University of California. The views and opinions of authors expressed herein do not necessarily state or reflect those of the United States Government or any agency thereof, or The Regents of the University of California.

Ernest Orlando Lawrence Berkeley National Laboratory is an equal opportunity employer.

*Published in Environmental Health Perspectives, September 21, 2012*

*Citation:*

Satish U, Mendell MJ, Shekhar K, Hotchi T, Sullivan D, Streufert S, Fisk WJ. Is CO<sub>2</sub> an Indoor Pollutant? Direct Effects of Low-to-Moderate CO<sub>2</sub> Concentrations on Human Decision-Making Performance. Environ Health Perspect. doi:10.1289/ehp.1104789

**Is CO<sub>2</sub> an Indoor Pollutant? Direct Effects of Low-to-Moderate CO<sub>2</sub> Concentrations on Human Decision-Making Performance**

Usha Satish,<sup>1</sup> Mark J. Mendell,<sup>2</sup> Krishnamurthy Shekhar,<sup>1</sup> Toshifumi Hotchi,<sup>2</sup>  
Douglas Sullivan,<sup>2</sup> Siegfried Streufert<sup>1</sup> and William J. Fisk<sup>2</sup>

<sup>1</sup> Department of Psychiatry and Behavioral Science, Upstate Medical University, State University of New York, Syracuse, NY, USA

<sup>2</sup> Indoor Environment Department, Lawrence Berkeley National Laboratory, Berkeley, CA, USA

Correspondence (regular/overnight mail):

Mark J. Mendell  
Lawrence Berkeley National Laboratory  
1 Cyclotron Road, 90R3058  
Berkeley, CA 94720  
Phone: 510-486-5762  
Fax: 510-486-6658  
Email: [mjmendell@lbl.gov](mailto:mjmendell@lbl.gov)

Acknowledgments:

Funding for this research was provided by Collaborative Activities for Research and Technology Innovation (CARTI), which supports research in the areas of air quality and water resource management. CARTI, part of the Syracuse Center of Excellence located in Syracuse, New York, is supported by the U.S. Environmental Protection Agency under award EM-83340401-0. Information about CARTI is available at <http://www.syracusecoe.org/coe/sub1.html?skuvar=68>.

Running Title:

Effects of CO<sub>2</sub> on Decision-Making Performance

Key words:

Carbon dioxide  
Cognition  
Decision making  
Human performance  
Indoor environmental quality  
Ventilation

Competing financial interests declaration:

The authors declare that they have no competing financial interests

Abbreviations:

ACGIH	American Conference of Government Industrial Hygienists
ANOVA	analysis of variance
C	Celsius
cfm	cubic feet per minute
CO <sub>2</sub>	carbon dioxide
df	degrees of freedom
F	Fahrenheit
h	hour
IAQ	indoor air quality
L	liter
LBNL	Lawrence Berkeley National Laboratory
MANOVA	multivariate analysis of variance
max	maximum
min	minimum
NIOSH	National Institute for Occupational Safety and Health
OSHA	Occupational Safety and Health Administration
PaCO <sub>2</sub>	partial pressure of CO <sub>2</sub> in arterial blood
ppm	parts per million
RH	relative humidity
s	second
SBS	sick building syndrome
SD	standard deviation
SMS	Strategic Management Simulation
VOC	volatile organic compound

## Abstract

**Background** – Associations of higher indoor carbon dioxide (CO<sub>2</sub>) concentrations with impaired work performance, increased health symptoms, and poorer perceived air quality have been attributed to correlation of indoor CO<sub>2</sub> with concentrations of other indoor air pollutants also influenced by rates of outdoor-air ventilation.

**Objectives** – We assessed direct effects of CO<sub>2</sub>, within the range of indoor concentrations, on decision making.

**Methods** – Twenty two participants were exposed to CO<sub>2</sub> at 600, 1,000, and 2,500 ppm in an office-like chamber, in six groups. Each group was exposed to these conditions in three 2.5-hour sessions, all on one day, with exposure order balanced across groups. At 600 ppm, CO<sub>2</sub> came from outdoor air and participants' respiration. Higher concentrations were achieved by injecting ultrapure CO<sub>2</sub>. Ventilation rate and temperature were constant. Under each condition, participants completed a computer-based test of decision-making performance and questionnaires on health symptoms and perceived air quality. Participants, and the person administering the decision-making test, were blinded to CO<sub>2</sub> level. Data were analyzed with analysis of variance models.

**Results** – Relative to 600 ppm, at 1,000 ppm CO<sub>2</sub>, moderate and statistically significant decrements occurred in six of nine scales of decision-making performance. At 2,500 ppm, large and statistically significant reductions occurred in seven scales of decision-making performance (raw score ratios 0.06-0.56), but performance on the focused activity scale increased.

**Conclusions** – Direct adverse effects of CO<sub>2</sub> on human performance may be economically important and may limit energy-saving reductions in outdoor air ventilation per person in buildings. Confirmation of these findings is needed.

## Introduction

Because humans produce and exhale carbon dioxide (CO<sub>2</sub>), concentrations of CO<sub>2</sub> in occupied indoor spaces are higher than concentrations outdoors. As the ventilation rate (i.e., rate of outdoor air supply to the indoors) per person decreases, the magnitude of the indoor-outdoor difference in CO<sub>2</sub> concentration increases. Consequently, peak indoor CO<sub>2</sub> concentrations, or the peak elevations of the indoor concentrations above those in outdoor air, have often been used as rough indicators for outdoor-air ventilation rate per occupant (Persily and Dols 1990). The need to reduce energy consumption provides an incentive for low rates of ventilation, leading to higher indoor CO<sub>2</sub> concentrations.

Although typical outdoor CO<sub>2</sub> concentrations are approximately 380 parts per million (ppm), outdoor levels in urban areas as high as 500 ppm have been reported (Persily 1997). Concentrations of CO<sub>2</sub> inside buildings range from outdoor levels up to several thousand ppm (Persily and Gorfain 2008). Prior research has documented direct health effects of CO<sub>2</sub> on humans, but only at concentrations much higher than found in normal indoor settings. CO<sub>2</sub> concentrations greater than 20,000 ppm cause deepened breathing; 40,000 ppm increases respiration markedly; 100,000 ppm causes visual disturbances and tremors and has been associated with loss of consciousness; and 250,000 ppm (25%) CO<sub>2</sub> can cause death (Lipsett et al. 1994). Maximum recommended occupational exposure limits for an 8-hour workday are 5,000 ppm as a time-weighted average, for the Occupational Safety and Health Administration (OSHA) (OSHA 2012) and the American Conference of Government Industrial Hygienists (ACGIH) (ACGIH 2011).

Epidemiologic and intervention research has shown that higher levels of CO<sub>2</sub> within the range found in normal indoor settings are associated with perceptions of poor air quality, increased prevalence of acute health symptoms (e.g., headache, mucosal irritation), slower work performance, and increased absence (Erdmann and Apte 2004; Federspiel et al. 2004; Milton et al. 2000; Seppanen et al. 1999; Shendell et al. 2004; Wargocki et al. 2000). It is widely believed that these associations exist only because the higher indoor CO<sub>2</sub> concentrations that occur at lower outdoor air ventilation rates are correlated with higher levels of other indoor-generated pollutants that directly cause the adverse effects (Mudarri 1997; Persily 1997). Thus CO<sub>2</sub> in the range of concentrations found in buildings (i.e., up to 5,000 ppm) has been assumed to have no direct impacts on occupants' perceptions, health, or work performance.

Researchers in Hungary have questioned this assumption (Kajtar et al. 2003; Kajtar et al. 2006). The authors reported that controlled human exposures to CO<sub>2</sub> between 2,000 ppm and 5,000 ppm, with ventilation rates unchanged, had subtle adverse impacts on proofreading of text in some trials, but the brief reports in conference proceedings provided limited details.

This stimulated our group to test effects of variation in CO<sub>2</sub> alone, in a controlled environment, on potentially more sensitive high-level cognitive functioning. We investigated a hypothesis that higher concentrations of CO<sub>2</sub>, within the range found in buildings and without changes in ventilation rate, have detrimental effects on occupants' decision-making performance.

## Methods

This study addresses responses among human participants under three different conditions in a controlled environmental chamber outfitted like an office, with CO<sub>2</sub> concentrations of approximately 600, 1,000, and 2,500 ppm. Six groups of four participants were scheduled for exposure to each of the three conditions for 2.5 hours per condition. The experimental sessions for each group took place on a single day, from 9:00-11:30, 12:30-15:00, and 16:00 – 18:30, with one-hour breaks outside of the exposure chamber between sessions. During the first break, participants ate a self-provided lunch. The order in which participants were exposed to the different CO<sub>2</sub> concentrations was balanced across groups, including all possible orders of low, medium, and high concentration sessions. Participants, and the person administering the tests of decision-making performance, were not informed about specific CO<sub>2</sub> conditions in each session. During each exposure condition, participants completed a computer-based test of decision-making performance, in which they were presented with scenarios and asked to make decisions based on a standardized protocol (Krishnamurthy et al. 2009; Satish et al. 2009; Streufert and Satish 1997). Before and after each test of decision-making performance, participants also completed computer-based questionnaires on perceived indoor air quality and health symptoms.

We received approval for the study protocol and the informed consent procedures from the Human Subjects Committee at Lawrence Berkeley National Laboratory (LBNL). We recruited primarily from among a local population of university students, all at least 18 years old. We scheduled 24 participants, with extras in case of no-shows, for participation. All participants provided written informed consent before participation. Scheduled participants were provided a small amount of financial compensation for their time.

### *Exposure Protocol*

Experimental sessions were conducted in a chamber facility at LBNL. The chamber has a 4.6 by 4.6 m floor plan, 2.4 m high ceiling, standard gypsum board walls, and vinyl flooring, and is equipped with four small desks, each with an Internet-connected computer. The chamber is located inside a heated and cooled building, with all external surfaces of the chamber surrounded by room-temperature air. The chamber has one window (~1 m by 1 m) that views the interior of the surrounding indoor space; hence, changes in daylighting or the view to outdoors were not factors in the research. The chamber has a relatively air-tight envelope, including a door with a refrigerator-style seal. The chamber was positively pressurized relative to the surrounding space. A small heating, ventilating, and air-conditioning system served the chamber with thermally conditioned air filtered with an efficient particle filter. The outdoor air supply rate was maintained constant at approximately 3.5 times the 7.1 L/s per person minimum requirement in California (California Energy Commission 2008); the flow rate was monitored continuously with a venturi flow meter (Gerand Model 4" 455, Minneapolis, MI).

CO<sub>2</sub> was recorded in real time at 1-minute intervals. During the baseline sessions, with participants and outdoor air as the only indoor source of CO<sub>2</sub>, measured CO<sub>2</sub> concentrations were approximately 600 ppm. In sessions with CO<sub>2</sub> added, CO<sub>2</sub> from a cylinder of ultra-pure CO<sub>2</sub> (at least 99.9999% pure) was added to the chamber supply air, upstream of the supply-air fan to assure mixing of the CO<sub>2</sub> in the air, at the rate needed to increase the CO<sub>2</sub> concentration to either



1,000 or 2,500 ppm. A mass flow controller monitored and regulated injection rates in real time. All other conditions (e.g., ventilation rate, temperature) remained unchanged.

The outdoor air exchange rate of the chamber was about  $7 \text{ h}^{-1}$ ; and in sessions with  $\text{CO}_2$  injected into the chamber, injection started before the participants entered the chamber. In sessions with no  $\text{CO}_2$  injection,  $\text{CO}_2$  concentrations were close to equilibrium levels 25 minutes after the start of occupancy, and in sessions with  $\text{CO}_2$  injection (because  $\text{CO}_2$  injection started before participants entered the chamber), 10-15 minutes after the start of occupancy.

Before participants entered the chamber, the desired chamber temperature and ventilation rate were established at target values of  $23 \text{ }^\circ\text{C}$  ( $73 \text{ }^\circ\text{F}$ ) and  $100 \text{ L/s}$  ( $210 \text{ ft}^3/\text{minute}$ ). Indoor chamber temperature during the experimental sessions was maintained at  $\sim 23 \text{ }^\circ\text{C}$  ( $73.4 \text{ }^\circ\text{F}$ ) by proportionally controlled electric resistance heating in the supply airstream. RH was approximately  $50\% \pm 15\%$ . We continuously monitored temperature and RH in real time. Temperature was averaged for each session for comparisons.

Calibrations of all instruments were checked at the start of the study. Calibration of the  $\text{CO}_2$  monitors was checked at least every week during experiments using primary standard calibration gases. Based on the instruments used and calibration procedures, we anticipated measurement accuracies of  $\pm 5\%$  at the lowest  $\text{CO}_2$  concentrations and as high as  $\pm 3\%$  at the highest concentrations. Real-time logged environmental data ( $\text{CO}_2$ , temperature, relative humidity, outdoor air supply rate) were downloaded from environmental monitors to Excel and imported into SAS statistical analysis software (SAS 9.1, Cary, NC).

The design of the  $\text{CO}_2$  injection system included features to prevent unsafe  $\text{CO}_2$  concentrations from developing in the event of a failure in the  $\text{CO}_2$  injection system or human error. The  $\text{CO}_2$  cylinder was outdoors so that any leaks would be to outdoors. A pressure relief valve located downstream of the pressure regulator was also located outdoors and set to prevent pressures from exceeding our target pressure at the inlet of the mass flow controller by  $>50\%$ . Valves would automatically stop  $\text{CO}_2$  injection if the outdoor air ventilation to the chamber or the ventilation fan failed. A flow limiter prevented  $\text{CO}_2$  concentrations from exceeding  $5,000 \text{ ppm}$  if the mass flow controller failed in the fully open position, and a second  $\text{CO}_2$  analyzer with control system would automatically stop  $\text{CO}_2$  injection if the concentration exceeded  $5,000 \text{ ppm}$ . Also, a research associate monitored  $\text{CO}_2$  concentrations in the chamber using a real time instrument. Given the purity level of the carbon dioxide in the gas cylinder ( $99.9999\%$ ) and the rate of outdoor air supply to the chamber, the maximum possible chamber air concentration of impurities originating from the cylinder of  $\text{CO}_2$  was only  $2 \text{ ppb}$ . The impurity of highest concentration was likely to be water vapor, and at a concentration  $\leq 2 \text{ ppb}$ , short term health risks from exposures to impurities would have been far less than risks associated with exposures to many normal indoor or outdoor pollutants. Finally, before participants entered the chamber we added  $\text{CO}_2$  from the cylinder to the chamber air, and collected an air sample on a sorbent tube for analysis by thermal desorption gas chromatography mass spectrometry. There was no evidence that the  $\text{CO}_2$  injection process increased indoor concentrations of volatile organic compounds (VOCs). Volatile organic compounds at low concentrations, typical of indoor and outdoor air concentrations, were detected.

On the morning of each of six experimental days, groups of participants came to LBNL for a full day of three experimental sessions. To ensure a full set of four participants for each scheduled day (after one unanticipated no-show on each of the first two days), we scheduled five participants each day and selected four at random to participate. On each experimental day, as soon as all participants had arrived, the selected participants were seated in the environmental chamber facility. Before they entered the chamber, a research associate distributed to participants a handout describing the session plans and answered any questions.

During the first 45 minutes of each session, participants were free to perform school work, read, or engage in any quiet non-disruptive activity. Participants were then asked by the LBNL research associate to complete the computer-based questionnaire on perceived air quality and symptoms, available via web connection on the laptop computers on their desks. Participants then had a 10-minute break, to stretch or exit the chamber to use the bathroom, but no participant elected to exit the chamber during a session.

A 20-minute training protocol was then used to train participants in the decision-making task. A technician trained in administering this test was present to answer questions before the test, and could enter the chamber to answer questions during the test. We estimated that CO<sub>2</sub> emissions of the technician, who was in the chamber for about 10 minutes during each session, would increase chamber CO<sub>2</sub> concentrations by no more than 17 ppm. (The technician was not required to give informed consent for this because the study conditions are commonly experienced in indoor environments and are not associated with adverse health effects.) Over the next 1.5 hours, participants took the computerized test of decision-making performance, which involved reading text displayed on a laptop computer and selecting among possible responses to indicate their decisions.

When the performance test was completed, participants repeated the computer-based questionnaire on perceived air quality and symptoms and then left the chamber until the next session. At any time during each session, participants were free to exit the facility to use a nearby bathroom, but were asked to return within 10 minutes. Participants were also free to terminate their participation and leave the facility at any time during the day, but no participants exercised these options.

#### *Testing of Decision-Making Performance*

We used a testing method designed to assess complex cognitive functioning in ways more relevant to the tasks of workers in buildings than the tests of simulated office work generally used (e.g., proof-reading text, adding numbers) (Wargocki et al. 2000). A computer-based program called the Strategic Management Simulation (SMS) test collects data on performance in decision making under different conditions. The SMS test has been used to study the impact on people's decision-making abilities of different drugs, VOCs from house painting, stress overload, head trauma, etc. (Breuer and Satish 2003; Satish et al. 2006; Satish et al. 2004; Satish et al. 2008; Swezey et al. 1998). (SMS testing is available for research by contract with State University of New York Upstate Medical University, and for commercial applications via Streufert Consulting, LLC.)

The SMS measures complex human behaviors required for effectiveness in many workplace settings. The system assesses both basic cognitive and behavioral responses to task demands, as well as cognitive and behavioral components commonly considered as executive functions. The system and its performance have been described in prior publications (e.g., Breuer and Satish 2003; Satish et al. 2004; Swezey et al. 1998). Participants are exposed to diverse computer-generated situations presenting real-world equivalent simulation scenarios that are proven to match real-world day-to-day challenges. Several parallel scenarios are available, allowing retesting individuals without bias due to experience and learning effects. Participants are given instructions via text messages on a user-friendly computer interface, and respond to the messages using a drop-down menu of possible decisions. All participants receive the same quantity of information at fixed time points in simulated time, but participants have flexibility to take actions and make decisions at any time during the simulation, as in the real world. The absence of requirements to engage in specific actions or to make decisions at specific points in time, the absence of stated demands to respond to specific information, the freedom to develop initiative, and the freedom for strategy development and decision implementation allow each participant to utilize his/her own preferred or typical action, planning, and strategic style. The SMS system generates measurement profiles that reflect the underlying decision-making capacities of the individual.

The computer calculates SMS performance measures as raw scores, based on the actions taken by the participants, their stated future plans, their responses to incoming information, and their use of prior actions and outcomes. The validated measures of task performance vary from relatively simple competencies such as speed of response, activity, and task orientation, through intermediate level capabilities such as initiative, emergency responsiveness, and use of information, to highly complex thought and action processes such as breadth of approach to problems, planning capacity, and strategy. The nine primary factors and factor combinations that have predicted real-world success are:

- Basic Activity Level (number of actions taken)
- Applied Activity (opportunistic actions)
- Focused Activity (strategic actions in a narrow endeavor)
- Task Orientation (focus on concurrent task demands)
- Initiative (development of new/creative activities)
- Information search (openness to, and search for information)
- Information usage (ability to utilize information effectively)
- Breadth of Approach (flexibility in approach to the task)
- Basic Strategy (number of strategic actions)

The raw scores assigned for each measure are linearly related to performance, with a higher score indicating superior performance. Interpretation is based on the relationship to established standards of performance excellence among thousands of previous SMS participants (Breuer and Streufert 1995; Satish et al. 2004; Satish et al. 2008; Streufert et al. 1988; Streufert and Streufert 1978; Streufert and Swezey 1986). Percentile ranks are calculated through a comparison of raw scores to the overall distribution of raw scores from a reference population of more than 20,000 U.S. adults, ages 16 to 83, who previously completed the SMS. The reference population was constructed non-randomly to be generally representative of the job distribution among the adult

U.S. population, including, e.g., college students, teachers, pilots, medical residents, corporate executives, home-makers, and unemployed. The percentile calculations for individual participants are not further adjusted for age, gender, or education level.

*Data Management and Analysis:*

The main predictor variable of interest was CO<sub>2</sub>, included in analyses as a categorical variable with three values: 600, 1,000, and 2,500 ppm. Real time CO<sub>2</sub> concentrations and temperature were averaged for each session for comparison.

Nine measures from the SMS, representing validated independent assessments of performance in complex task settings, were compared across CO<sub>2</sub> conditions. Raw scores on the different SMS measures are computer-calculated based on procedures (software formulas) that are discussed by Streufert and Swezey (1986). The formulas are based on numerically and graphically scored decision actions, on the interrelationships among decisions over time, the interrelationships among decisions with incoming information, as well as decision planning and other components of participant activity. Each of the activity event components that are utilized in the formulas are collected by the SMS computer software program (cf. Streufert and Swezey (1986)). A separate SMS software system is subsequently used to calculate the value for each measure. Where appropriate – i.e., where maximum performance levels have limits (cannot be exceeded) – the obtained scores are expressed by the program as percentages of maximally obtainable values. A higher score on a measure indicates better performance in that area of performance. For each measure, ratios of scores across conditions were calculated to show the magnitude of changes.

Initial data analysis used multivariate analysis of variance (MANOVA) to assess overall significance across all conditions, to assure that subsequent (post hoc) analysis across the nine different simulation measures would be legitimate. With high levels of significance established, post hoc analysis for each simulation measure using analysis of variance techniques (ANOVA) becomes possible. Separate analysis of variance procedures across CO<sub>2</sub> conditions were used for each of the nine SMS measures (within participants, with participants as their own controls). Percentile ranks were calculated from the raw scores and normative data, without adjustments for demographic or other variables. Percentile levels are divided into categories with descriptive labels based on prior test findings from different populations, normal and impaired.

## **Results**

Because 2 of the 24 originally scheduled participants cancelled at a time when they could not be replaced, 22 participants provided complete SMS data. Of these, 10 were male; 18 were aged 18 to 29 years and 4 were aged 30 to 39. One participant had completed high school only, 8 had completed some college, and 13 had a college degree. None were current smokers, 1 reported current asthma, and 5 reported eczema, hay fever, or allergy to dust or mold.

Median CO<sub>2</sub> values for the low, medium, and high CO<sub>2</sub> conditions were 600, 1,006, and 2,496 ppm (which we will refer to as 600, 1,000, and 2,500 ppm), and ranges were 132, 92, and 125 ppm, respectively (Table 1). Temperatures in the study chamber were controlled effectively, varying overall within about 0.2 °C (from 22.9 to 23.1 °C in each condition), and with median values across the three CO<sub>2</sub> conditions varying less than 0.1 °C.

The raw scores for each of the SMS performance measures were plotted for each participant according to CO<sub>2</sub> level (Figure 1). The plots indicate clear relationships between raw scores and CO<sub>2</sub> level for all performance measures other than focused activity and information search, with dramatic reductions in raw scores at 2,500 ppm CO<sub>2</sub> for some measures of decision-making performance.

For seven of nine scales of decision-making performance (basic activity, applied activity, task orientation, initiative, information usage, breadth of approach, and strategy), mean raw scores showed a consistently monotonic decrease with increasing CO<sub>2</sub> concentrations, with all overall p-values <0.001 (Table 2). In post-hoc pairwise comparisons by CO<sub>2</sub> concentration, performance on these 7 scales differed between concentrations with  $p < 0.01$  for all comparisons, with the exception of performance on the task orientation, initiative, and strategy scales between 600 and 1,000 ppm CO<sub>2</sub> ( $p < 0.05$ ,  $p < 0.10$ , and  $p < 0.05$ , respectively) (Table 3). For these 7 scales, compared with mean raw scores at 600 ppm CO<sub>2</sub>, mean raw scores at 1,000 ppm CO<sub>2</sub> were 11% to 23% lower, and at 2,500 ppm CO<sub>2</sub> were 44% to 94% lower. Relative to raw scores at 1,000 ppm CO<sub>2</sub>, raw scores at 2,500 ppm were 35% to 93% lower.

For information search, mean raw scores were similar at all three CO<sub>2</sub> conditions. Neither the overall analysis across the three conditions (Table 2) nor the post-hoc pairwise analyses (Table 3) indicated significant differences. For focused activity, raw scores at 600 ppm CO<sub>2</sub> and 1,000 ppm CO<sub>2</sub> were nearly identical (16.27 and 16.09), but the mean raw score at 2,500 ppm was higher (19.55), resulting in an overall p-value  $\leq 0.001$  (Table 2). Post-hoc tests indicated no difference between mean raw scores at 600 and 1,000 ppm CO<sub>2</sub>, but significant differences ( $p \leq 0.01$ ) between the mean raw score at 2,500 ppm CO<sub>2</sub> and scores at both 600 and 1,000 ppm (Table 3).

Figure 2 shows the percentile scores on the nine scales at the three CO<sub>2</sub> conditions (based on the raw scores shown in Table 2), with the percentile boundaries for five normative levels of performance: superior, very good, average, marginal, and dysfunctional. At 1,000 ppm CO<sub>2</sub> relative to 600 ppm, percentile ranks were moderately diminished at most. However, at 2,500 ppm CO<sub>2</sub>, percentile ranks for five performance scales decreased to levels associated with marginal or dysfunctional performance.

## **Discussion**

### *Synthesis and Interpretation of Findings*

Performance for six of nine decision-making measures decreased moderately at 1,000 ppm relative to the baseline of 600 ppm, and seven decreased substantially at 2,500 ppm. For an eighth scale, “information search,” no significant differences were seen across conditions. In contrast to other scales, an inverse pattern was seen for “focused activity,” with the highest level of focus obtained at 2,500 ppm and the lowest at 600 ppm.

Thus, most decision-making variables showed a decline with higher concentrations of CO<sub>2</sub>, but measures of focused activity improved. Focused activity is important for overall productivity, but high levels of focus under non-emergency conditions may indicate “over-concentration.” Prior

research with the SMS has shown repeatedly that individuals who experience difficulty in functioning (e.g., persons with mild to moderate head injuries (Satish et al. 2008), persons under the influence of alcohol (Streufert et al. 1993), and persons suffering from allergic rhinitis (Satish et al. 2004) tend to become highly focused on smaller details at the expense of the big picture.

High levels of predictive validity for the SMS ( $r > 0.60$  with real-world success as judged by peers and as demonstrated by income, job level, promotions, and level in organizations), as well as high levels of test-retest reliability across the four simulation scenarios ( $r = 0.72-0.94$ ) have repeatedly been demonstrated (Breuer and Streufert 1995; Streufert et al. 1988). Additional validity is demonstrated by the deterioration of various performance indicators with 0.05% blood alcohol intoxication and seriously diminished functioning with intoxication at the 0.10 level (Satish and Streufert 2002). Baseline scores at 600 ppm CO<sub>2</sub> for the participants in this study, mostly current science and engineering students from a top U.S. university, were all average or above.

While the modest reductions in multiple aspects of decision making seen at 1,000 ppm may not be critical to individuals, at a societal level or for employers, an exposure that reduces performance even slightly could be economically significant. The substantial reductions in decision-making performance with 2.5-hour exposures to 2,500 ppm indicate, per the available norms for the SMS test, impairment that is of importance even for individuals. These findings provide initial evidence for considering CO<sub>2</sub> as an indoor pollutant, not just a proxy for other pollutants that directly affect people.

#### *CO<sub>2</sub> Concentrations in Practice*

The real-world significance of our findings, if confirmed, would depend upon the extent to which CO<sub>2</sub> concentrations are at or above 1,000 and 2,500 ppm in current or future buildings. There is strong evidence that in schools, CO<sub>2</sub> concentrations are frequently near or above the levels associated in this study with significant reductions in decision-making performance. In surveys of elementary school classrooms in California and Texas, average CO<sub>2</sub> concentrations were above 1,000 ppm, a substantial proportion exceeded 2,000 ppm, and in 21% of Texas classrooms peak CO<sub>2</sub> concentration exceeded 3,000 ppm (Corsi et al. 2002; Whitmore et al. 2003). Given these concentrations, we must consider the possibility that some students in high-CO<sub>2</sub> classrooms are disadvantaged in learning or test taking. We do not know if exposures that cause decrements in decision making in the SMS test will inhibit learning by students; however, we cannot rule out impacts on learning. We were not able to identify CO<sub>2</sub> measurements for spaces in which students take tests related to admission to universities or graduate schools, or from tests related to professional accreditations, but these testing environments often have a high occupant density, and thus might have elevated CO<sub>2</sub> levels.

In general office spaces within the U.S., CO<sub>2</sub> concentrations tend to be much lower than in schools. In a representative survey of 100 U.S. offices (Persily and Gorfain 2008), only 5% of the measured peak indoor CO<sub>2</sub> concentrations exceeded 1,000 ppm, assuming an outdoor concentration of 400 ppm. One very small study suggests that meeting rooms in offices, where important decisions are sometimes made, can have elevated CO<sub>2</sub> concentrations; e.g., up to 1,900 ppm during 30-90 minute meetings (Fisk et al. 2010).

In some vehicles (aircraft, ships, submarines, cars, buses, and trucks), because of their airtight construction or high occupant density, high CO<sub>2</sub> concentrations may be expected. In eight studies within commercial aircraft, mean CO<sub>2</sub> concentrations in the passenger cabins were generally above 1,000 ppm and ranged as high as 1,756 ppm, and maximum concentrations were as high as 4,200 ppm (Committee on Air Quality in Passenger Cabins of Commercial Aircraft 2002). We did not identify data on CO<sub>2</sub> concentrations in automobiles and trucks. One small study (Knibbs et al. 2008) reported low ventilation rates in vehicles with ventilation systems in the closed or recirculated-air positions. From those results, and using an assumption of one occupant and a 0.0052 L/s CO<sub>2</sub> emission rate per occupant (Persily and Gorfain 2008), we estimated steady state CO<sub>2</sub> concentrations in an automobile and pickup truck of 3,700 ppm and 1,250 ppm above outdoor concentrations, respectively. These numbers would increase in proportion to the number of occupants. It is not known if the findings of the present study apply to the decision making of vehicle drivers, although such effects are conceivable.

There is evidence that people wearing masks for respiratory protection may inhale air with highly elevated CO<sub>2</sub> concentrations. In a recent study, dead-space CO<sub>2</sub> concentrations within a respirator (i.e., N95 mask) were approximately 30,000 ppm (Roberge et al. 2010), suggesting potentially high CO<sub>2</sub> concentration in inhaled air. The inhaled concentration would be lower than that within the mask, diluted by approximately 500 ml per breath inhaled through the mask. Although the study did not report the actual inhaled-air CO<sub>2</sub> concentrations, partial pressures of CO<sub>2</sub> in blood did not differ with wearing the mask (although see below on how respiration rate varies to stabilize this pressure). Caretti et al. (1999) reported that respirator wear with low-level activity did not adversely alter cognitive performance or mood.

#### *Findings by Others*

The Hungarian studies briefly reported by Kajtar et al. (2003; 2006) were the only prior studies on cognitive effects of moderate CO<sub>2</sub> elevations that we identified. In these studies, the ventilation rate in an experimental chamber was kept constant at a level producing a chamber CO<sub>2</sub> concentration of 600 ppm from the occupant-generated CO<sub>2</sub>; in some experiments, however, the chamber CO<sub>2</sub> concentration was increased above 600 ppm, to as high as 5,000 ppm, by injecting 99.995% pure CO<sub>2</sub> from a gas cylinder into the chamber. In two series of studies, participants blinded to CO<sub>2</sub> concentrations performed proofreading significantly more poorly in some, but not all sessions with CO<sub>2</sub> concentrations of 4,000 ppm relative to 600 ppm. Similar, marginally significant differences were seen at 3,000 vs. 600 ppm. (Differences were seen only in proportion of errors found, not in speed of reading.) The studies by Kajtar et al were small (e.g., 10 participants) and found only a few significant associations out of many trials that may have been due to chance, but did suggest that CO<sub>2</sub> concentrations found in buildings may directly influence human performance. Our research, which was motivated by the Hungarian studies, involved lower concentrations of CO<sub>2</sub>, a larger study population, and different methods to assess human performance.

Prior studies on CO<sub>2</sub> exposures, mostly at higher levels, have focused on physiologic effects. CO<sub>2</sub> is the key regulator of respiration and arousal of behavioral states in humans (Kaye et al. 2004). The initial effects of inhaling CO<sub>2</sub> at higher concentrations are increased partial pressure of CO<sub>2</sub> in arterial blood (PaCO<sub>2</sub>) and decreased blood pH. However, PaCO<sub>2</sub> is tightly regulated in healthy humans through reflex control of breathing, despite normal variation within and

between individuals (Bloch-Salisbury et al. 2000). Inhaled CO<sub>2</sub> at concentrations of tens of thousands of ppm has been associated with changes in respiration, cerebral blood flow, cardiac output, and anxiety (Brian Jr 1998; Kaye et al. 2004; Lipsett et al. 1994; Roberge et al. 2010; Woods et al. 1988). Little research has documented physiological impacts of moderately elevated CO<sub>2</sub> concentrations, except one small study that reported changes in respiration, circulation, and cerebral electrical activity at 1,000 ppm CO<sub>2</sub> (Goromosov 1968).

We do not have hypotheses to explain why inhaling moderately elevated CO<sub>2</sub>, with the expected resulting increases in respiration, heart rate, and cardiac output to stabilize PaCO<sub>2</sub>, would affect decision-making performance. Bloch-Salisbury et al. (2000) have summarized prior knowledge on effects of elevated PaCO<sub>2</sub>. PaCO<sub>2</sub> has a direct linear relationship with cerebral blood flow in a broad range above and below normal levels, through dilation and constriction of arterioles. Moderately elevated (or reduced) PaCO<sub>2</sub> has dramatic effects on central nervous system and cortical function. Bloch-Salisbury et al. (2000) reported that experimental changes in PaCO<sub>2</sub> in humans within the normal range (in 2-hour sessions involving special procedures to hold respiration constant and thus eliminate the normal reflex control of PaCO<sub>2</sub> through altered breathing), showed no effects on cognitive function or alertness but caused significant changes in EEG power spectra.

#### *Limitations*

This study successfully controlled the known environmental confounding factors of temperature and ventilation rate. While exposures to CO<sub>2</sub> in prior sessions may theoretically have affected performance in subsequent sessions, such carryover effects should not invalidate study results because of the balanced order of exposures. Suggestion effects were unlikely, as participants and the researcher explaining the SMS to them were blinded to specific conditions of each session. While we conclude that the causality of the observed effects is clear, the ability to generalize from this group of college/university students to others is uncertain. Effects of CO<sub>2</sub> between 600 and 1,000 ppm and between 1,000 and 2,500 ppm, and effects for longer and shorter periods of time are also uncertain. The strength of the effects at 2,500 ppm CO<sub>2</sub> is so large for some metrics as to almost defy credibility, although it is possible that such effects occur without recognition in daily life. Replication of these study findings, including use of other measures of complex cognitive functioning and measures of physiologic response such as respiration and heart rate, is needed before definitive conclusions are drawn.

#### *Implications for Minimum Ventilation Standards*

The findings of this study, if replicated, would have implications for the standards that specify minimum ventilation rates in buildings, and would also indicate the need to adhere more consistently to the existing standards. Many of the elevated CO<sub>2</sub> concentrations observed in practice are a consequence of a failure to supply the amount of outdoor air specified in current standards; however, even the minimum ventilation rates in the leading professional standard (ASHRAE 2010) correspond to CO<sub>2</sub> concentrations above 1,000 ppm in densely occupied spaces. There is current interest in reducing ventilation rates, and the rates required by standards, to save energy and reduce energy-related costs. Yet large reductions in ventilation rates could lead to increased CO<sub>2</sub> concentrations that may adversely affect decision-making performance, even if air cleaning systems or low-emission materials were used to control other indoor pollutants. It seems unlikely that recommended minimum ventilation rates in future standards



would be low enough to cause CO<sub>2</sub> levels above 2,500 ppm, a level at which decrements in decision-making performance in our findings were large, but standards with rates that result in 1,500 ppm of indoor CO<sub>2</sub> are conceivable.

## **Conclusions**

Increases in indoor CO<sub>2</sub> concentrations resulting from the injection of ultrapure CO<sub>2</sub>, with all other factors held constant, were associated with statistically significant and meaningful reductions in decision-making performance. At 1,000 ppm CO<sub>2</sub>, compared to 600 ppm, performance was significantly diminished on six of nine metrics of decision-making performance. At 2,500 ppm CO<sub>2</sub>, compared to 600 ppm, performance was significantly reduced in seven of nine metrics of performance, with percentile ranks for some performance metrics decreasing to levels associated with marginal or dysfunctional performance. The direct impacts of CO<sub>2</sub> on performance indicated by our findings may be economically important, may disadvantage some individuals, and may limit the extent to which outdoor air supply per person can be reduced in buildings to save energy. Confirmation of these findings is needed.

## References

- ACGIH. 2011. TLVs and BEIs. Cincinnati, OH: American Conference of Governmental Industrial Hygienists.
- ASHRAE. 2010. ANSI/ASHRAE Standard 62.1-2010: Ventilation for Acceptable Indoor Air Quality. Atlanta, GA, US: American Society of Heating, Refrigerating and Air-Conditioning Engineers, Inc.
- Bloch-Salisbury E, Lansing R, Shea SA. 2000. Acute changes in carbon dioxide levels alter the electroencephalogram without affecting cognitive function. *Psychophysiology* 37(4):418-426.
- Breuer K, Satish U. 2003. Emergency management simulations: an approach to the assessment of decision-making processes in complex dynamic crisis environments. In: *From Modeling To Managing Security: A Systems Dynamics Approach* (J.J. G, ed). Norway: Norwegian Academic Press, 145-156.
- Breuer K, Streufert S. 1995. The strategic management simulation (SMS): A case comparison analysis of the German SMS version. In: *Corporate Training for Effective Performance* (Mulder M, Brinkerhoff RO, eds). Boston: Kluwer, 1-17.
- Brian Jr JE. 1998. Carbon dioxide and the cerebral circulation. *Anesthesiology* 88(5):1365.
- California Energy Commission. 2008. 2008 Building energy efficiency standards for residential and nonresidential buildings CEC-400-2008-001-CMF. Sacramento, CA: California Energy Commission.
- Caretti DM. 1999. Cognitive performance and mood during respirator wear and exercise. Fairfax, VA, US: American Industrial Hygiene Association.
- Committee on Air Quality in Passenger Cabins of Commercial Aircraft. 2002. *The Airliner Cabin Environment and the Health of Passengers and Crew*. Washington., D.C., US: National Research Council.
- Corsi RL, Torres VM, Sanders M, Kinney KL. 2002. Carbon dioxide levels and dynamics in elementary schools: results of the TESIAS Study. In: *Indoor Air '02: Proceedings of the 9th International Conference on Indoor Air Quality and Climate, June 30-July 5 2002 2002*, Monterey, CA: Indoor Air, 74-79.
- Erdmann CA, Apte MG. 2004. Mucous membrane and lower respiratory building related symptoms in relation to indoor carbon dioxide concentrations in the 100-building BASE dataset. *Indoor Air* 14(s8):127-134.
- Federspiel CC, Fisk WJ, Price PN, Liu G, Faulkner D, Dibartolomeo DL, et al. 2004. Worker performance and ventilation in a call center: analyses of work performance data for registered nurses. *Indoor Air* 14(s8):41-50.
- Fisk WJ, Sullivan DP, Faulkner D, Eliseeva E. 2010. CO<sub>2</sub> monitoring for demand controlled ventilation in commercial buildings. LBNL-3279E. Berkeley, CA: Lawrence Berkeley National Laboratory.
- Goromosov MS. 1968. *The Physiological Basis of Health Standards for Dwellings*. Geneva, Switzerland: World Health Organization.
- Kajtar L, Herczeg L, Lang E. 2003. Examination of influence of CO<sub>2</sub> concentration by scientific methods in the laboratory. In: *Proceedings of Healthy Buildings 2003, 7-11 December 2003 2003*, Singapore: Stallion Press, 176-181.
- Kajtar L, Herczeg L, Lang E, Hrustinszky T, Banhidi L. 2006. Influence of carbon-dioxide pollutant on human well-being and work intensity. In: *Proceedings of Healthy Buildings*

- 2006, 4-8 June 2006 2006, Lisbon, Portugal:Universidade do Porto, Porto, Portugal, 85-90.
- Kaye J, Buchanan F, Kendrick A, Johnson P, Lowry C, Bailey J, et al. 2004. Acute carbon dioxide exposure in healthy adults: evaluation of a novel means of investigating the stress response. *Journal of neuroendocrinology* 16(3):256-264.
- Knibbs LD, De Dear RJ, Morawska L, Atkinson SE. 2008. On-road quantification of the key characteristics of automobile HVAC systems in relation to in-cabin submicrometer particle pollution. In: 11th International Conference on Indoor Air Quality and Climate: Indoor Air 2008. Copenhagen, Denmark.
- Krishnamurthy S, Satish U, Foster T, Streufert S, Dewan M, Krummel T. 2009. Components of critical decision making and ABSITE assessment: toward a more comprehensive evaluation. *Journal of Graduate Medical Education* 1(2):273-277.
- Lipsett MJ, Shusterman DJ, Beard RR. 1994. Inorganic compounds of carbon, nitrogen, and oxygen. In: Patty's Industrial Hygiene and Toxicology (Clayton GD, Clayton FD, eds). New York:John Wiley and Sons, 4523-4554.
- Milton DK, Glencross PM, Walters MD. 2000. Risk of sick leave associated with outdoor air supply rate, humidification, and occupant complaints. *Indoor Air* 10(4):212-221.
- Mudarri DH. 1997. Potential correction factors for interpreting CO<sub>2</sub> Measurements in buildings. *ASHRAE Transactions* 103(2):244-255.
- OSHA (Occupational Safety and Health Administration). 2012. Sampling and Analytical Methods: Carbon Dioxide in Workplace Atmospheres. Available: <http://www.osha.gov/dts/sltc/methods/inorganic/id172/id172.html> [accessed 7 May 2012].
- Persily A, Dols WS. 1990. The relation of CO<sub>2</sub> concentration to office building ventilation. *Air Change Rate and Airtightness in Buildings*, ASTM STP 1067:77-92.
- Persily AK. 1997. Evaluating building IAQ and ventilation with carbon dioxide. *ASHRAE Transactions* 103(2):193-204.
- Persily AK, Gorfain J. 2008. Analysis of ventilation data from the U.S. Environmental Protection Agency Building Assessment Survey and Evaluation (BASE) Study, NISTIR-7145-Revised. Bethesda, MD: National Institute for Standards and Technology.
- Roberge RJ, Coca A, Williams WJ, Powell JB, Palmiero AJ. 2010. Physiological impact of the N95 filtering facepiece respirator on healthcare workers. *Respiratory Care* 55(5):569-577.
- Satish U, Cleckner L, Vasselli J. 2006. Pilot study of using strategic management simulation to assess human productivity. In: AWMA/EPA Conference: Indoor Air Quality - Problems, Research, and Solutions, 17-19 July 2006, Durham, NC, US.
- Satish U, Manring J, Gregory R, Krishnamurthy S, Streufert S, Dewan M. 2009. Novel assessment of psychiatry residents: SMS simulations. *Accreditation Council for Graduate Medical Education (ACGME) Bulletin* January 18-23.
- Satish U, Streufert S. 2002. Value of a cognitive simulation in medicine: towards optimizing decision making performance of healthcare personnel. *Quality and Safety in Health Care* 11(2):163-167.
- Satish U, Streufert S, Dewan M, Voort SV. 2004. Improvements in simulated real-world relevant performance for patients with seasonal allergic rhinitis: impact of desloratadine. *Allergy* 59(4):415-420.

- Satish U, Streufert S, Eslinger PJ. 2008. Simulation-based executive cognitive assessment and rehabilitation after traumatic frontal lobe injury: A case report. *Disability & Rehabilitation* 30(6):468-478.
- Seppanen O, Fisk WJ, Mendell MJ. 1999. Association of ventilation rates and CO<sub>2</sub> concentrations with health and other responses in commercial and institutional buildings. *Indoor Air* 9(4):226-252.
- Shendell DG, Prill R, Fisk WJ, Apte MG, Blake D, Faulkner D. 2004. Associations between classroom CO<sub>2</sub> concentrations and student attendance in Washington and Idaho. *Indoor Air* 14(5):333-341.
- Streufert S, Pogash R, Piasecki M. 1988. Simulation based assessment of managerial competence: reliability and validity. *Personnel Psychology* 41(3):537-557.
- Streufert S, Pogash RM, Gingrich D, Kantner A, Lonardi L, Severs W, et al. 1993. Alcohol and complex functioning. *Journal of Applied Social Psychology* 23(11):847-866.
- Streufert S, Satish U. 1997. Graphic representations of processing structure: the time event matrix. *Journal of Applied Social Psychology* 27(23):2122-2148.
- Streufert S, Streufert SC. 1978. *Behavior in the Complex Environment*. Washington D.C. and New York City:VH Winston & Sons and Halsted Division, John Wiley and Sons.
- Streufert S, Swezey RW. 1986. *Complexity, Managers, and Organizations*. Orlando, Florida, US:Academic Press.
- Swezey RW, Streufert S, Satish U, Siem FM. 1998. Preliminary development of a computer-based team performance assessment simulation. *International Journal of Cognitive Ergonomics* 2:163-179.
- Wargocki P, Wyon DP, Sundell J, Clausen G, Fanger PO. 2000. The effects of outdoor air supply rate in an office on perceived air quality, sick building syndrome (SBS) symptoms and productivity. *Indoor Air* 10(4):222-236.
- Whitmore CA, Clayton A, Akland A. 2003. *California Portable Classrooms Study, Phase II: Main Study, Final Report, Volume II*. Research Triangle Park, NC: RTI International.
- Woods SW, Charney DS, Goodman WK, Heninger GR. 1988. Carbon dioxide--induced anxiety: behavioral, physiologic, and biochemical effects of carbon dioxide in patients with panic disorders and healthy subjects. *Archives of General Psychiatry* 45(1):43.

## TABLES

**Table 1.** CO<sub>2</sub> concentrations during study conditions

CO <sub>2</sub> Condition	CO <sub>2</sub> concentration (ppm)			
	Min	Median	Max	Range
Low	542	600	675	132
Medium	969	1006	1061	92
High	2,418	2,496	2,543	125
Overall	542	1006	2,543	---

Abbreviations: CO<sub>2</sub>, carbon dioxide; ppm, parts per million; Min, minimum; Max, maximum

**Table 2.** Mean raw scores for nine outcome variables at three conditions of CO<sub>2</sub> concentration among 22 participants, and comparison using MANOVA

Outcome Variables	Conditions (ppm of CO <sub>2</sub> )			Overall F statistic (df=2,42)	p-value
	600 ppm	1,000 ppm	2,500 ppm		
	Mean ± SD	Mean ± SD	Mean ± SD		
Basic activity	69.59 ± 7.04	59.23 ± 7.12	38.77 ± 7.57	172.77	<0.001
Applied activity	117.86 ± 39.28	97.55 ± 35.51	62.68 ± 31.86	72.13	<0.001
Focused activity	16.27 ± 3.20	16.09 ± 3.70	19.55 ± 3.40	17.26	<0.001
Task orientation	140.82 ± 28.66	125.41 ± 28.62	50.45 ± 31.66	115.08	<0.001
Initiative	20.09 ± 6.96	16.45 ± 6.70	1.41 ± 1.26	81.45	<0.001
Information search	20.36 ± 3.06	21.5 ± 3.20	20.91 ± 3.08	2.51	>0.10
Information usage	10.32 ± 3.21	7.95 ± 2.24	3.18 ± 1.71	129.20	<0.001
Breadth of approach	9.36 ± 1.36	7.82 ± 1.56	2.32 ± 1.17	679.88	<0.001
Strategy	27.23 ± 5.48	23.95 ± 5.65	1.68 ± 1.32	414.51	<0.001

Abbreviations: ppm, parts per million; CO<sub>2</sub>, carbon dioxide; df, degrees of freedom; SD, standard deviation

**Table 3.** Comparison of mean raw scores for nine decision-making measures between three different CO<sub>2</sub> concentrations among 22 participants

Variables	Ratios of Condition Scores <sup>a</sup>		
	Score at 1,000 ppm / Score at 600 ppm	Score at 2,500 ppm / Score at 1,000 ppm	Score at 2,500 ppm / Score at 600 ppm
Basic Activity	0.85 <sup>#</sup>	0.65 <sup>#</sup>	0.56 <sup>#</sup>
Applied Activity	0.83 <sup>#</sup>	0.64 <sup>#</sup>	0.53 <sup>#</sup>
Focused Activity	0.99	1.22 <sup>#</sup>	1.20 <sup>#</sup>
Task Orientation	0.89 <sup>**</sup>	0.40 <sup>#</sup>	0.36 <sup>#</sup>
Initiative	0.82 <sup>*</sup>	0.09 <sup>#</sup>	0.07 <sup>#</sup>
Information Search	1.06	0.97	1.03
Information Usage	0.77 <sup>#</sup>	0.40 <sup>#</sup>	0.31 <sup>#</sup>
Breadth of Approach	0.84 <sup>#</sup>	0.30 <sup>#</sup>	0.25 <sup>#</sup>
Strategy	0.88 <sup>**</sup>	0.07 <sup>#</sup>	0.06 <sup>#</sup>


Abbreviations: CO<sub>2</sub>, carbon dioxide; ppm, parts per million; df, degrees of freedom

<sup>a</sup> p-values based on F test, df = 1, 21, calculated for difference between score in numerator and score in denominator


\* p-value <0.10

\*\* p-value <0.05

# p-value <0.01

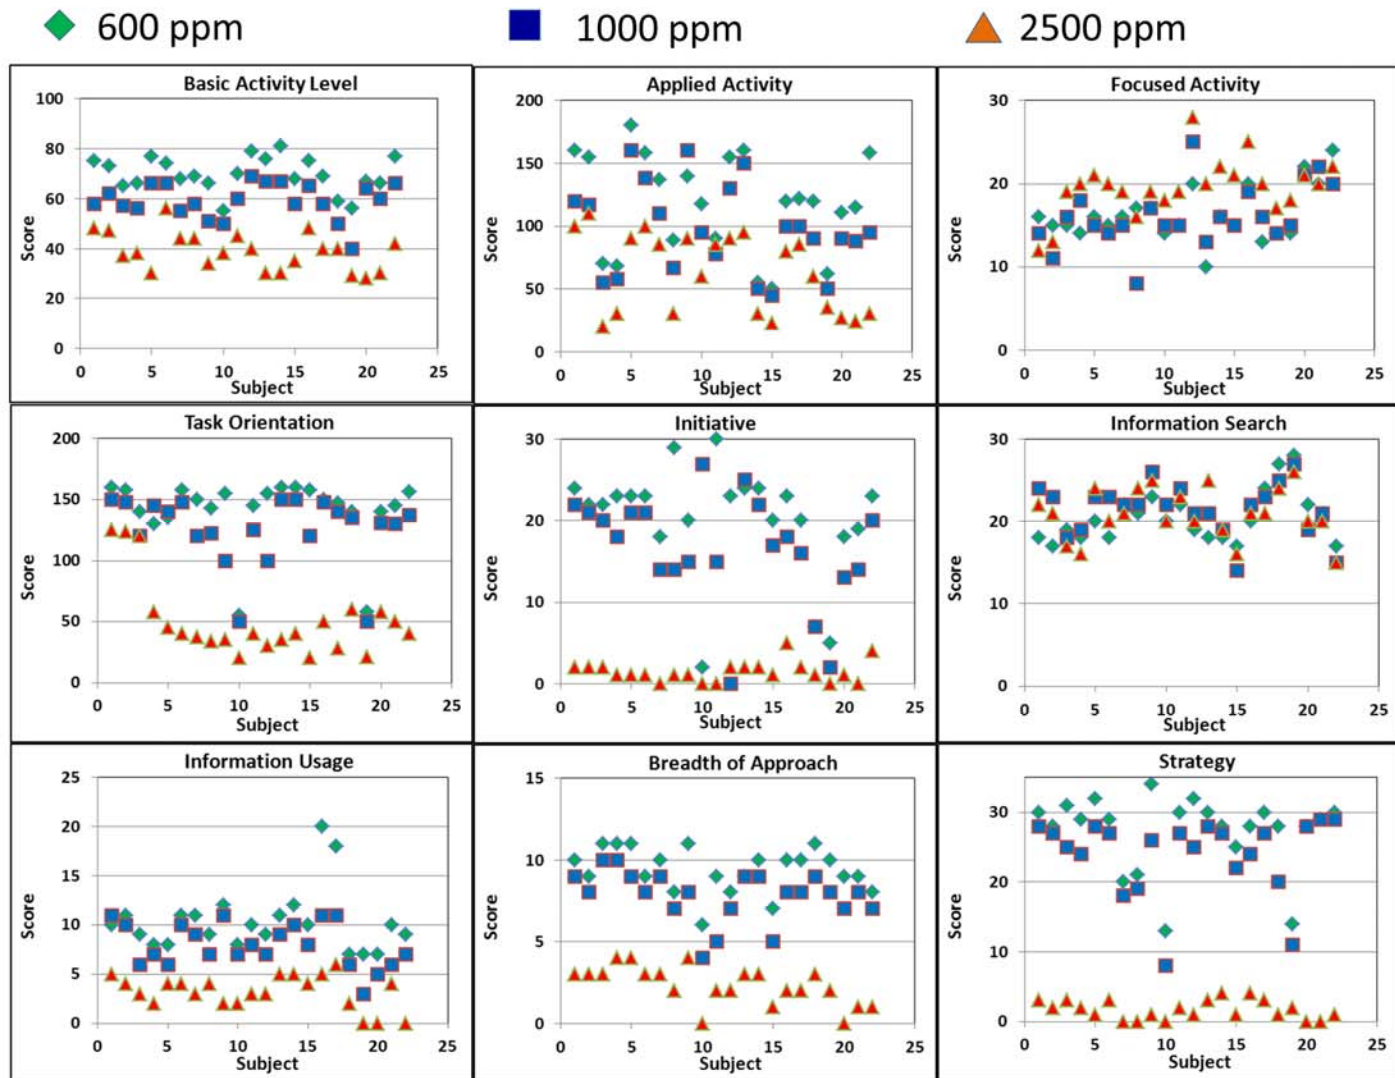

1  
2  
3 **Figure 1. Plots of individual scores, by condition, for each of the SMS measures of decision-making performance**

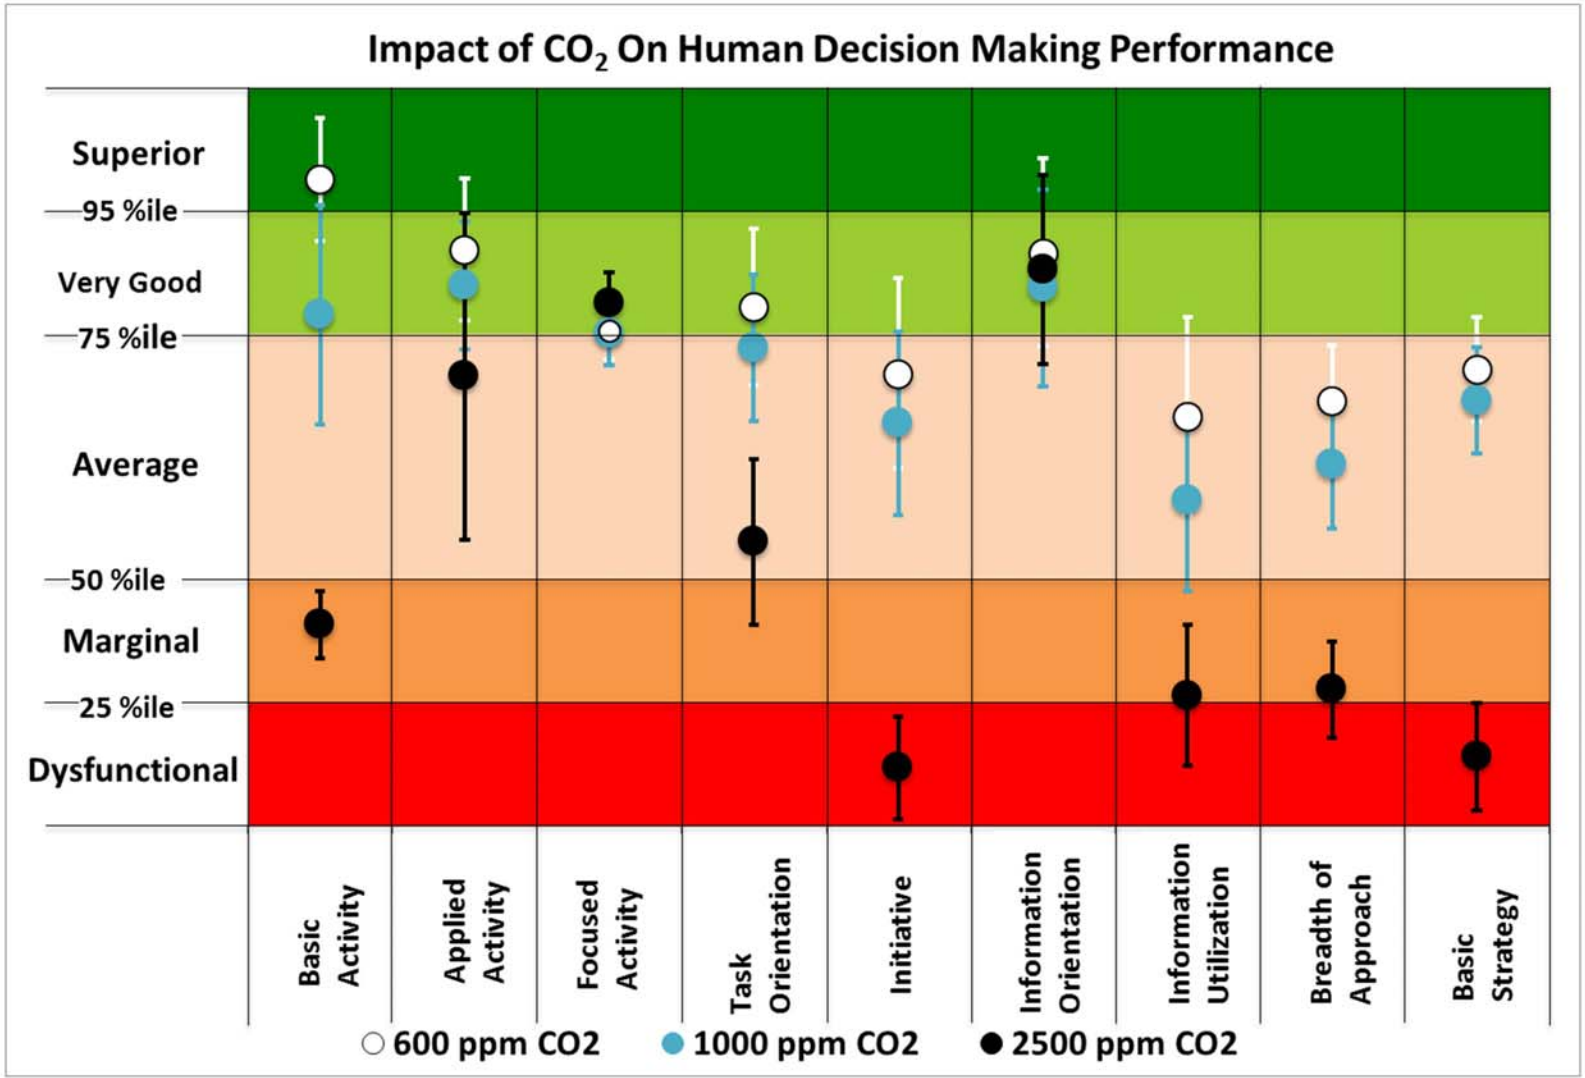

4  
5  
6

Figure 2. Impact of CO<sub>2</sub> on Human Decision-Making Performance. Error bars indicate one standard deviation.