Lawrence Berkeley National Laboratory

LBL Publications

Title

Thin-Triple Windows - Now a Cost-Effective Envelope Trade-Off for High-Performance Homes

Permalink

https://escholarship.org/uc/item/5j21j8td

Authors

Gilbride, Theresa

Cort, Katherine

Hart, Robert

et al.

Publication Date

2026-08-03

Copyright Information

This work is made available under the terms of a Creative Commons Attribution License, available at https://creativecommons.org/licenses/by/4.0/

eScholarship.org Powered by the California Digital Library
University of California

Thin-Triple Windows - Now a Cost-Effective Envelope Trade-Off for High-Performance Homes

Theresa Gilbride, Pacific Northwest National Laboratory
Katherine Cort, Pacific Northwest National Laboratory
Robert Hart, Lawrence Berkeley National Laboratory
Brad Begin, Alpen Windows
Steve Byers, NRG Logic
Karla Butterfield, Steven Winters
March 2026[1]

ABSTRACT

Thin-triple pane windows are coming down in price due to some unprecedented changes in the window manufacturing industry, including the recent expansion in the number of U.S. manufacturing lines producing thin-triple pane windows. These insulating glazing units (IGUs) can provide the performance of a traditional triple-pane window with the thickness of a double-pane IGU, allowing them to drop into double-pane window frames in existing homes. More importantly, U.S. window makers can use them in place of double-pane IGUs in their high-speed production lines, paving the way for lower cost, high-performance windows for high-volume U.S. home builders. This paper will touch on these developments and the U.S. Department of Energy (DOE) research that led to them. Recent energy modeling analyses of single-family and multi-family homes are presented showing how thin triples can be a cost-effective tradeoff against other envelope measures to help builders in mixed and cold regions meet the higher Energy Rating Index (ERI) requirements of recent energy codes. Non-energy benefits of thin triples are also addressed, including resiliency, sound mitigation, condensation control, and comfort sections.

Introduction

Thermal transfer and air leakage through the building envelope make up the largest HVAC loads in most regions, and windows alone are estimated to be responsible for approximately 10% of building energy use (Hart et al. 2019), despite their proportionally small area of the envelope (Figure 1).

[1] DRAFT under review for inclusion in the proceedings of the 2026 ACEEE Summer Study on Energy-Efficiency in Buildings. Please do not reproduce or distribute.

DRAFT

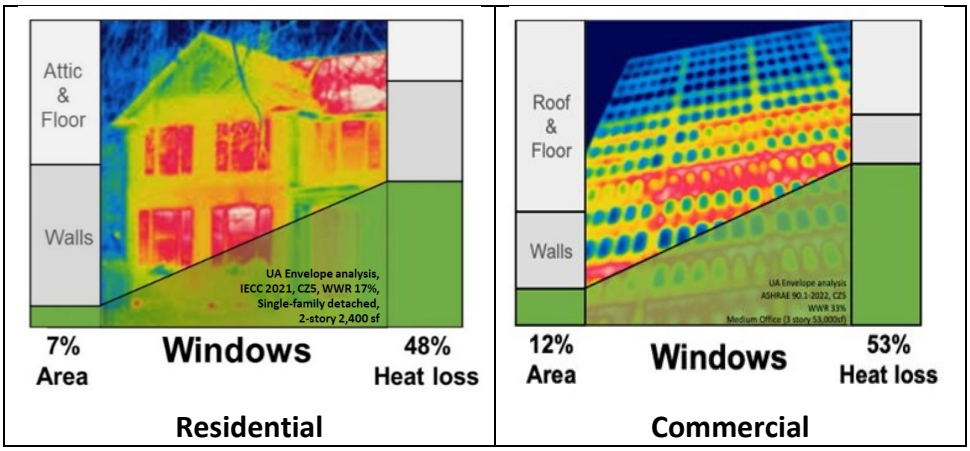


Figure 1. Windows account for nearly half of the heat loss through the envelope in American homes and commercial buildings (Source: Berkeley Lab).

Of all the envelope components, windows have a disproportionate impact on heating and cooling loads and can account for 30–50% of envelope heat loss in a code-minimum home. While a typical code-built home has a wall insulation value of R-20 (U=0.05), most well-performing double-pane windows will have an R-value of 3 or lower (U-value of 0.28 or higher). In a typical 2,000 ft^2 home with windows comprising 15% of the exterior walls, double-pane windows with a U-value of 0.28 would have a UA (U-value x surface area) of 84 UA (UA = total heat loss through the window surface). If high-performance triple-pane U=0.14 windows were installed instead, the UA drops in half to 42 UA (Begin et al. 2025).

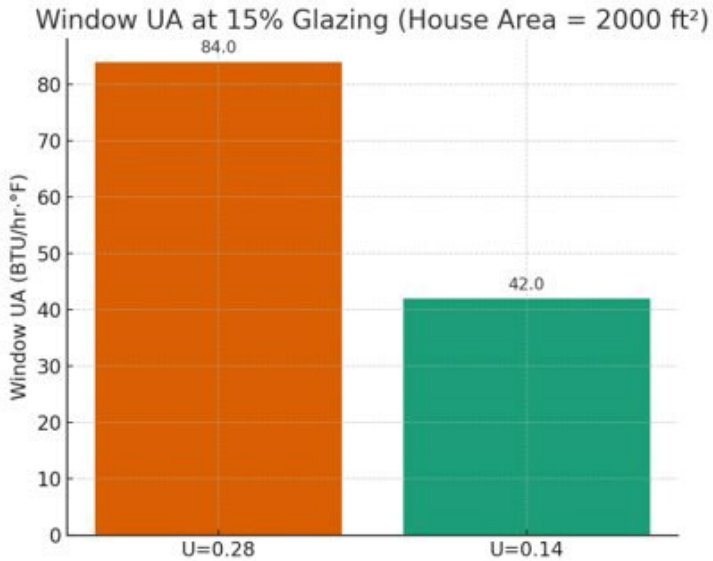


Figure 2. In a typical home with windows comprising 15% of exterior wall area, replacing double-pane U=0.28 windows with high performance triple-pane U=0.14 windows cuts window UA in half. (Byers in Begin, Byers, Sylvestre. 2025 EEBA)

The window industry has been marked by many technological breakthroughs in the 20th century that each helped to foster dramatic change in the industry, contributing to more

DRAFT

affordable and efficient window products for consumers. Four of the most prominent are described below and their adoption level shown in Figure 3 (Begin et al. 2025):

1. **Invention of the Float Glass Process** – by Pilkington in 1959, dramatically increased the size of glass sheets that could be produced, making it much faster and cheaper to manufacture large amounts of glass at one time, thus making window glass much more available and affordable. After licensing for the U.S., Europe, and Japan in 1965, the float glass process soon dominated the industry, capturing 90% of all glass production by 1980.
2. **Transition from Single- to Dual-Pane Insulated Glass Units** – the invention of the float glass process made the next big transformation – from single-pane to double-pane windows – economically feasible. Between 1970 and 2010, double-pane windows went from 10% of window sales to 90% of all window sales in the U.S. market.
3. **Commercialization of Low-e Coatings on Glass** – The third big innovation was the addition of low-emissivity coatings on window glass. Starting in 1980, IGUs with low-e coating grew to 75% of the market by 2010.
4. **Rise of Vinyl Windows** – The use of vinyl (uPVC) window frames also had a mercurial rise – going from 1% of the market in 1975 to 63% of the market by 2010.

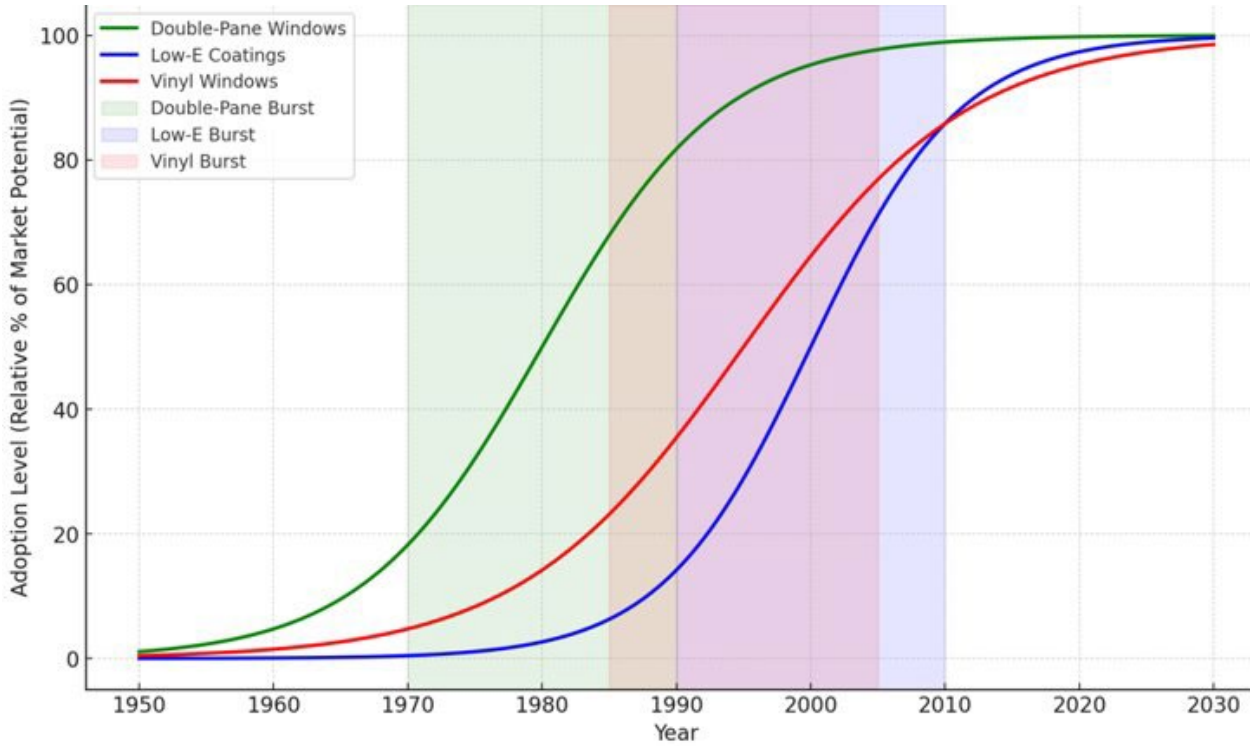


Figure 3. Breakthrough innovations in the window manufacturing industry spurred transformative changes in the 1960s -2000's but innovation has slowed in the past 10 years.

These four innovations caused dramatic changes in window manufacturing from the 1950s to the 2010s. However, there have been no radical breakthrough technologies in the window industry for the past decade or more. While triple-pane windows and vacuum insulated glass (VIG) hold the promise of significant performance improvements, there has been no notable uptick in sales

DRAFT


of either technology as a share of the U.S. window market. As of 2023, triple-pane windows made up less than 5% of sales, a number that hasn't changed much since at least 2010 (Selkowitz 2023; Hart et al. 2019).

Is the window industry poised for a triple-pane breakthrough?


Thin-Glass IGU Technology

Previous Barriers to Triple Pane Installation

Triple-pane windows have been around for decades, but their use has been minimal in the United States. A series of market analyses and builder interviews conducted by researchers as Pacific Northwest National Laboratories (PNNL) confirmed that uptake has been hampered by several factors – builders felt they were too expensive, too hard to find, too heavy, and too wide (Cort and Gilbride 2019; Gilbride et al. 2019). Width of the windows has been a significant issue for two reasons. The width of a typical triple-pane window plus sash can be 5 or more inches. This exceeds the width of the 2x4 exterior walls that was typical of homes built throughout the country before recent advances in building energy codes and is still common in warmer regions (Cort and Gilbride 2019; Gilbride et al. 2019). The width of a typical triple-pane IGU can be up to 1-3/8 inches while double-pane IGUs of 3/4-inch width are common. For window manufacturers (those who purchase IGUs and make the sash and frame packages to go around them), their assembly lines would need to be retooled to accommodate the wider triple-pane IGUs. Window makers are reluctant to do that retooling unless there is a demonstrated sizable demand for the product, so they are hesitant to advertise the fact that they can produce them. That lack of advertising, and concurrent lack of information provided by manufacturers regarding triple-pane window performance specifications and pricing, has contributed to a lack of demand by builders (Cort et. al. 2024).

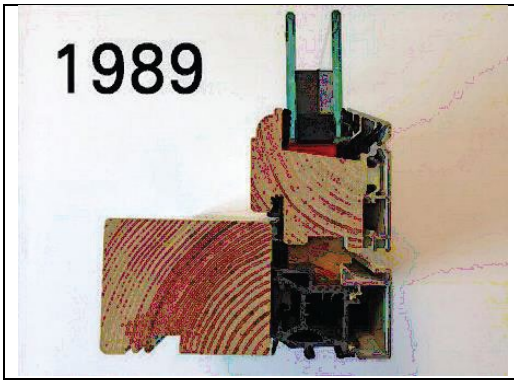

Conventional double-pane wood-framed windows have a 3-inch sash

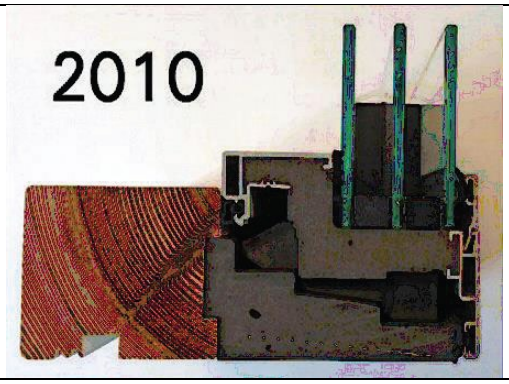

European typical triple-pane windows have a 5-inch sash.

Figure 4. Typical triple-pane windows use three typical-thickness glass panes (1/8-inch, 3 to 4 mm) separated by ½-inch gaps filled with air or argon gas and a total insulated glazing unit width of 1-1/4 inch to 1-3/8 inch (25 to 35 mm), while a typical double-pane window has an IGU width of 3/4 to 7/8 inch (19 to 28 mm).

Thin Triple Technology Development

DRAFT

Could thinner triple-pane windows be the answer? In the 1980s, some window manufacturers began experimenting with a "suspended film" process developed by Southwall Technologies that consisted of stretching a sheet of plastic between two panes of glass to create a third layer. In 1989, researchers at Berkeley Lab filed a US Statutory Invention for a "thin triple-pane" window that used a non-structural thin pane sandwiched between two typical thickness glass panes. The thin center pane was held in place with clips and the gaps on either side of the center pane were filled with krypton gas, creating an IGU that was thinner than a typical triple-pane IGU. These ideas were later refined in a 2008 paper by Arasteh et al. to validate the performance of non-structural center layers without hermetic seals at the perimeter (Arasteh et al. 2008). Commercialization stalled because there was no economically viable center pane at the time.

Since then, several factors have come into play to make thin-triple-pane windows more available and affordable. The thin glass (<=1mm) manufacturing industry has expanded dramatically, going through a transformation akin to the float glass transformation of the 1900s. Innovations in thin glass manufacturing from the 1980s to the 2020s have increased the size of thin glass sheets that can be produced from 2 ft^2 to as much as 103 ft^2. These advances, spurred on by the burgeoning cell phone and flat screen TV markets, have brought the price down while dramatically increasing the availability of thin glass, making use of thin glass in a thin triple-pane window much more economically feasible (Begin et al. 2025).

Thin triple IGUs typically consist of two typical-thickness (1/8-inch, 3 mm) sheets of glass on the outsides, a thin center pane 0.5 to 1.6 mm thick, warm-edge spacers to support the center pane, and krypton or argon gas to fill the sealed cavities between the center pane and outer panes. Krypton allows for thinner cavities than argon without impacting thermal performance.

These two improvements, the use of thin glass for the center pane and the use of krypton rather than argon for the gas fill, have made possible a product that has the potential to transform the window industry again – a thin-triple IGU that can perform as well as a typical-width triple-pane window while fitting into the same frame as a double-pane window. This removes a major industry impediment – concerns about retooling frame manufacturing lines to accommodate the wider typical triple-pane IGUs – and opens the way to the production of thin-triples in the industry (Hart et al. 2019).

Thin Triple Performance

From a manufacturing performance standpoint, the exterior and interior glass panes used to make thin-triples can be identical to those used in typical double-pane windows, which IGU manufacturers have on hand, so only the thin glass and krypton are not already in their supply chains. Some window manufacturers make their own IGUs and frames. Many window makers buy their IGUs from one of three large U.S. IGU manufacturers. If these IGUs are thin triples, they will fit into window manufacturers' typical double-pane frames with no retooling of production lines (Hart et al. 2020).

In terms of the thin triples' thermal performance, it's worth noting that, unlike wall insulation, window thermal performance is often stated in U-factor which is a measure of the overall window heat transfer (Btu/hr·ft^2·F), rather than in R-value (resistance to heat flow). R-value is the inverse of U-value, so a triple-pane window with an R value of R-5 would have a U-factor of 0.20 (0.20 = 1/5). These properties account for the performance of the window construction (glass, spacer, sash/frame) and the air films on the indoor and outdoor surfaces.

DRAFT

The thermal performance for thin triple-pane fixed picture windows that have been certified by the National Fenestration Rating Council (NFRC) and are available in today's market ranges from a U-factor of U-0.20 to U-0.14, which is on par with typical triple panes (e.g., IGU width of 1-1/4 in, to 1-3/8 in.) and is a significant performance improvement over the traditional double pane low-e fixed picture window, rated with U-factor of 0.30-0.27 (Hart et al. 2020).

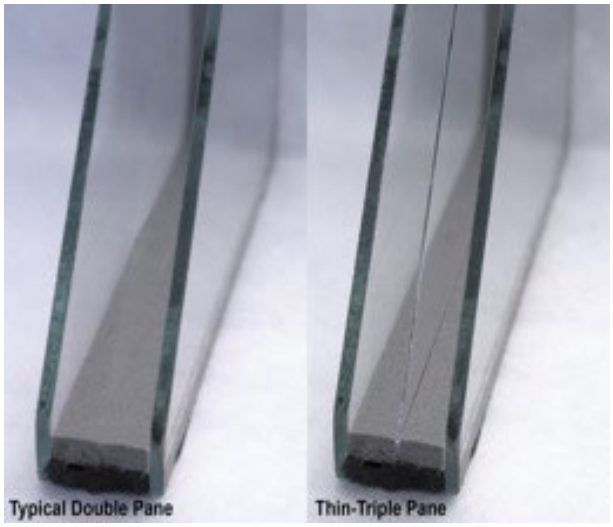


Figure 5. Thin-triple IGU technology utilizing thin glass as a non-structural center layer enables raising of IGU thermal performance from R-5 to R-8 hr ft2 °F/Btu. Source: LBNL.

High-Performance Homes

The performance gains that triple-pane windows provide have become increasingly beneficial to builders as residential building codes and above-code home certification programs like ENERGY STAR Certified Homes and the U.S. Department of Energy's Efficient New Homes (DENH) program encourage higher-performing building envelopes. While the minimum U-values listed in the latest version of the International Energy Conservation Code (IECC 2024) range from 0.50 for climate zone 1 to 0.27 for CZ can be met with double-pane windows, the minimum value for northern regions in the most recent version of ENERGY STAR is U= ≤ 0.22, a value that is challenging to find in a double-pane window product. (ENERGY STAR does allow U-factors of 0.23 to 0.26 for windows with solar heat gain coefficients of ≥ 0.35 to 0.40.) (ENERGY STAR Version 7.0). And more importantly, from a compliance standpoint, many builders are following performance paths rather than prescriptive paths to compliance with the building energy codes and above-code programs. These performance paths require builders to compute the total conductance of the building envelope by multiplying the U factors of each of the individual components of the proposed building envelope by their area and summing the total or by running an energy model to determine total envelope and comparing that to a target home total Energy Rating Index (ERI) calculated based on compliance with prescriptive measures.

DRAFT

In seeking to reduce their total ERI scores, builders are realizing that windows are typically the poorest performing component of the building envelope and upgrading to higher performing thin-triple windows might be an easy way to improve overall envelope performance. Thin-triple windows require no adjustments to home designs developed for double-pane windows. Using higher performing windows to achieve overall envelope performance may also help builders avoid other more challenging modifications to typical construction practices to accommodate higher insulation values in other building components. Do the data back up these assumptions?

Tradeoff Analysis

A tradeoff analysis was conducted using Ekotrope. Two home energy raters conducted the analyses using real homes and apartments that had been previously modeled for home certifications in climate zones 4 and 5 in Connecticut and Colorado. Various scenarios were run to show tradeoffs, using a home built with 2021 IECC prescriptive envelope requirements as the baseline. The Connecticut rater ran two of each building type with six window performance levels and five envelope tradeoff scenarios. The tradeoff scenarios were as follows:

- Keep 2021 IECC prescriptive envelope requirements and change window performance only.
- Change window performance and remove continuous exterior wall insulation.
- Change window performance and decrease foundation insulation.
- Change window performance and decrease ceiling insulation.
- Change window performance, remove continuous exterior wall insulation, decrease ceiling insulation, and decrease foundation insulation.
- Change window performance, remove continuous exterior wall insulation, decrease ceiling insulation, and decrease foundation insulation.

The window performance levels that were analyzed included ENERGY STAR V7 windows, windows that met DENH V2, and windows with U values of U-0.20, U-0.14, and U-0.10. For simplicity, only the U-0.20 (R-5) window scenarios will be shown here. The total building UA for one baseline single-family home and each scenario are shown in Tables 1 and 2. Similar scenarios were run for two multifamily buildings in climate zones 4 and 5, including an analysis of the whole building and analyses of a single top floor, midfloor, and bottom floor apartment unit in each building. Results of the analysis of one whole multifamily building and one top-floor unit are shown in Tables 3 and 4. The percents by which each scenario exceeded or fell short of the baseline (a building with envelope measures specified to the 2021 IECC) are shown in green for “performed-better-than” and red for “performed-worse-than” the baseline. It should be noted that nearly all of the scenarios that fell short of the 2021 IECC included a ceiling insulation tradeoff that dropped the ceiling R value from R-60 to R-29. R-29 was selected because that is a common R-value for ceiling cavity insulation for a cathedral ceiling. This does not take into account other ways a builder might increase cathedral ceiling R values, such as using spray foam rather than fibrous insulation or using rigid foam layers above the roof deck.

DRAFT

Table 1. Comparison of tradeoffs including reduced ceiling, exterior wall, and foundation insulation when code-compliant double-pane windows are replaced with U-0.20 (triple-pane) windows in a single-family home in climate zone 4.

Single-Family Home A (CZ 4)							
Metrics	**2021 IECC**	**U-0.20**	**U-0.20 + <Wall ci**	**U-0.20 + <Foun-dation**	**U-0.20 + <Ceiling**	**U-0.20 + <Wall ci + <Foundation**	**U-0.20 + <Ceiling <Wall ci + <Foundation**
Ceiling R	60	60	60	60	29	60	29
Wall R (cavity)	20	20	20	20	20	20	20
Wall R (continuous)	5	5	0	5	5	0	0
Window U	0.3	0.2	0.2	0.2	0.2	0.2	0.2
Door U	0.3	0.3	0.3	0.3	0.3	0.3	0.3
Floor R	0.033	0.033	0.033	0.033	0.033	0.033	0.033
Foundation Wall R	R10	R10	R10	R5	R10	R5	R5
Slab R, depth	R10, 4v	NA	NA	NA	NA	NA	NA
Building UA	**545.9**	**444**	**497**	**486**	**468.3**	**536.8**	**561.1**
vs. 2021 IECC	-	-19%	-9%	-11%	-14%	-2%	2.8%
Heating Load (kBtuh)	**38**	**33**	**35**	**34**	**34**	**37**	**38**
Cooling Load (kBtuh)	**27**	**27**	**27**	**27**	**27**	**27**	**27**

DRAFT

Table 2. Comparison of tradeoffs including reduced ceiling, exterior wall, and foundation insulation when code-compliant double-pane windows are replaced with U-0.20 (triple-pane) windows in a single-family home in climate zone 5.

Single-Family Home A (CZ 5)							
Metrics	**2021 IECC**	**U-0.20**	**U-0.20 + <Wall ci**	**U-0.20 + <Foun-dation**	**U-0.20 + <Ceiling**	**U-0.20 + <Wall ci + <Foundation**	**U-0.20 + <Ceiling + <Wall ci + <Foundation**
Ceiling R	60	60	60	60	29	60	29
Wall R (cavity)	20	20	20	20	20	20	20
Wall R (continuous)	5	5	0	5	5	0	0
Window U	0.3	0.2	0.2	0.2	0.2	0.2	0.2
Door U	0.3	0.3	0.3	0.3	0.3	0.3	0.3
Floor R	0.033	0.033	0.033	0.033	0.033	0.033	0.033
Foundation Wall R	R15	R15	R15	R5	R15	R5	R5
Slab R, depth	R10, 4v	NA	NA	NA	NA	NA	NA
Building UA	**539.8**	**437.9**	**485.4**	**485.4**	**462.2**	**532.9**	**557.2**
vs. 2021 IECC	-	-18.9%	-10.1%	-10.1%	-14%	-1.3%	3.2%
Heating Load (kBtuh)	**44**	**38**	**41**	**41**	**39**	**44**	**45**
Cooling Load (kBtuh)	**30**	**29**	**30**	**30**	**29**	**30**	**30**

Table 3. Comparison of tradeoffs including reduced ceiling, exterior wall, and foundation insulation when code-compliant double-pane windows are replaced with U-0.20 (triple-pane) windows in a whole multifamily building in climate zones 4 and 5.

Multifamily, Whole Building A		**CZ 4**				**CZ 5**			
Metrics	**2021 IECC**	**U-0.20**	**U-0.20 + <Wall ci**	**U-0.20 + <Ceiling**	**U-0.20 + <Ceiling + <Wall ci**	**U-0.20**	**U-0.20 + <Wall ci**	**U-0.20 + <Ceiling**	**U-0.20 + <Ceiling + <Wall ci**
Ceiling R	60	60	60	29	29	60	60	29	29
Wall R (cavity)	20	20	20	20	20	20	20	20	20
Wall R (continuous)	5	5	0	5	0	5	0	5	0
Window U	0.3	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Door U	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.3	0.3
Floor R	0.033	0.033	0.033	0.033	0.033	0.033	0.033	0.033	0.033
Foundation Wall R	R10/R15	R10	R10	R10	R10	R15	R15	R15	R15
Slab R, depth	R10, 4v	NA	NA	NA	NA	NA	NA	NA	NA
Building UA	**2618**	**2238**	**2517**	**2388**	**2667**	**2238**	**2517**	**2388**	**2667**
vs. 2021 IECC		-14%	-4%	-9%	1.9%	-15%	-1%	-9%	1.9%

DRAFT

Table 4. Comparison of tradeoffs including reduced ceiling and exterior wall foundation insulation when code-compliant double-pane windows are replaced with U-0.20 (triple-pane) windows in one top-floor unit of a multifamily building in climate zones 4 and 5.

Multifamily Building A, Top Floor Unit		**CZ 4**			**CZ 5**		
Metrics	**2021 IECC**	**U-0.20**	**U-0.20 + <Wall ci**	**U-0.20 + <Ceiling + <Wall ci**	**U-0.20**	**U-0.20 + <Wall ci**	**U-0.20 + <Ceiling + <Wall ci**
Ceiling R	60	60	60	29	60	60	29
Wall R (cavity)	20	20	20	20	20	20	20
Wall R (continuous)	5	5	0	0	5	0	0
Window U	0.3	0.2	0.2	0.2	0.2	0.2	0.2
Door U	0.3	NA	NA	NA	NA	NA	NA
Floor R	0.033	NA	NA	NA	NA	NA	NA
Foundation Wall R	R10/R15	NA	NA	NA	NA	NA	NA
Slab R, depth	R10, 4v	NA	NA	NA	NA	NA	NA
Building UA	**87.1**	**75.4**	**84**	**87.8**	**75.4**	**84**	**87.8**
vs. 2021 IECC		-13%	-3.6%	0.8%	-13%	-4%	0.8%
Heating Load (kBtuh)	**7**	**7**	**7**	**7**	**7**	**7**	**8**
Cooling Load (kBtuh)	**6**	**6**	**6**	**6**	**6**	**6**	**6**

The Colorado rater ran three scenarios in climate zone 5 – a single-family home over an unconditioned crawlspace, an end-unit two-story townhome over a conditioned crawlspace, and a two-story townhome over a walk-out basement. He modeled each home five ways: 2021 IECC Prescriptive, 2018 IECC, Energy Star V 3.2, DENH V2, and 2021 IECC with U-0.20, U-0.14, and U-0.10 windows, allowing tradeoffs for exterior wall insulation, foundation insulation, and ceiling insulation. For simplicity, only the tradeoffs for U-0.20 are shown in Table 5 below.

DRAFT

Table 5. Comparison of three Colorado homes modeled to the 2021 IECC and then with a triple-pane windows, allowing envelope tradeoffs (shown in gold).

Metrics	1- Single-Family, Crawlspace		2 - Townhome, Conditioned Crawlspace		3 - Townhome, Walkout Basement	
	2021 IECC Prescriptive	**U-value = 0.20**	**2021 IECC Prescriptive**	**U-value = 0.20**	**2021 IECC Prescriptive**	**U-value = 0.20**
Windows	U-0.32, SHGC-0.40	U-0.20, SHGC-0.30	U-0.32, SHGC-0.40	U-0.20, SHGC-0.30	U-0.32, SHGC-0.40	U-0.20, SHGC-0.30
Exterior Doors	U-0.20	U-0.20	U-0.20	U-0.20	U-0.20	U-0.20
Roof Deck	NA	NA	NA	NA	NA	NA
Flat Ceiling	R60	R60	R60	R49	R60	R60
Exterior Knee Wall Insulation	NA	R21	NA	NA	NA	NA
Exterior Wall Cavity Insulation (2x6)	R20 + R5 ci	R21	R20 + R5 ci	R21	R20 + R5 ci	R23
Floors over unconditioned space	R30	R30	R30	R30	R30	R30
Slab insulation (on grade)	NA	NA	NA	NA	R10, 4v	R10, 4v
Crawl Foundation Wall	NA	NA	15	NA	NA	NA
Finished Bsmnt Wall	NA	NA	NA	NA	R19	R19
Unfinished Bsmnt Wall	R15	R15	R19	R19	NA	NA
Rim Joist Insulation	R30	R30	R30	R30	R30	R30
UA Compliance, % above	7%	16%	8%	16%	5%	11%
HERS	56	48.99	51	48.8	55	47
ES V3.2 HERS Target	55	55	51	51	53	53
DOE ZERH V2 HERS Target	49	49	49	49	47	47
Window U-Values are at 4k+ ft. Door U-values are all 0.20 which is the Energy Logic default value.						

Note that once a home is constructed, insulating envelope and window retrofits are rarely made; thus, one could argue that any tradeoff made away from enhanced envelope insulating measures at the time of construction is likely an opportunity lost over a significant portion of the life of building. This tradeoff analysis is meant to highlight the value added from high-performance windows in a high-performance design, and is not necessarily recommended as a course of action.

Other Considerations (Co-Benefits)

Home builders in a survey of DENH builders by PNNL (Gilbride et al. 2019) identified several factors influencing their decisions to purchase and install double or triple-pane windows. Of the DENH builders surveyed, 41% use all triple-pane windows and another 28% install triple-pane windows in most or some of their homes. This corresponds to data collected on all DENH Housing Innovation Award participants in 2013-2019 (100 builders), where 39% of builders

DRAFT

reported using triple-pane windows. The builders were asked to identify what benefits they saw in triple-pane windows other than energy-savings. Their responses are shown in Figure 6.

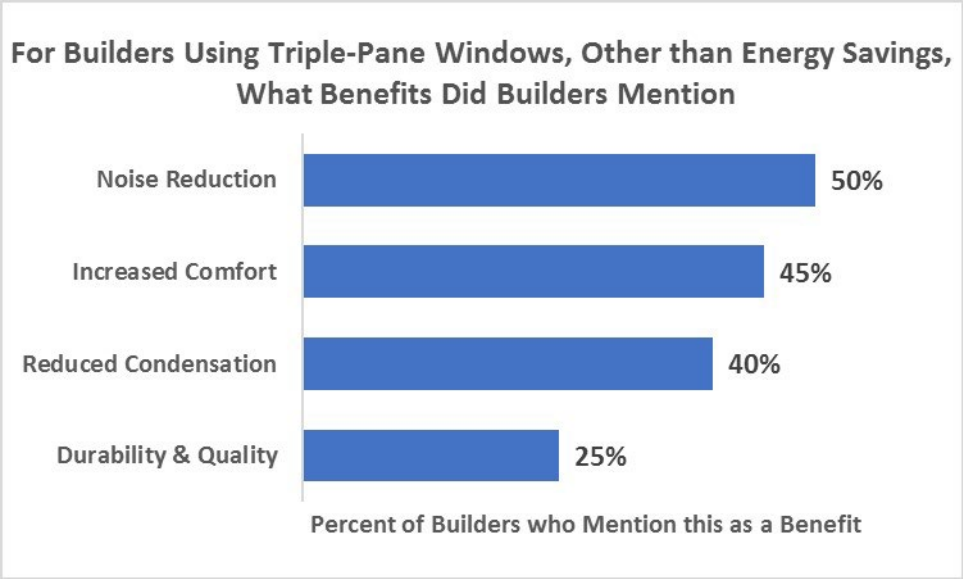


Figure 6. Benefits Builders Mention for Triple-Pane Windows (Gilbride et al. 2019, rev 2023, double vs triple)

Acoustic Control

In addition to the added thermal performance, the thin triple-pane windows demonstrated significant acoustic benefits, reducing sound infiltration by 8 dB to 10 dB in a side-by-side PNNL Lab Home study that measured dB sound infiltration through triple-panes in comparison to double panes (Hunt et al. 2021). An 8 to 10-decibel reduction is perceived as cutting the sound level in half[2] and in a 2019 survey of high-performance home builders, the most prevalent secondary reason that builders gave for using triple-pane windows was noise reduction (See Figure 6). Some builders mentioned homebuyers specifically asking for triple-pane windows for their sound-deadening effects. One builder who constructs urban infill homes commented, "We are building homes next to Boeing Field Airport in Seattle. Planes are flying right overhead so close you can clearly see them from the houses, and it is so quiet inside you can't hear them" (Gilbride et al. 2019).

Comfort

Comfort was cited by many builders as a reason they installed triple-pane windows. Temperature-related comfort issues are a common source of homeowner complaints and call-backs in new construction. Even when there are no actual drafts caused by air leakage around the windows, home occupants sitting or standing next to a double- or single-pane window on a cold winter day may feel the sensation of a cold draft. This can be due to radiant heat flow from their body toward the cold window and/or due to convective heat flow near the window caused by

[2] It has been established that a 6 dB to 10 dB reduction in sound level generally results in an individual's perception of sound being reduced by half (Warren 1973).

DRAFT

temperature differences between the room air and the cold window surface. Many builders and homeowners have reported that they don't sense this cold air feeling near triple-pane windows. "You can stand in front of these [triple-pane] windows and not feel any difference in temperature from the center of the house," said one upper Midwest builder. A Colorado builder reported, "You can stand next to a triple-pane window on a 1-degree day in a t-shirt. It's too cold for that with a double-pane window," (Gilbride et al. 2019).

Condensation Control

A field study conducted by PNNL in Helena, Montana, in late winter compared the condensation and ice buildup on a window before and after replacement of the original double-pane, vinyl-framed window with thin triple-pane fiberglass-framed windows. As can be seen in Figure 7, condensation and ice buildup were completely eliminated after triple planes were installed (Gunderson et al. 2024).



Figure 7. Helena, MT field study, March 2021. Left: double-pane, vinyl framed window shows condensation and ice buildup. Right: Same location after replacing double-pane with thin triple-pane fiberglass-framed window, shows zero condensation and ice buildup.

One Habitat for Humanity builder in Michigan said performance and condensation were the reasons his affiliate switched from double- to triple-pane windows. "We used to use double-pane windows but we would get so much condensation, we would literally see rotting of the wood sills and the drywall around the windows, as well as frost on the inside face of the windows and mold on the walls. Since we started installing triple-pane windows, there is zero condensation on the windows, even when it's zero degrees outside and high humidity inside," (Gilbride et al. 2019).

HVAC Impacts

Builders have commented that they can reduce HVAC sizes when they use triple- rather than double-pane windows, to under 2 tons (<22,000 BTU) for homes up to 3,000 ft2. They also commented that they can simplify duct runs by having throws from interior walls or switch from central ducted systems to ductless minisplit systems (Gilbride et al. 2019). Two builders provided data on the impact that switching from double-pane to triple-pane windows had on their HVAC heating load (Table 6). Four homes in Michigan and five homes in Washington were

DRAFT

modeled in REM/Rate were modeled first with double-pane then with triple-pane windows. Heating load reductions of 6% to 17% were achieved by switching to triple-pane windows.

Table 6. Space heating design load reductions due to use of triple-pane instead of double-pane windows in homes built in Michigan and Washington State

House	Double-Pane		Triple-Pane		HVAC Heating Load Reduction
	U-Value	Btu Design Space Heating Load	U-Value	Btu Design Space Heating Load	
MI 1 (Springmont), 900 ft^2	0.31	15,937	0.21	14,942	6%
MI 2 (Denner/Trimble), 1,100 ft^2	0.32	13,191	0.21	12,309	6%
MI 3 (Cedar), 1,200 ft^2	0.32	13,401	0.21	12,435	7%
MI 4 (Gateway), 1,000 ft^2	0.44	22,209	0.21	18,357	17%
WA 1 (16^{th} Ave) 2,730 ft^2	0.27	16,600	0.20	14,400	13%
WA 2 (MLK) 1,057 ft^2	0.27	9,100	0.20	8,200	10%
WA 3 (33^{rd} Ave) 2,635 ft^2	0.27	17,700	0.20	15,900	10%
WA 4 (42^{nd} Ave) 2,595 ft^2	0.27	13,800	0.20	12,200	12%
WA 5 (Flora Ave) 2,646 ft^2	0.27	21,600	0.20	18,800	13%

Conclusion

Triple-pane windows provide an attractive tradeoff to other envelope measures for meeting today's higher performance criteria. Advances in thin glass technology have made feasible the high-volume production of thin-triple pane IGUs. Thin-triple windows offer many of the advantages of traditional triple-pane windows, such as thermal performance, sound abatement, and condensation reduction, without the barriers of traditional triple-pane windows, such as width, weight, and installation challenges. Every large residential window manufacturer now has some has some version of a "lightweight" triple pane product available in one or more product lines. At least one large IGU maker produces thin-triple IGUs. The product is now readily available. Will there be a leap in uptake?

References

Arasteh, Dariush K, Howdy Goudey, and Christian Kohler. 2008. "Highly Insulating Glazing Systems using Non-Structural Center Glazing Layers." 2008 Annual ASHRAE Meeting.

Begin, Brad, Steve Byers and Steve Sylvestre. 2025. "Scaling Up Affordable Triple-Pane Windows," presentation at the Energy & Environmental Building Alliance (EEBA) High Performance Home Summit, September 18, 2025, Saint Paul, Minnesota.

Cort, K.A., T. Gilbride. 2019. *Field Validation of High-R Windows: Market Assessment and Program Plan.* July 10, 2019. Pacific Northwest National Laboratory. PNNL-28823. https://www.osti.gov/servlets/purl/1558104/.

Cort K.A., I. Smith, and W. Zalis. 2024. *PAWS High-Performance Window Match-Making Meeting at EEBA Summit: Results and Next Steps.* October 10, 2024. Pacific Northwest

DRAFT

National Laboratory. PNNL-SA-207478. https://paws.energy/wp-content/uploads/2025/05/PAWS-2024-EEBA-Meeting-Results.pdf.

Gilbride TL, S Selkowitz, OG Dingus, and KA Cort. 2019. *Double or Triple? Factors Influencing the Window Purchasing decisions of High-Performance Builders.* PNNL-28809, Pacific Northwest National Laboratory. https://www.osti.gov/servlets/purl/1557862.

Gunderson, P., Louie, E., & Cort, K. (2024). "Laboratory and field validation of the performance benefits and costs of thin triple-pane windows in residential buildings." *Science and Technology for the Built Environment,* 30(7), 767–784. https://doi.org/10.1080/23744731.2024.2357529.

Hart R, S. Selkowitz, and C. Curcija. 2019. "Thermal performance and potential annual energy impact of retrofit thin-glass triple-pane glazing in US residential buildings." *Build Simulation.* 12: 79–86.

Hart R, S Selkowitz S, M Lafrance, K Cort, M Shirakh, J Jennings. 2020. "Performance Insulating Windows." *In Proceedings of the 2020 ACEEE Summer Study,* August 2020.

Hunt, WE, SI Rosenberg, and KA Cort. 2021. *Evaluation of Thin Triple-Pane Windows in the PNNL Lab Homes.* PNNL-31165. April 2021. Pacific Northwest National Laboratory, https://www.osti.gov/servlets/purl/1811300.

Selkowitz, S. 2023, "Study of High-Performance Windows Incremental Manufacturing Cost. Northwest Energy Efficiency Alliance (NEEA), January 3, 2023. Portland, Oregon.

Warren RM. 1973. "Quantification of Loudness." *American Journal of Psychology* 86(4): 807-825.

Acknowledgement: This work was supported by the U.S. Department of Energy under Contract No. DE-AC02-05CH11231.

DRAFT