

# Lawrence Berkeley National Laboratory

## LBL Publications

### **Title**

Large Scale Superfluid Practice

### **Permalink**

<https://escholarship.org/uc/item/6h8579rq>

### **Authors**

Caspi, S

Taylor, C

Gilbert, W S

et al.

### **Publication Date**

1982-07-01

c.2



# Lawrence Berkeley Laboratory

UNIVERSITY OF CALIFORNIA

RECEIVED  
LAWRENCE

BERKELEY LABORATORY

## Accelerator & Fusion Research Division

SEP 30 1982

LIBRARY AND  
DOCUMENTS SECTION

Submitted for the American Institute of Chemical  
Engineers CRYO-SYMPOSIA, Los Angeles, CA,  
November 11-14, 1982


### LARGE SCALE SUPERFLUID PRACTICE

S. Caspi, C. Taylor, W.S. Gilbert,  
W. Hassenzahl, J. Rechen and R. Warren

July 1982

### TWO-WEEK LOAN COPY

*This is a Library Circulating Copy  
which may be borrowed for two weeks.  
For a personal retention copy, call  
Tech. Info. Division, Ext. 6782.*

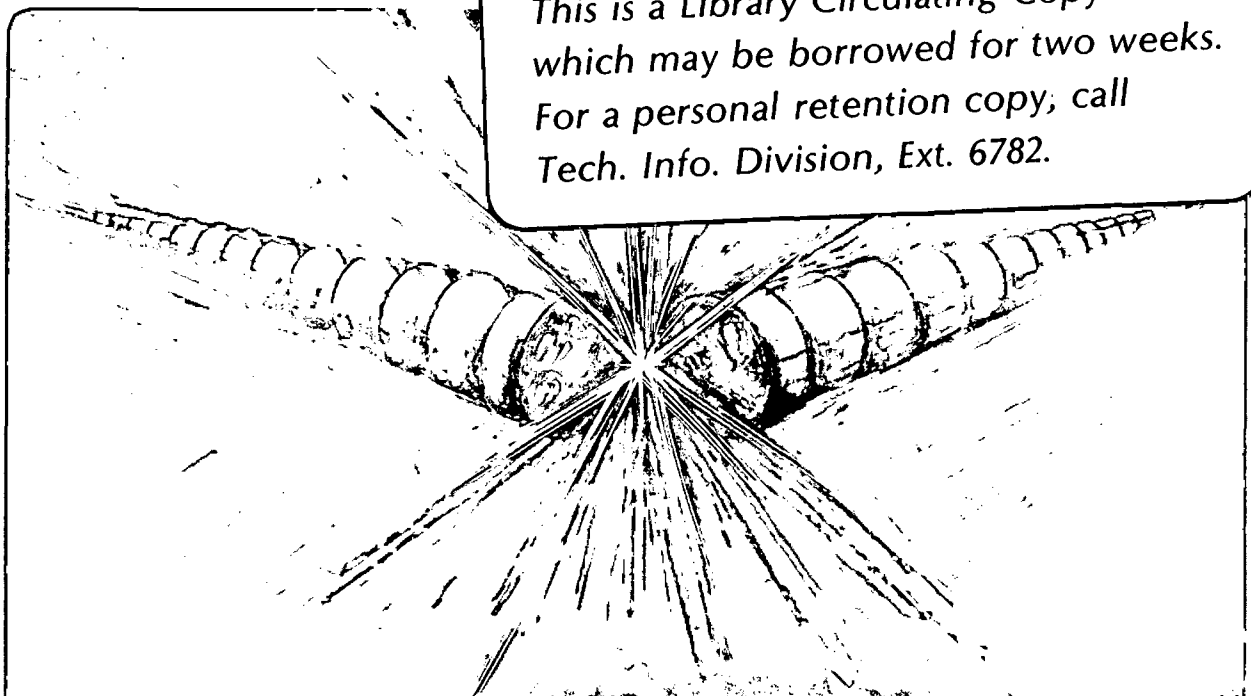

LBL-14746  
c.2

## DISCLAIMER

This document was prepared as an account of work sponsored by the United States Government. While this document is believed to contain correct information, neither the United States Government nor any agency thereof, nor the Regents of the University of California, nor any of their employees, makes any warranty, express or implied, or assumes any legal responsibility for the accuracy, completeness, or usefulness of any information, apparatus, product, or process disclosed, or represents that its use would not infringe privately owned rights. Reference herein to any specific commercial product, process, or service by its trade name, trademark, manufacturer, or otherwise, does not necessarily constitute or imply its endorsement, recommendation, or favoring by the United States Government or any agency thereof, or the Regents of the University of California. The views and opinions of authors expressed herein do not necessarily state or reflect those of the United States Government or any agency thereof or the Regents of the University of California.

LARGE SCALE SUPERFLUID PRACTICE\*

S. Caspi, C. Taylor, W. S. Gilbert, W. Hassenzahl, J. Rechen and R. Warren

July 1982

Accelerator and Fusion Research Division  
Lawrence Berkeley Laboratory  
University of California  
Berkeley, California 94720

Presented at the AIChE/CRYO-SYMPOSIA, November 1982

\*This work was supported by the Director, Office of Energy Research, Office of High Energy and Nuclear Physics, High Energy Physics Division, U. S. Dept. of Energy, under Contract No. DE-AC03-76SF00098.

## LARGE SCALE SUPERFLUID PRACTICE\*

S. Caspi, C. Taylor, W.S. Gilbert, W. Hassenzahl, J. Rechen and R. Warren

Lawrence Berkeley Laboratory  
University of California  
Berkeley, CA 94720

## INTRODUCTION

Since 1979 Lawrence Berkeley Laboratory has been testing superconducting magnets in He II. The 1 atm pressure, 1.8 K, He II, test facility, is an integral part of the LBL Research and Development program on high field superconducting dipole magnets for particle accelerators [1]. Some of the experience gained in this facility and the details of its operation are reported here.

## EXPERIMENTAL TEST FACILITY

The dewar is based on the principle of the Claudet bath [2] and provides He II at 1.8 K and 1 atm on a continuous basis. We report here on the dewar in the vertical configuration [3], Fig. 1. The facility was modified recently to accommodate horizontal magnets and a He II volume of up to 400 liters [4].

The vertical dewar consisted of a 28-ℓ He I chamber, a 142-ℓ He II chamber, and a He II refrigeration system. The He I chamber is a heat intercept for the magnet current leads and instrumentation wires, a liquid supply

---

\*This work was supported by the Director, Office of Energy Research, Office of High Energy and Nuclear Physics, High Energy Physics Division, U. S. Dept. of Energy, under Contract No. DE-AC03-76SF00098.

for 1.8 K refrigeration, and an atmospheric pressure intercept for the lower He II reservoir. The tube connecting the two chambers permits mass flow to maintain atmospheric pressure in the lower vessel. During steady state operation, He I at 4.4 K and 1 atm is precooled to about 2.6 K in a counter flow heat exchanger. It then expands through a regulated Joule Thompson valve, and exits at a vapor pressure corresponding to about 1.75 K. Downstream, it exchanges heat with the 1.8 K He II reservoir, then pre-cools the counterflow heat exchanger, and finally exits to a pump.

Seven carbon glass thermometers were placed inside the dewar. In the upper vessel, T2 and T1 were 1 and 10 mm from the bottom respectively. In the lower, He II, reservoir, the sensors were mounted as follows (distances are below the top flange): T3 - 5 mm, T4 - 30 mm, T5 - 365 mm, T6 - 835 mm, and T7 - 1225 mm at the bottom of the dewar. The temperature was measured with an accuracy better than 5 mK below  $T_\lambda$  using an H.P. 9845 data acquisition system.

#### COOLDOWN AND PRODUCTION OF He II

During a typical cooldown the liquid in the region of the heat exchanger reached  $T_\lambda$  (see Fig. 2) approximately three hours after the JT valve was set into operation. During this period, the liquid below the heat exchanger showed good mixing resulting in a temperature difference  $T7 - T5 < 100$  mK. Above the heat exchanger, the liquid was stagnant and the temperature remained near 4.2 K. Temperature sensor T5 was the first to reach  $T_\lambda$  and remained at  $T_\lambda$  until the rest of the liquid in the lower reservoir was cooled to  $T_\lambda$ . The expansion of this "lambda liquid" is gravitationally free and is caused by the heat transfer process at the He I - He II boundary. Helium II expands upwards and downwards but at different rates because of the

different bath temperatures in the two directions. Experimentally when the transition boundary passes a sensor location the measured temperature drops to  $T_\lambda$  and remains constant. The boundary is sharp, sensor T3 does not see the cold boundary approaching until the temperature at T4, which is only 25 mm away, has been at  $T_\lambda$  for some time. We estimate T3 remains around 4 K until the boundary is within 1 mm of the sensor. The boundary is thought to be even sharper than the 3 mm thickness of the sensors. The boundary velocity between sensors T6 and T7 which start at  $T_\infty = 2.2$  K is 2 mm/sec and between sensors T3 and T4 which start at  $T_\infty = 4$  K, is 0.1 mm/sec. These values are typical but depend on the refrigeration power. An estimate on the thickness of the He II - He I boundary layer is reported in Ref. 5.

#### JOULE THOMSON (JT) EXPANSION VALVE

The temperature across the JT valve during cooldown is shown in Fig. 3. The upstream temperature depends on the heat exchange between the incoming He I liquid and the return cold vapor through the counterflow heat exchanger. The downstream temperature usually reflects the equilibrium between temperature and pressure according to the saturation curve. During the initial cooldown period however, for a pressure less than 40 Torr, the downstream temperature remains at  $\sim 2.2$  K regardless of the pressure. This behavior changes when the lower reservoir drops below 2.6 K. At this time the downstream temperature falls abruptly to its equilibrium value of 1.8 K and any change in pressure is immediately reflected in a change in the saturation temperature. Simultaneously the upstream temperature levels off about 2.6 K and, as long as this value is maintained, the overall operation is stable. When the temperature difference across the lower heat exchanger is small (e.g. less than  $\sim 100$  mK) the counterflow heat exchanger cools

further and the temperature upstream of the JT drops abruptly to  $\sim 2$  K. At this temperature the liquid behaves as superfluid and it flows unimpeded through the JT valve. The uncontrolled rush of liquid floods the lower heat exchanger, reduces the cooling efficiency and as a result the system develops a thermal instability. When this happens the JT valve must be shut off so that the heat exchanger dries out and the upstream liquid warms up to He I temperature before cooling can resume.

An undesirable thermal condition can develop under similar circumstances where there is excess refrigeration. When the temperature of the lower reservoir is too low ( $< 1.7$  K) or the temperature difference across the heat exchanger is below  $\sim 100$  mK, the heat flux through the channel connecting the lower and upper vessels is reduced. Accordingly the temperature gradient across the channel is reduced by increasing the effective length from the He II/He I interface to the main He II bath. As result the interface moves up through the tube until it crosses the channel entrance at the bottom of the He I reservoir. A stable layer of cold helium with a temperature  $T_{\lambda-\epsilon}$  is established that draws heat from He I by conduction only (Fig. 2).

#### SUPERLEAK

One of the design goals of the He II test facility was to have a simple procedure for magnet installation before and after each test. This was accomplished by using a breakable seal between all flanges. The application of an epoxy resin seal (50-50 mix of Shell Epon 828 and Versamid 140) was found to be leaktight even though superleaks can develop in He II. This procedure has been used about 30 times and found to be reliable. The only time a superleak was observed was when the membrane of a pressure transducer



developed a superleak. The recorded superleak is shown in Fig. 4 and described below.


The cooldown from 4.4 K proceeded at first with no indication that any leak was present, as indicated by cooldown rate and vacuum. After superfluid was created and propagated throughout the dewar the He II/He I interface finally reached the top of the He II vessel and entered the connecting tube. At this time the superfluid also reached the superleak in the pressure transducer located on the upper flange. The superleak spoiled the vacuum and the gas in the vacuum space cooled the He I vessel and warmed up the lower dewar by convection. This heat leak raised the temperature in the vicinity of the superleak above the lambda temperature and the flow of helium into the vacuum stopped. Slowly the vacuum was pumped to its original value and cooldown resumed at a temperature just above  $T_\lambda$  and continued until superfluid again reached the superleak area. This cycle was recorded for over 3 hours with the lower reservoir temperature oscillating around  $T_\lambda$ . In the time sequence the behavior indicated where the superleak might be and when the pressure transducer was removed the superleak went away. To find such a superleak at room temperature is quite difficult if not impossible and this string of events led to its elimination.

#### CALORIMETRY

The isothermal behavior of superfluid He II and the absence of vapor when it is used at 1 atmosphere provide the means for calorimetry using a straightforward energy balance. The rate of change of temperature during magnet cycling is plotted in Fig. 5 and temperature jumps due to energy dumps during magnet quenches are shown in Fig. 6. The absence of stratification is clearly visible although some of the temperature sensors are located as far apart as 1.5 m.

## REFERENCES

1. Taylor, C., Althaus, R., Caspi, S., Gilbert, W., Hassenzahl, W., Meuser, R., Rechen, J., Warren, R. 'Design of Epoxy-free superconducting magnets and performance in both helium I and pressurized helium II' IEEE Trans. on magnetics., Vol. MAG-17, No. 5, 1981, pp. 1571-1574.
2. Bon Mardion, G., Claudet, G., Seyfert, P., Verdier, J. 'Helium II in low-temperature and superconductive magnet engineering' Adv. cryo. Engineering, Vol.23, pp.358-362.
3. Warren, R. P., Lambertson, G. R., Gilbert, W. D., Meuser, R. W., Caspi, S., and Schafer, R. V. "A pressurized Helium II - cooled magnet test facility'. 8th Inter. Cryo. Engr. Conf., (1980), pp. 373-377.
4. Caspi, S. 'The use of Calorimetry in superfluid He II to measure losses in superconducting magnets.' 9th Inter. cryo. Engr. Conf., Kobe (1982).
5. Caspi, S., 'Gravitational convection of subcooled He I and the transition into superfluid He II at atmospheric pressure'. 8th Inter. cryo. Engr. Conf., (1980), pp. 238-242.

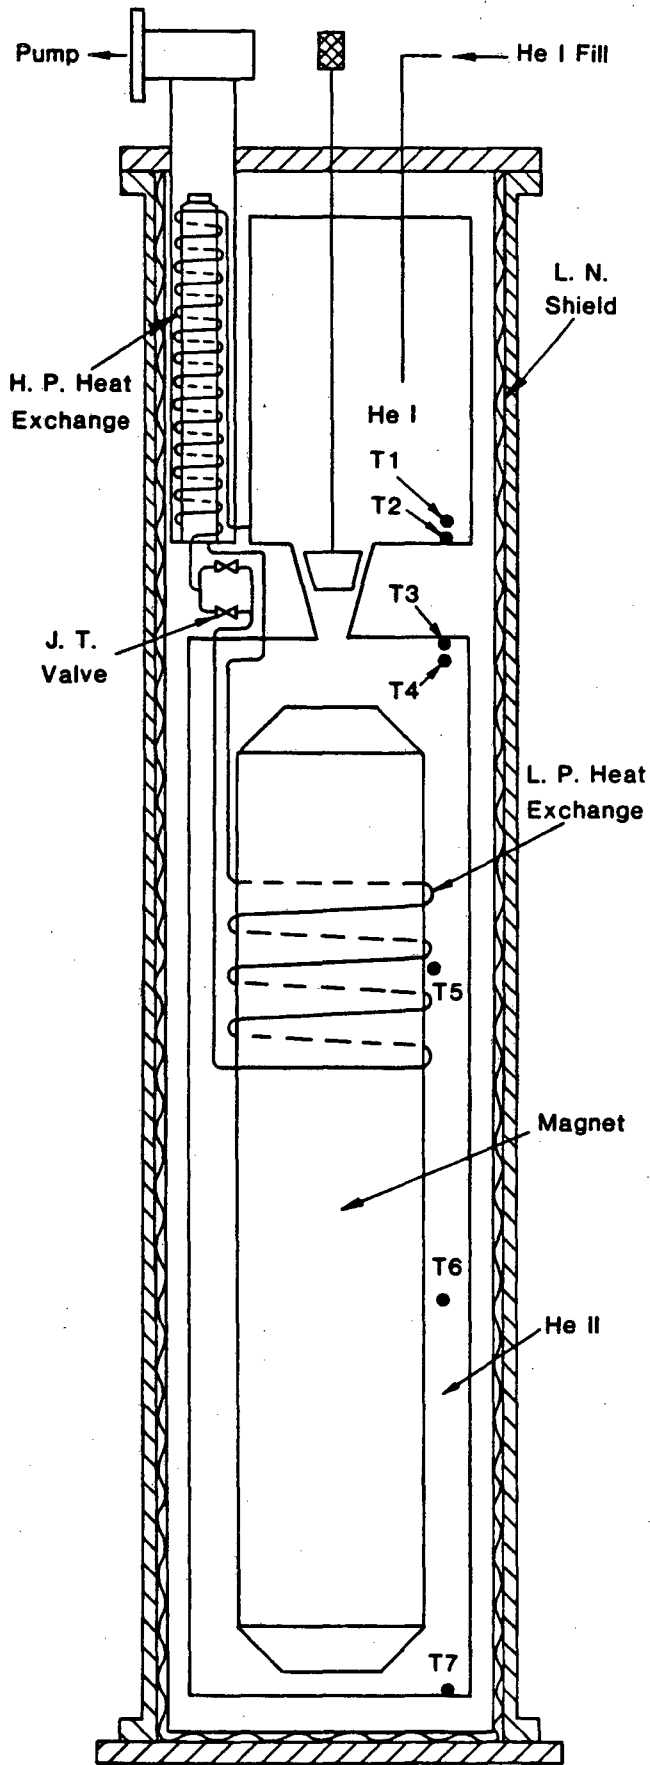

XBL 805-9703

Fig. 1 Helium II refrigeration system for testing Superconducting Magnets.

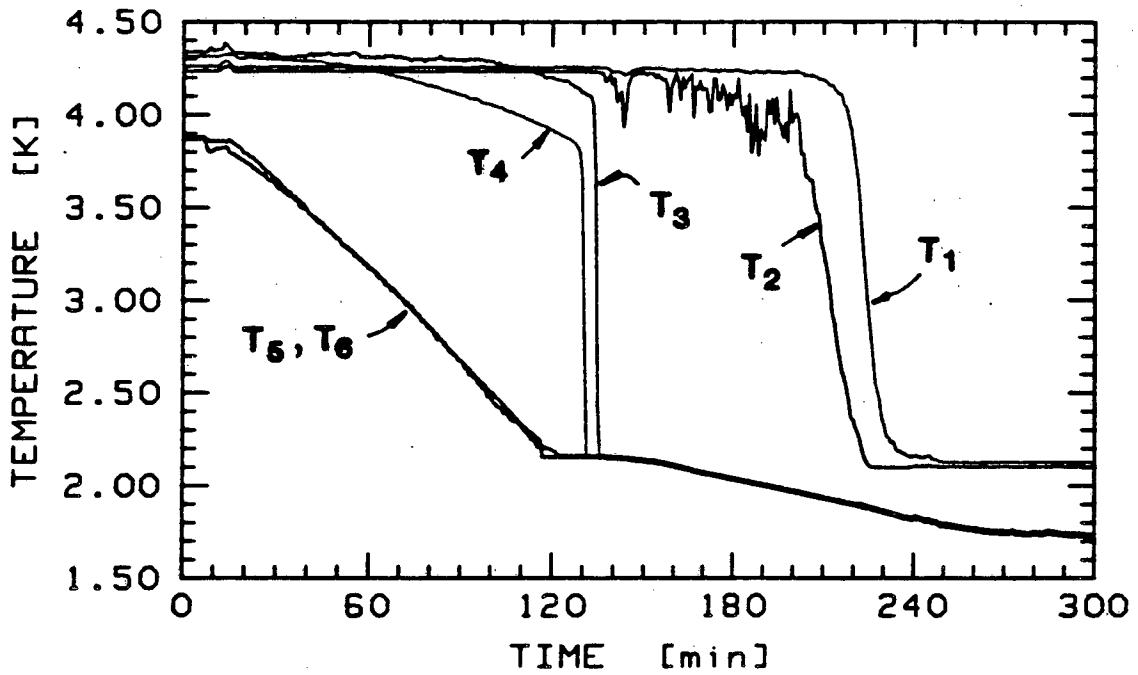


Fig. 2 Temperature at various locations in the cryostat during cooldown.

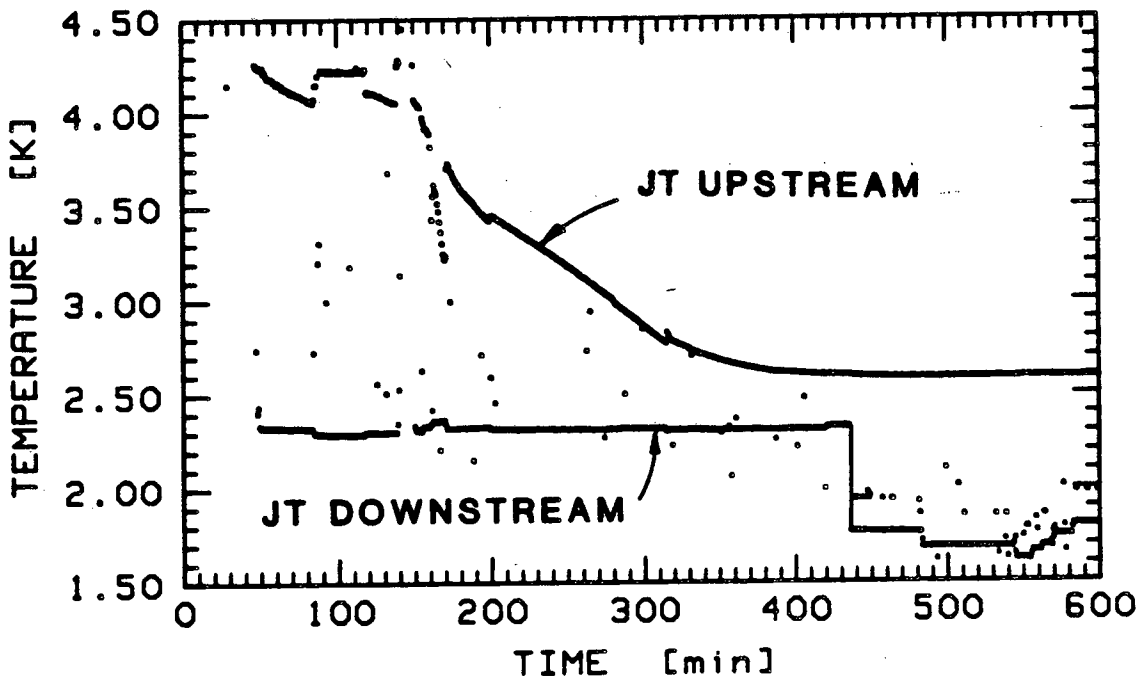


Fig. 3 Temperatures at the JT valve during cooldown.

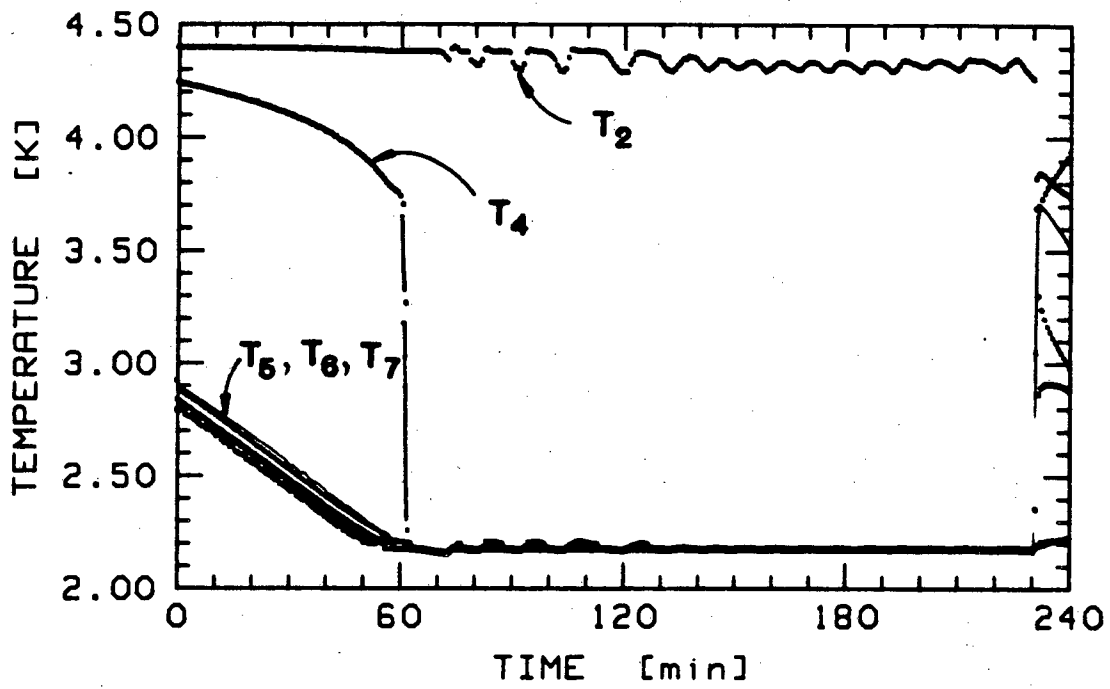


Fig. 4 A superleak inhibits cryostat cooldown below  $T_\lambda$ .

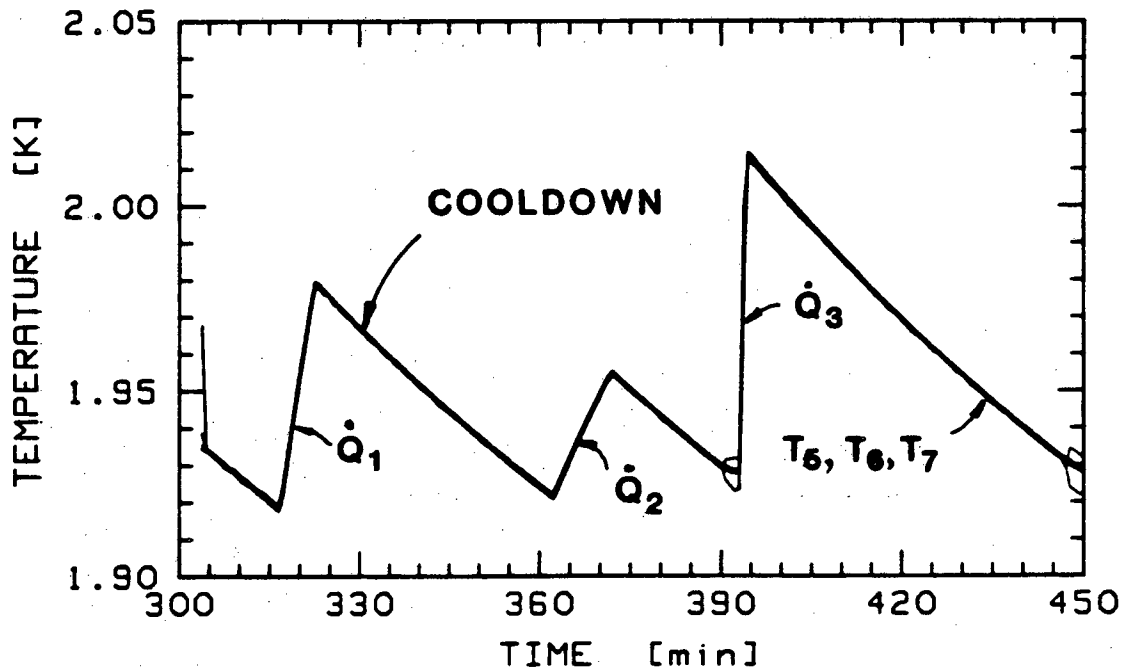


Fig. 5 Superfluid temperature response to various heat inputs.

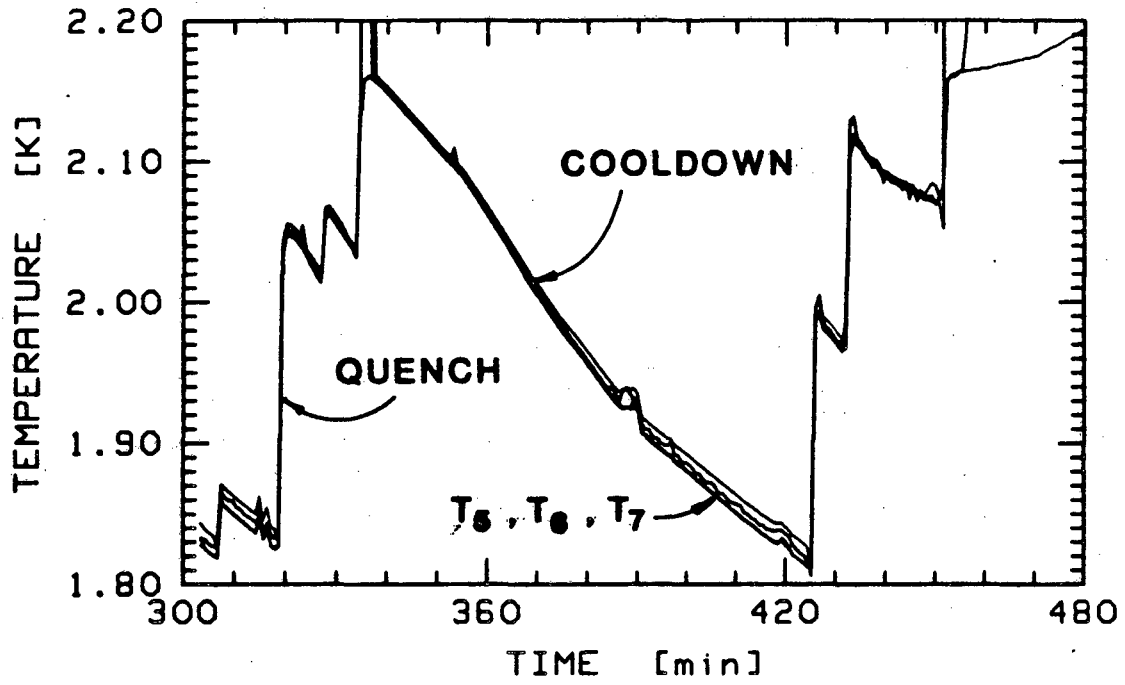


Fig. 6 Cryostat temperature variations for several quenches with some cooling in between.

This report was done with support from the Department of Energy. Any conclusions or opinions expressed in this report represent solely those of the author(s) and not necessarily those of The Regents of the University of California, the Lawrence Berkeley Laboratory or the Department of Energy.

Reference to a company or product name does not imply approval or recommendation of the product by the University of California or the U.S. Department of Energy to the exclusion of others that may be suitable.

TECHNICAL INFORMATION DEPARTMENT  
LAWRENCE BERKELEY LABORATORY  
UNIVERSITY OF CALIFORNIA  
BERKELEY, CALIFORNIA 94720