

# UC Davis

## Research Reports

### Title

CO2 and Cost Impact Analysis of a Microgrid with Electric Vehicle Charging Infrastructure:  
A Case Study in Southern California

### Permalink

<https://escholarship.org/uc/item/8br5m587>

### Authors

Enriquez-Contreras, Luis Fernando

Barth, Matthew

Ula, Sadrul

### Publication Date

2024-05-01

# CO<sub>2</sub> and Cost Impact Analysis of a Microgrid with Electric Vehicle Charging Infrastructure: A Case Study in Southern California

May 2024

An Article from the National Center for  
Sustainable Transportation

Luis Fernando Enriquez-Conteras, University of California,  
Riverside

Matthew Barth, University of California, Riverside

Sadrul Ula, University of California, Riverside

PRE-PRINT

Submitted to the 27<sup>th</sup> *IEEE International Conference on Intelligent Transportation Systems*,  
May 2024



## TECHNICAL REPORT DOCUMENTATION PAGE

|  |   |   |                         |
|--|---|---|-------------------------|
| <b>1. Report No.</b><br>NCST-UCR-RR-24-44  | <b>2. Government Accession No.</b><br>N/A                   | <b>3. Recipient's Catalog No.</b><br>N/A  |                         |
| <b>4. Title and Subtitle</b><br>CO <sub>2</sub> and Cost Impact Analysis of a Microgrid with Electric Vehicle Charging Infrastructure: a Case Study in Southern California   |   | <b>5. Report Date</b><br>May 2024   |                         |
|  |   | <b>6. Performing Organization Code</b><br>N/A                                     |                         |
| <b>7. Author(s)</b><br>Luis Fernando Enriquez-Conteras, <a href="https://orcid.org/0000-0002-0636-1216">https://orcid.org/0000-0002-0636-1216</a><br>Matthew Barth, PhD, <a href="https://orcid.org/0000-0002-4735-5859">https://orcid.org/0000-0002-4735-5859</a><br>Sadrul Ula, PhD  |   | <b>8. Performing Organization Report No.</b><br>N/A                               |                         |
| <b>9. Performing Organization Name and Address</b><br>University of California, Riverside<br>Bourns College of Engineering –Center for Environmental Research & Technology<br>1084 Columbia Avenue<br>Riverside, CA 92507  |   | <b>10. Work Unit No.</b><br>N/A   |                         |
|  |   | <b>11. Contract or Grant No.</b><br>USDOT Grant 69A3551747114                     |                         |
| <b>12. Sponsoring Agency Name and Address</b><br>U.S. Department of Transportation<br>Office of the Assistant Secretary for Research and Technology<br>1200 New Jersey Avenue, SE, Washington, DC 20590  |   | <b>13. Type of Report and Period Covered</b><br>Pre-Print (June 2021 – June 2022) |                         |
|  |   | <b>14. Sponsoring Agency Code</b><br>USDOT OST-R                                  |                         |
| <b>15. Supplementary Notes</b><br>Paper submitted to the 27 <sup>th</sup> IEEE International Conference on Intelligent Transportation Systems, May 2024.   |   |   |                         |
| <b>16. Abstract</b><br>As a part of an innovative Intelligent Transportation System (ITS), this paper investigates the effectiveness of transportation-based microgrid configurations in reducing carbon dioxide (CO <sub>2</sub> ) emissions and electricity costs. A case study at the University of California, Riverside (UCR) utilizes high-resolution California Independent System Operator (CAISO) CO <sub>2</sub> emission data to assess the environmental impact of each microgrid configuration. It also compares electricity costs to determine potential consumer savings. The results demonstrate that a load-following transportation microgrid strategy can significantly reduce CO <sub>2</sub> emissions (67%–84%) and achieve annual cost savings of approximately \$24,000, even when accounting for the additional demand from daily electric vehicle (EV) charging at the building. However, battery sizing is crucial for cost-effectiveness, as load-following exhibits diminishing returns. Doubling battery capacity may yield negligible reductions in electricity costs and CO <sub>2</sub> emissions after exceeding certain threshold. This emphasizes the importance of optimizing battery capacity to achieve a balance between cost and environmental impact. The study further reveals that Level 2 chargers in a commercial building generally have minimal impact on building demand and energy charges. Conversely, a single Level 3 DC fast charger has a more significant impact, requiring increased solar and battery storage capacity for further cost reduction. |   |   |                         |
| <b>17. Key Words</b><br>Infrastructure for charging, communication and controls, energy storage and control systems, electric vehicles   |   | <b>18. Distribution Statement</b><br>No restrictions.                             |                         |
| <b>19. Security Classif. (of this report)</b><br>Unclassified  | <b>20. Security Classif. (of this page)</b><br>Unclassified | <b>21. No. of Pages</b><br>11   | <b>22. Price</b><br>N/A |

## **About the National Center for Sustainable Transportation**

The National Center for Sustainable Transportation is a consortium of leading universities committed to advancing an environmentally sustainable transportation system through cutting-edge research, direct policy engagement, and education of our future leaders. Consortium members include: the University of California, Davis; California State University, Long Beach; Georgia Institute of Technology; Texas Southern University; the University of California, Riverside; the University of Southern California; and the University of Vermont. More information can be found at: [ncst.ucdavis.edu](http://ncst.ucdavis.edu).

## **Disclaimer**

The contents of this report reflect the views of the authors, who are responsible for the facts and the accuracy of the information presented herein. This document is disseminated in the interest of information exchange. The report is funded, partially or entirely, by a grant from the U.S. Department of Transportation's University Transportation Centers Program. However, the U.S. Government assumes no liability for the contents or use thereof.

The U.S. Department of Transportation requires that all University Transportation Center reports be published publicly. To fulfill this requirement, the National Center for Sustainable Transportation publishes reports on the University of California open access publication repository, eScholarship. The authors may copyright any books, publications, or other copyrightable materials developed in the course of, or under, or as a result of the funding grant; however, the U.S. Department of Transportation reserves a royalty-free, nonexclusive and irrevocable license to reproduce, publish, or otherwise use and to authorize others to use the work for government purposes.

## **Acknowledgments**

This study was funded, partially or entirely, by a grant from the National Center for Sustainable Transportation (NCST), supported by the U.S. Department of Transportation (USDOT) through the University Transportation Centers program. The authors would like to thank the NCST and the USDOT for their support of university-based research in transportation, and especially for the funding provided in support of this project.

# CO<sub>2</sub> and Cost Impact Analysis of a Microgrid with Electric Vehicle Charging Infrastructure: a Case Study in Southern California

Luis Fernando Enriquez-Contreras<sup>\*†</sup>, Matthew Barth<sup>\*†</sup>, Sadrul Ula<sup>†</sup>

<sup>\*</sup>*Department of Electrical and Computer Engineering*

*University of California, Riverside*

Riverside, United States of America

lenri001@ucr.edu, barth@ece.ucr.edu

<sup>†</sup>*College of Engineering, Center for Environmental Research & Technology*

*University of California, Riverside*

Riverside, United States of America

lenri001@ucr.edu, barth@ece.ucr.edu, sula@cert.ucr.edu

**Abstract**—As a part of an innovative Intelligent Transportation System (ITS), this paper investigates the effectiveness of transportation-based microgrid configurations in reducing carbon dioxide (CO<sub>2</sub>) emissions and electricity costs. A case study at the University of California, Riverside (UCR) utilizes high-resolution California Independent System Operator (CAISO) CO<sub>2</sub> emission data to assess the environmental impact of each microgrid configuration. It also compares electricity costs to determine potential consumer savings. The results demonstrate that a load-following transportation microgrid strategy can significantly reduce CO<sub>2</sub> emissions (67%–84%) and achieve annual cost savings of approximately \$24,000, even when accounting for the additional demand from daily electric vehicle (EV) charging at the building. However, battery sizing is crucial for cost-effectiveness, as load-following exhibits diminishing returns. Doubling battery capacity may yield negligible reductions in electricity costs and CO<sub>2</sub> emissions after exceeding certain threshold. This emphasizes the importance of optimizing battery capacity to achieve a balance between cost and environmental impact. The study further reveals that Level 2 chargers in a commercial building generally have minimal impact on building demand and energy charges. Conversely, a single Level 3 DC fast charger has a more significant impact, requiring increased solar and battery storage capacity for further cost reduction.

**Index Terms**—Infrastructure for Charging, Communication and Controls, Energy Storage and Control Systems, Electric Vehicles

## I. INTRODUCTION

### A. Background

California is committed to reducing greenhouse gas emissions (GHG) through various approaches, particularly in the two largest sectors: transportation and electricity generation. In California, electric vehicles (EVs) accounted for 25.4% of Q2 2023 vehicle sales [1], and the state will ban the sale of internal combustion engine vehicles by 2035 [2]. Concurrently, California is expanding the number of EV charging stations in the state, with 13,844 Level 2 and 1,924 Level 3 stations [3] as of November 2023. EV technology has advanced, and new EVs can typically

charge up to 80% in 20-60 minutes [4]. This is made possible by Level 3 DC fast charging, which can deliver up to 350 kilowatts (kW), compared to Level 2 charging, which is limited to 19 kW [4]. While this reduced charging time has increased the attractiveness of EVs, it also poses a challenge for the owners of these chargers, as they can quickly demand a large amount of electricity demand. As California strives to increase the share of clean energy in its electricity mix, it also needs to reduce the CO<sub>2</sub> emissions from transportation by promoting electrification. This leads to two conundrums: how will California provide enough capacity for electrified transportation, and how clean is the grid that minimizes the emissions associated with battery electric vehicles? One method to alleviate the pressure on the grid is to localize electricity production and EV charging using microgrids. A microgrid is defined by the Department of Energy (DOE) and the Institute of Electrical and Electronics Engineers (IEEE) as: "a group of interconnected loads and distributed energy resources within clearly defined electrical boundaries that acts as a single controllable entity with respect to the grid. A microgrid can connect and disconnect from the grid to enable it to operate in both grid-connected or island-mode." [5] [6]. As microgrids and EV chargers become more widespread, it is essential to study the economic and environmental impacts of EV charging, especially fast charging, and the effect of microgrids on that impact. EV charging differs from typical building loads, as it can rapidly ramp up to high levels at random intervals based on human behavior, i.e., when they plug in. An outlier event where multiple people charge simultaneously can cause a significant peak in the load.

This research holds significant implications for the advancement of intelligent transportation systems, as it aims to address the economic needs of EV charging infrastructure owners and determine the optimal configuration that benefits both EV owners and the environment by

minimizing GHG emissions. This paper delves into the impacts of Level 2 and Level 3 charging infrastructure on the behavior of microgrids, associated electricity costs, and CO<sub>2</sub> emissions within the context of Southern California. The simulations are conducted using OpenModelica [7], a dynamic modeling and simulation environment. This study distinguishes itself from previous research in many ways, including employing a higher time resolution for calculating CO<sub>2</sub> emissions, capturing data every 15 minutes.

### B. Literature Review

Transportation microgrids have gained significant traction in recent years due to the growing demand for transportation electrification. These microgrids, which combine distributed energy resources (DERs) and energy storage systems with electric vehicle (EV) charging infrastructure, offer a promising solution for integrating EVs into the power grid while minimizing environmental impact. Previous studies have investigated the economic viability of transportation microgrids, primarily focusing on energy charges associated with EV charging. However, demand charges, which reflect the peak demand imposed on the grid, need to be addressed. This inclusion is crucial for fast charging stations, which draw significant power during peak periods. A more comprehensive approach to economic analysis should consider energy and demand charges, providing a more accurate assessment of the overall cost of operating a transportation microgrid. Research has addressed the impact of EV charging demand on transportation microgrids, often focusing on low-demand Level 2 charging. However, the increasing deployment of high-demand Level 3 charging requires a more nuanced understanding of its implications. Studies should incorporate a mix of Level 2 and Level 3 charging scenarios to accurately assess the impact of EV charging demand on microgrid operation and economics. Assessment of the GHG emissions associated with transportation-microgrids is often simplified by using average CO<sub>2</sub> emissions from an area's electricity production. This approach fails to capture the variations in CO<sub>2</sub> emissions throughout the day, which can significantly affect the environmental impact of EV charging. More sophisticated GHG emission calculations should consider the time-varying nature of CO<sub>2</sub> emissions, providing a more accurate representation of the environmental impact of transportation microgrids.

Several studies have investigated the performance of electric vehicle charging stations (EVCS) under varying conditions. Reference [8] is developing a demand and stochastic model for EVCS, followed by a techno-economic assessment and an environmental impact analysis. They concluded that the optimal configuration and investment costs of EVCS with solar integration are highly dependent on feed-in tariffs and solar irradiation levels. However, their CO<sub>2</sub> emission calculations were based on annual averages and did not account for intraday variations. They only considered energy charges, omitting demand charges in their economic analysis. Reference [9] proposed

a control algorithm for EVCS that can minimize charging time, minimize costs, or maximize renewable energy use depending on the scenario. They modeled charging loads using a uniform distribution during peak demand periods, assuming only Level 2 charging at 3.3 kW and excluding Level 3 charging. Reference [10] proposed an EV charging model that shifts charging events from peak demand periods to off-peak times. They found that their current method had limited impact on peak load shaving and that solar production surplus may only sometimes be diverted to EVs due to their low availability during those times. Their dataset was limited to one week, involving four EVs in a system with ten buildings. Reference [11] ran multiple scenarios with different self-consumption rates, comparing scenarios first and then calculating emissions for each. Their CO<sub>2</sub> emission calculations were based on whole-life-cycle CO<sub>2</sub> emissions without high time resolution. Reference [12] employed the Non-dominated Sorting Genetic Algorithm-II (NSGA-II) to analyze four different responses with EV penetration rates of 0%, 10%, 20%, and 30% using a Monte Carlo load profile. They achieved remarkable results but did not elaborate on their CO<sub>2</sub> calculations or provide a detailed analysis of the specific impacts of Level 2 versus Level 3 charging. Reference [13] analyzed IEEE 9 and 14 bus systems, forecasting EV loads one day ahead. They utilized multiple microgrids to balance out EV charging within the system, employing a multi-objective energy management approach for optimizing microgrid operation. The forecasted EV loads did not have sudden high-demand events nor level 3 charging, which makes the forecasting model challenging to implement. A similar problem arises in Reference [14], which performs a techno-economic analysis of PV EVCS with BESS. Their analysis also varies battery size to find the net present values that would make the project economically viable. However, it is limited to only one Level 2 electric vehicle. While their cost experiment spans the course of a year, it only uses the total energy for the year, which is multiplied by an annual CO<sub>2</sub> emissions rate.

### C. CO<sub>2</sub> Emissions

Our microgrid's solar production, shown in Fig. 1, largely overlaps with the local solar energy production within the larger grid. With a Battery Energy Storage System (BESS), we can utilize renewable energy during peak times and at night. In this scenario, the control algorithm is optimized to minimize cost for the consumer. However, we want to see how low-price EV charging aligns with actual CO<sub>2</sub> emission outputs. While the microgrid does not produce any direct CO<sub>2</sub> emissions, CO<sub>2</sub> emissions are attributed to the microgrid when it pulls power from the main power grid. The simulation uses emission output calculations from the California Independent System Operator (CAISO) for each time interval as a sum of all the powerplant CO<sub>2</sub> emissions (imports, natural gas, biogas, biomass, geothermal, coal)  $\frac{\text{m}^{\text{TONCO}_2}}{\text{hour}}$ . The CO<sub>2</sub> emissions output is divided by the amount of power produced (solar, wind,

geothermal, biomass, biogas, small hydro, grid batteries, large hydro, imports, nuclear, coal) in MW, which gives us an emissions rate of  $\frac{\text{mTON}_{\text{CO}_2}}{\text{hour}} \cdot \frac{1}{4000}$ . This is multiplied by 15-minute data kW and a multiplier. The multiplier of  $\frac{1}{4000}$  converts kW into W and addresses the four 15-minute periods in an hour. CAISO gives us an estimate of the amount of CO<sub>2</sub> emissions in mTON<sub>CO<sub>2</sub></sub> for every 15 minutes that is summed to give us the total for the entire period. This method is similar to the one used in [15]. The CO<sub>2</sub> calculations use 15-minute intervals to align with the time intervals used for billing and demand cost by electric utilities. When the microgrid does not pull power from the grid or is sending power, the CO<sub>2</sub> emissions are assumed to be zero since we are using renewable solar energy.

## II. SIMULATION IN OPENMODELICA

OpenModelica is an open-source implementation of the Modelica programming language [16]. Modelica is a programming language that is designed for dynamic systems simulation [7]. OMEdit is the GUI interface for OpenModelica, allowing the user to draw a system for simulation [17]. The microgrid scenarios are simulated in OpenModelica using the Modelica Buildings library. Lawrence Berkeley National Laboratory created the Modelica Buildings library for building and district energy and control systems [18]. Further, its capability for energy storage systems, bi-directional inverter, solar, and HVAC modeling make it ideal for a microgrid simulation setup. This allows us to create scenarios that do not currently exist in our microgrid, shown in Fig. 1, for example, running a month with solar with the same load or running the BESS control algorithm for different electric rates. The power circuits are three-phase balanced circuits. The simulation of our case study microgrid is the grid connected to the building netload. The model's net load is broken down into solar power, HVAC loads, regular building loads, electric vehicle chargers, and the BESS, as shown in Fig.1.

### A. Validation

A year of real-world data was used to validate the  $P_G$  output to ensure that our model accurately portrays our real-world system.  $P_G$  is the power the microgrid sends or consumes from the grid. The actual data was compared to the simulated with a correlation coefficient of  $\approx 0.965087$  as shown in Figure 2.

### B. Solar Generation and Building Loads

The solar power in our model is based on historical solar data from a 100 kW photovoltaic (PV) array. The HVAC loads and the regular building loads are represented separately in this model but utilize the same method; they both use historical real-world power data to represent their load in the system.

### C. EV Charger Loads

Our model also considers transportation loads in the form of EV chargers. The EV chargers are represented

as two models: Level 2 EV chargers (Fig. 5) and Level 3 EV chargers. While other building loads follow a typical daily and yearly pattern, EV loads are different since they stochastically switch on and off, depending on when people plug in. Our case study microgrid has four Level 2 chargers, so it can have four "steps" of 5 kW each, while there is only one "step" of 50 kW with the Level 3 chargers. SCADA data is used to generate EV loads in our model for the Level 2 charger. For the Level 3 charger, a Poisson random distribution is used to generate the number of charge sessions in a day, the arrival times, and charging durations based on real-world data recorded over a year.

Data from the Level-2 charger SCADA system was utilized to determine the parameters for the probability density function (PDF) depicted in Fig. 3. Additionally, the power output of the Level 2 chargers is illustrated in Fig. 4. Analysis of the historical data revealed three distinct peak charging periods occurring at 7:00, 9:00, and 13:00, respectively, with an average number of vehicle arrivals of 6, 2, and 1 during each peak. The Level 2 SCADA data is used in the Level 2 charger load simulation. The random arrivals for Level 3 charging are modeled with three peak times at 7:00, 9:00, and 13:00, with an average number of vehicle arrivals of 2, 1, and 1, respectively. Level 3 charging has a mean charging time of 30 minutes. The EV random arrivals function uses these parameters to generate random arrival times and durations. The function employs the NumPy library [19] [20] in Python to create a Poisson random distribution with means centered around the peak times. To ensure consistency across different scenarios and prevent any outlier event from the EV charging load from disproportionately influencing higher demand events, a random data seed value of 10 was employed to ensure every charging event was the same.

### D. BESS and Load-Following

The BESS is modeled as a battery connected to a bi-directional inverter. Data generated by the control algorithm controls the BESS output. The BESS output is computed in real-time using a load-following algorithm utilizing BESS SOC and the grid meter output. The algorithm charges the battery when excess solar power is exported to the grid and when the battery needs to be charged. Our algorithm reads the net load from the grid model and determines the amount of CO<sub>2</sub> produced during that interval. Algorithm 1 shows the load the following algorithm sufficient for 0 kW operation.

## III. RESULTS

The charging setup in OpenModelica is modified for different layouts and scenarios, as described in Table I.

Scenario 1 represents the baseline case where only the building loads, such as air conditioners, appliances, and lights, are connected to the grid. Scenario 2 represents a building installing four Level 2 EV chargers. Scenario 3 adds one Level 3 charger to the building and the Level

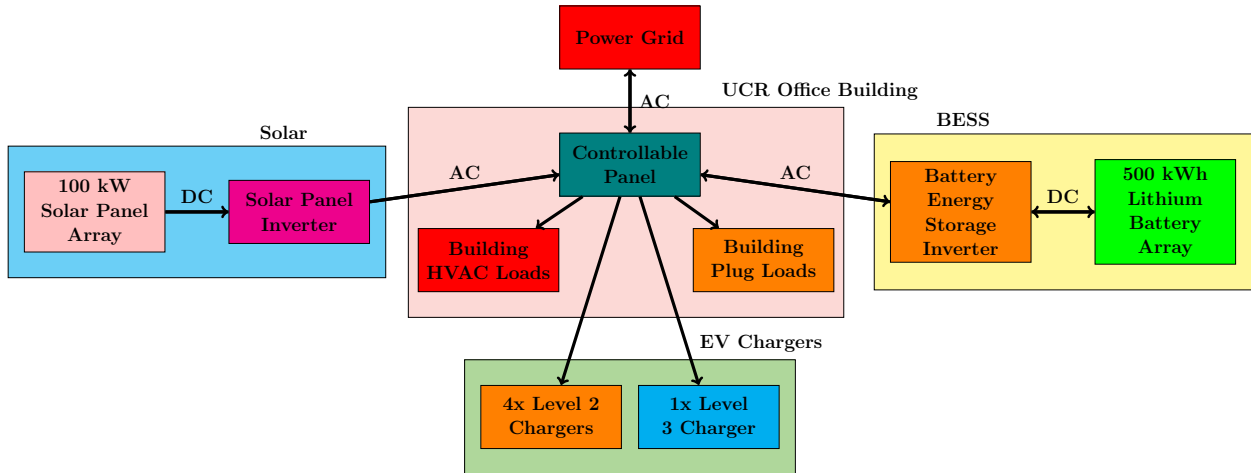


Fig. 1: Microgrid Architecture of our Case Study Example BESS: Battery Energy Storage System

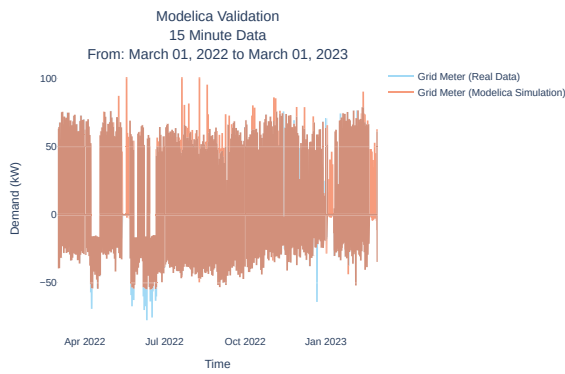


Fig. 2: Whole Year Validation of the Microgrid Architecture in Open-Modelica. The bright blue and red are the real data and simulated data, respectively. The dark red is the overlap between real and simulated data.

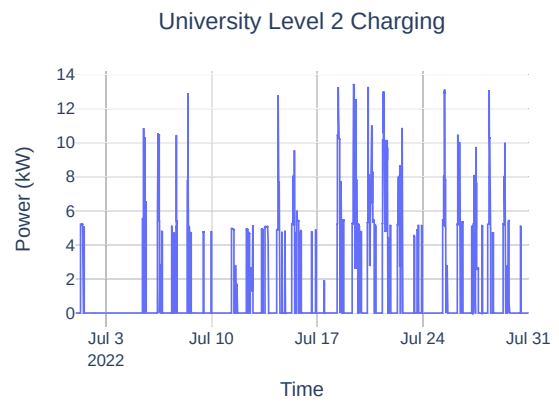


Fig. 4: Example Level 2 Chargers Power Draw from SCADA system

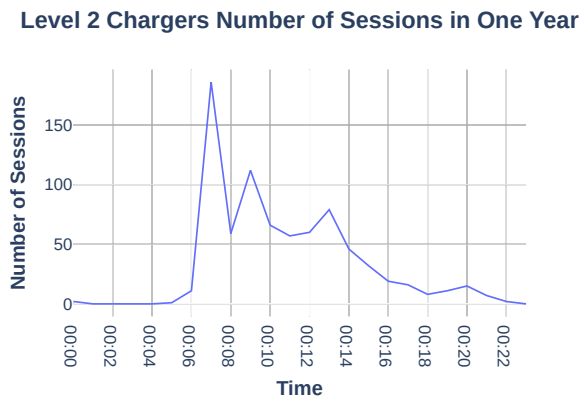


Fig. 3: Level 2 EV Charger Probability Density Function Created by Using Actual Charging Data Obtained from a SCADA System



Fig. 5: Level 2 Charging Setup



---

**Algorithm 1: Load-Following**

---

```
1 net_load, SOC ← Modelica Data Output
2 if net_load ≤ 0 kW and SOC > 20 % and net_load
   ≥ -100 kW then
3 | BESS_inverter = -net_load
4 else if net_load ≤ -100 kW and SOC > 20 % then
5 | BESS_inverter = -100 kW
6 else if net_load ≥ 0 kW and SOC < 90 % and
   net_load ≤ 100 kW then
7 | BESS_inverter = net_load
8 else if net_load ≥ 0 kW and SOC < 90 % then
9 | BESS_inverter = 100 kW
10 else
11 | BESS_inverter = 0
```

---

2 chargers. Scenario 4 is the first case that utilizes a microgrid, which includes 100 kW of solar power and 500 kWh of battery storage. This scenario demonstrates the peak-shaving capabilities of a microgrid without EV chargers, creating high demand. This can be thought of as the baseline case for the BESS microgrid. Scenarios 5, 6, 7, and 8 represent a transportation microgrid with EV chargers; the BESS capacity is varied to different sizes that include or exclude Level 3 charging to show which BESS size offers the lowest cost and the lowest CO<sub>2</sub> emissions, as well as the impact Level 3 charging has on the transportation-based microgrid.

Each scenario is run independently of the others, and the power outputs of the different components in the simulation are shown in Fig. 6. Scenarios 1, 2, and 3 are constantly negative, meaning they pull power from the grid. Scenarios 3-8, on the other hand, mostly stay at zero, meaning they either export power to the grid when the BESS SOC is over 90% or import power from the grid when it is under 20%.

While the load-following algorithm should limit the amount of power consumed at any time to near zero kW, there are still times when the BESS cannot supply the building with power. This happens when the BESS is too depleted, and there is little to no solar power to replenish it, as shown in Figure 9. The two main reasons for these events are multiple cloudy days and electrical faults. The larger the battery capacity, the less frequently the battery is depleted, and the microgrid can better weather events of low solar output. Most of the low solar power events occur during the winter months.

Figures 6, 7, and 8 show box plots of the power output. Fig. 6 is for the entire year, while Figures 7 and 8 show selected months. The box plots show that all three figures' mean and 75th percentile are almost identical at 0 kW. This implies that the following load functions correctly most of the time. However, the outliers show when the BESS fails to keep the power pulled from the grid at 0 kW. Fig. 6 shows that Scenarios 4 - 8 have almost identical values. However, this is because the figure is maximum

for the entire year. Only a few of the billing months have a solar outage long enough to cause BESS depletion that causes a demand peak almost as large as the no BESS scenario (Scenario 2).

Just one outlier will change the demand charge for the entire billing month. In some months, the maximum demand peak of Scenario 2 and 3 is similar since they have the same load, but for most of the months, it is reduced significantly, reflected in the reduced demand charges of the building.

Figures 9 and 10 demonstrate the challenges that arise when utilizing Level 3 charging compared to Level 2 charging. In Fig. 9, the microgrid mostly maintains zero power consumption from the grid, occasionally exporting power to the grid with minimal imports. In Fig. 10, the microgrid still maintains a mostly zero power consumption but experiences higher power imports from the grid due to battery depletion. While the demand peaks vary significantly between Level 2 and Level 3 charging, the overall energy consumption of the microgrid compared to local solar production remains similar, as shown in Table III.

The average daily CO<sub>2</sub> emissions from each scenario are shown in Fig. 11. Scenario 2, with its increased charging events, shows about a 26% increase in CO<sub>2</sub> emissions compared to Scenario 1. The CO<sub>2</sub> emissions from the transportation-microgrids are lower than a conventional building, even with the additional load from the EV chargers. This case study shows that integrating a BESS coupled with peak morning charging significantly alters the characteristic emissions profile of the microgrid, deviating from the conventional duck curve paradigm. Unlike the typical afternoon peak observed in traditional duck curve scenarios, the microgrid under examination exhibits a peak demand period during the early morning. This phenomenon is attributed to the near depletion of the battery reserve, diminished solar power generation, and heightened demand for electric vehicles (EVs) during this timeframe. Table II shows each scenario's emissions and electric price amounts.

#### IV. CONCLUSIONS

Transportation microgrids have emerged as a compelling solution for mitigating the electrical costs and emission levels associated with EV charging infrastructure. A comprehensive analysis of various scenarios reveals significant economic and environmental benefits of transportation microgrids compared to conventional systems, as depicted in Table II. For transportation-microgrid systems using a load-following algorithm, the estimated annual savings range is similar at around \$23,000 to \$24,000 for our case study, even with the additional demand from EV chargers. This implies that load-following transportation microgrids provide the same amount of savings even with varying demand and a sufficiently large BESS. The cost of demand and the cost of energy saved

TABLE I: Simulated Scenarios of the example UCR Microgrid under Different Battery Sizes and EV Charging Demands

| Scenario |   |
|----------|---|
| 1        | Standard Building with no EV Chargers   |
| 2        | Standard Building with Level 2 Charging   |
| 3        | Standard Building with Level 2 and Level 3 Charging                               |
| 4        | Microgrid Building with 100 kW Solar, 500 kWh BESS, and No EV Charging            |
| 5        | Microgrid Building with 100 kW Solar, 500 kWh BESS, and Level 2 Charging          |
| 6        | Microgrid Building with 100 kW Solar, 500 kWh BESS, Level 2, and Level 3 Charging |
| 7        | Microgrid Building with 100 kW Solar, 1 MWh BESS, and Level 2 Charging            |
| 8        | Microgrid Building with 100 kW Solar, 2 MWh BESS, Level 2, and Level 3 Charging   |

TABLE II: Microgrid Utility Prices and CO<sub>2</sub> Emissions Output under Different Battery Sizes and EV Charging Demands

| Scenario | Demand Charges (\$) | Energy Charges (\$) | Total Cost (\$) | CO <sub>2</sub> Emissions (mTons) |
|----------|---------------------|---------------------|-----------------|-----------------------------------|
| 1        | 6616                | 22736               | 29352           | 34                                |
| 2        | 8196                | 24607               | 32803           | 37                                |
| 3        | 14235               | 29693               | 43928           | 43                                |
| 4        | 3887                | 2387                | 6274            | 5                                 |
| 5        | 5133                | 3853                | 8986            | 7                                 |
| 6        | 11329               | 8238                | 19567           | 14                                |
| 7        | 5022                | 3814                | 8836            | 7                                 |
| 8        | 11400               | 8133                | 19533           | 14                                |

TABLE III: Microgrid Building Power Generation & Consumption  
(This table determines if the renewable energy produced is sufficient to meet demand)

| Billing Month              | Energy Produced (MWh) | Capacity Factor % | No EV Charging (MWh) | Level 2 Charging (MWh) | Level 2 & 3 Charging (MWh) |
|----------------------------|-----------------------|-------------------|----------------------|------------------------|----------------------------|
| Entire Interval            | 202                   | 23                | -183                 | -198                   | -239                       |
| Mar_01_2022 to Mar_31_2022 | 22                    | 29                | -14                  | -15                    | -19                        |
| Apr_01_2022 to Apr_30_2022 | 15                    | 21                | -15                  | -16                    | -19                        |
| May_01_2022 to May_31_2022 | 12                    | 16                | -10                  | -11                    | -14                        |
| Jun_01_2022 to Jun_30_2022 | 16                    | 23                | -21                  | -22                    | -26                        |
| Jul_01_2022 to Jul_31_2022 | 26                    | 36                | -21                  | -21                    | -25                        |
| Aug_01_2022 to Aug_31_2022 | 23                    | 31                | -22                  | -24                    | -27                        |
| Sep_01_2022 to Sep_30_2022 | 20                    | 28                | -21                  | -23                    | -26                        |
| Oct_01_2022 to Oct_31_2022 | 18                    | 24                | -16                  | -17                    | -21                        |
| Nov_01_2022 to Nov_30_2022 | 15                    | 21                | -12                  | -13                    | -16                        |
| Dec_01_2022 to Dec_31_2022 | 11                    | 15                | -11                  | -12                    | -15                        |
| Jan_01_2023 to Jan_31_2023 | 10                    | 13                | -8                   | -10                    | -13                        |
| Feb_01_2023 to Feb_28_2023 | 9                     | 14                | -7                   | -8                     | -11                        |

follow the same trend as the total cost, with the overall amount of savings being similar, \$3,000 and \$21,000, respectively, which is calculated from the commercial utility rate shown in Tables IV, V. Furthermore, load-following transportation-microgrids can reduce CO<sub>2</sub> emissions by 67% to 85%, approximately 30 tons of CO<sub>2</sub> in our case. It is important to note that while the scenarios show similar reductions in electricity prices and CO<sub>2</sub> emissions, users are strongly incentivized to acquire additional clean energy sources (solar and wind), especially when adding a Level 3 fast charger. At the same time, a couple of Level 2 chargers do not heavily strain an office building. The solar surplus rates make low CO<sub>2</sub> emission load-following more economically viable compared to just peak-shaving [22]. BESS reduces the energy pulled from the grid rather than

saving up energy to address a couple of peak cases in a month.

It is important to note that increasing the battery capacity does not necessarily guarantee improved microgrid performance. Addressing the most challenging solar power outages requires a significant increase in battery capacity while providing only marginal CO<sub>2</sub> and cost savings in return. Also, extra capacity is not very useful for CO<sub>2</sub> emissions reductions without adding extra solar power to charge the battery during daylight hours completely. Lastly, any sensible microgrid planning requires addressing three key parameters: clean energy generation, energy storage, and load management. Doing only two of the three creates situations where the microgrid alone cannot power the building.

TABLE IV: Riverside Public Utility Commercial Demand Rate [21]

|                       |  | Per Meter, Per Month Effective January 1, |          |          |          |          |
|-----------------------|--|---|----------|----------|----------|----------|
|                       |  | 2024                                      | 2025     | 2026     | 2027     | 2028     |
| Customer Charge       | Flat Charge  | \$22.10                                   | \$22.10  | \$22.10  | \$22.10  | \$22.10  |
| Reliability Charge    | Flat Charge  | \$90.00                                   | \$90.00  | \$90.00  | \$90.00  | \$90.00  |
| Network Access Charge | \$ Per kW  | \$1.75                                    | \$1.75   | \$1.75   | \$1.75   | \$1.75   |
| Demand Charge         | First 15 kW or less of billing demand, flat charge | \$160.95                                  | \$160.95 | \$160.95 | \$160.95 | \$160.95 |
| Demand Charge         | All excess kW of billing demand, per kW            | \$10.73                                   | \$10.73  | \$10.73  | \$10.73  | \$10.73  |

TABLE V: Riverside Public Utility Commercial Energy Rate [21]

Note: The solar surplus rate to sell electricity to the grid is \$0.076 per kWh [22]

| Per kWh Effective January 1, |                          | 2024     | 2025     | 2026     | 2027     | 2028     |
|------------------------------|--------------------------|----------|----------|----------|----------|----------|
| Tier 1                       | 0 – 30,000kWh            | \$0.1242 | \$0.1242 | \$0.1242 | \$0.1242 | \$0.1242 |
| Tier 2                       | Over 30,000 kWh, per kWh | \$0.1360 | \$0.1360 | \$0.1360 | \$0.1360 | \$0.1360 |

Scenarios Grid Power Output

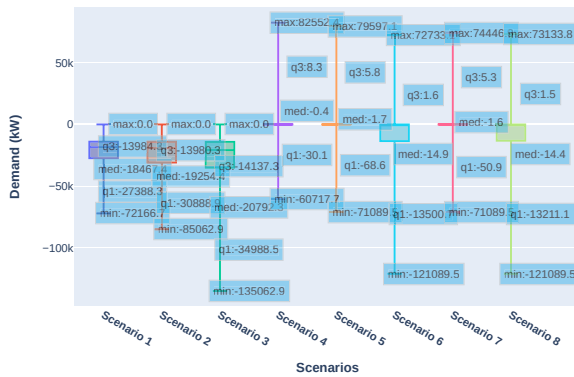


Fig. 6: power measured from the meter for the entire year

Scenarios Power Output  
From: July 01, 2022 to July 31, 2022

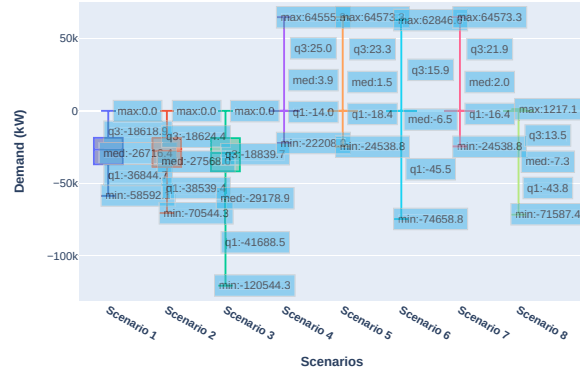


Fig. 8: Power measured from the meter for July

Scenarios Power Output  
From: March 01, 2022 to March 31, 2022

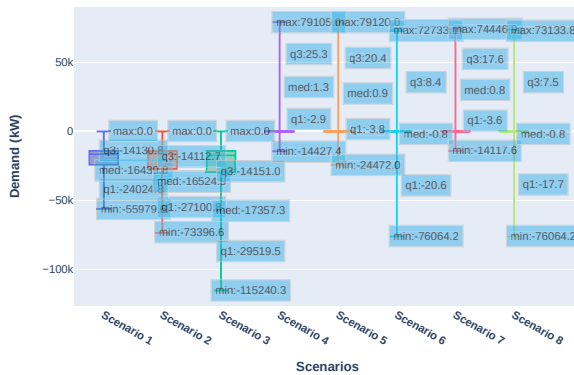


Fig. 7: Power measured from the meter for March

Scenario 7  
Microgrid Output  
From: July 01, 2022 to July 31, 2022

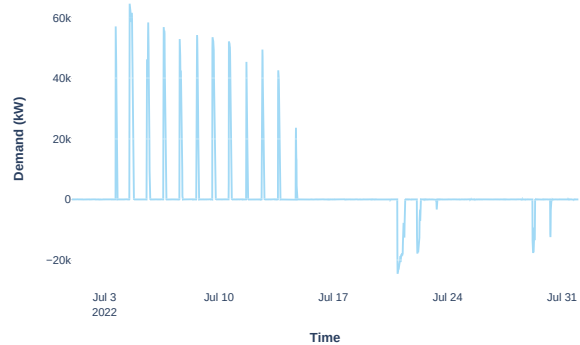


Fig. 9: Load Following Failures after Battery Depletion (Level 2 Charging, 1 MWh BESS)

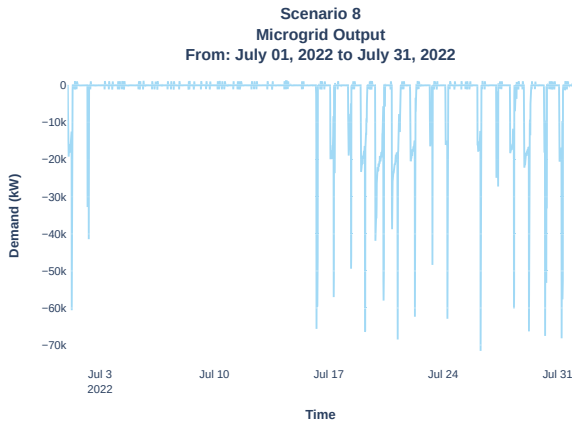


Fig. 10: Load Following Failures after Battery Depletion (Level 2 and Level 3 Charging, 1 MWh BESS)

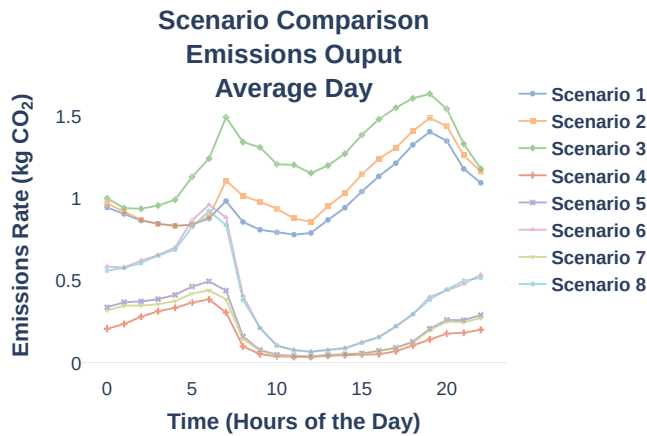


Fig. 11: CO<sub>2</sub> Emissions Outputs Averages During Times of Day, using a microgrid setup

## V. FUTURE WORK

Future research will explore different, more advanced control strategies to optimize the electric costs and CO<sub>2</sub> emissions of the transportation-microgrid. These strategies will include electric vehicle load allocation during high peak times, maximizing the use of the clean energy produced by the solar panels, and minimizing the power drawn from the grid during high CO<sub>2</sub> times. The effects of the new net energy metering policy in California on the value of the BESS system will also be assessed. The impact of different time-of-use (TOU) rates in California on electric costs and CO<sub>2</sub> emissions will be analyzed.

## REFERENCES

- [1] [Online]. Available: <https://www.gov.ca.gov/2023/08/02/milestone-1-in-4-new-cars-sold-in-california-were-zero-emission/>
- [2] [Online]. Available: <https://www.gov.ca.gov/2020/09/23/governor-newsom-announces-california-will-phase-out-gasoline>
- [3] [Online]. Available: [https://afdc.energy.gov/stations/#/analyze?country=US&fuel=ELEC&ev\\_levels=2&region=US-CA](https://afdc.energy.gov/stations/#/analyze?country=US&fuel=ELEC&ev_levels=2&region=US-CA)
- [4] [Online]. Available: <https://www.transportation.gov/rural/ev/toolkit/ev-basics/charging-speeds>

- [5] D. T. Ton and M. A. Smith, "The us department of energy's microgrid initiative," *The Electricity Journal*, vol. 25, no. 8, pp. 84–94, 2012.
- [6] K. R. Padiyar and A. M. Kulkarni, *Microgrids: Operation and Control*, 2019, pp. 415–453.
- [7] [Online]. Available: <https://modelica.org/modelicalanguage.html>
- [8] N. Himabindu, S. Hampannavar, B. Deepa, and M. Swapna, "Analysis of microgrid integrated photovoltaic (pv) powered electric vehicle charging stations (evcs) under different solar irradiation conditions in india: A way towards sustainable development and growth," *Energy reports*, vol. 7, pp. 8534–8547, 2021.
- [9] S.-G. Yoon and S.-G. Kang, "Economic microgrid planning algorithm with electric vehicle charging demands," *Energies*, vol. 10, no. 10, p. 1487, 2017.
- [10] A. Purvins, C.-F. Covrig, and G. Lempidis, "Electric vehicle charging system model for accurate electricity system planning," *IET Generation, Transmission & Distribution*, vol. 12, no. 17, pp. 4053–4059, 2018.
- [11] M. Khemir, M. Rojas, R. Popova, T. Feizi, J. F. Heinekamp, and K. Strunz, "Real-world application of sustainable mobility in urban microgrids," *IEEE Transactions on Industry Applications*, vol. 58, no. 2, pp. 1396–1405, 2022.
- [12] Y. Huang, H. Masrur, M. S. H. Lipu, H. O. R. Howlader, M. M. Gamil, A. Nakadomari, P. Mandal, and T. Senjyu, "Multi-objective optimization of campus microgrid system considering electric vehicle charging load integrated to power grid," *Sustainable Cities and Society*, vol. 98, p. 104778, 2023.
- [13] B. Tan and H. Chen, "Multi-objective energy management of multiple microgrids under random electric vehicle charging," *Energy*, vol. 208, p. 118360, 2020.
- [14] A. Sierra, C. Gercek, K. Geurs, and A. Reinders, "Technical, financial, and environmental feasibility analysis of photovoltaic ev charging stations with energy storage in china and the united states," *IEEE Journal of Photovoltaics*, vol. 10, no. 6, pp. 1892–1899, 2020.
- [15] J. Garrido, M. J. Barth, L. Enriquez-Contreras, A. J. Hasan, M. Todd, S. Ula, and J. Yusuf, "Dynamic data-driven carbon-based electric vehicle charging pricing strategy using machine learning," in *2021 IEEE International Intelligent Transportation Systems Conference (ITSC)*. IEEE, 2021, pp. 1670–1675.
- [16] [Online]. Available: <https://openmodelica.org/>
- [17] [Online]. Available: <https://openmodelica.org/doc/OpenModelicaUsersGuide/latest/omedit.html>
- [18] [Online]. Available: <https://simulationresearch.lbl.gov/modelica/>
- [19] [Online]. Available: <https://numpy.org/>
- [20] [Online]. Available: <https://numpy.org/doc/stable/reference/random/generated/numpy.random.poisson.html>
- [21] [Online]. Available: <https://riversideca.gov/utilities/sites/riversideca.gov/utilities/files/pdf/rates-electric/2024/Electric%20Schedule%20A%20-%20Effective%2001-1-24%20Final.pdf>
- [22] [Online]. Available: <https://riversideca.gov/utilities/sites/riversideca.gov/utilities/files/pdf/rates-electric/Electric%20Rate%20Schedule%20NEM%20-%20Attachment%201-%20Effective%2001-01-24%20.pdf>